

# **Kentucky Weatherization Field Guide SWS-Aligned Edition**

**Primary author: John Krigger**

**Illustrators: John Krigger, Bob Starkey,  
Steve Hogan, Wayne Harney, Darrel Tenter**

**Technical publisher: Darrel Tenter**

**Editors: Darrel Tenter, Timmie Smart, and Mary Coster**

***The Kentucky Weatherization Field Guide* describes procedures used to analyze and improve the performance of existing homes retrofitted under the Department of Energy's Weatherization Assistance Program and the State of Kentucky. This field guide is cross referenced to DOE's Standard Work Specifications for Home Energy Upgrades: March 2013 edition.**

**The author recognizes the knowledge, ingenuity, and creativity of the weatherization network throughout the United States for pioneering, changing, and perfecting the standards, specifications and procedures documented in this field guide.**

**Kentucky Technical Reviewers:**

**Gary Brown, John Cora, Mark Powell and Charles E. Smith**

**Copyright 2014 by**

**Saturn Resource Management, Inc.**

**Version 090114**

# Acknowledgments

We are Saturn Resource Management of Helena Montana. Our content expertise is energy conservation for buildings. We publish documents, create curricula, implement training, and consult.

We thank the Department of Energy's Weatherization Assistance Program (WAP) for promoting residential energy efficiency for more than 35 years. Without the DOE, our industry wouldn't exist as a building-science-based endeavor.

Weatherization agencies, State WAP grantees, private contractors, national laboratories, utility companies, and non-profit corporations have also contributed much to the content in this guide.

For many years, we've tried to list the specific people who have influenced Saturn's work in a substantial way. Now there are just too many contributors to list. You know who you are: thank you.

WAP energy specialists and energy experts associated with WAP are our most important contributors. Saturn's present and past staff have done a fine job of compiling the information in this field guide. Thanks to everyone who has reviewed this field guide and labored to improve it. Thank you, past-and-present customers, for allowing Saturn the privilege of serving you. We appreciate your business.

# Preface

This Weatherization Field Guide outlines a set of best practices for the Weatherization Assistance Program (WAP). Weatherization experts collaborating with the National Renewable Energy Lab (NREL) developed the Standard Work Specifications (SWS) beginning in 2009. These new SWS standards reside online in [NREL's SWS Tool](#).

The SWS presents details and outcomes for weatherization measures that are required when a weatherization agency selects a weatherization measure, based on its cost effectiveness. The technical content of this guide aligns with the SWS requirements.

A major purpose of this guide is to show how its contents are aligned with the SWS. Therefore, we've inserted hypertext references to the specific SWS details that our content aligns to. When you click on one of these references, the relevant detail appears in your browser.

This guide also incorporates information from the following standards and specifications.

- DOE Weatherization Job Task Analysis (2013)
- Building Performance Institute's (BPI) relevant standards
- WAP Policy Directives from 2005 to 2013
- International Residential Code 2012
- International Energy Conservation Code 2012
- Standards for combustion systems by The National Fire Protection Association (NFPA) 2009 editions, including NFPA 54, 31, and 211
- International Mechanical Code 2009

We begin this guide with health and safety, an important topic for both workers and clients. The first part of the chapter dis-

cusses client health and safety. The last part of the chapter covers worker health and safety.

Next, the guide presents a chapter on energy auditing, inspecting, customer relations, and work flow development. The following chapter discusses insulation and air sealing materials and their characteristics. We follow that with four chapters on the four distinct parts of the building shell: attics and roofs; walls; floors and foundations; and windows and doors.

The guide's largest chapter is heating and cooling. We created a separate chapter on ventilation, which includes whole-house ventilation, local ventilation, attic and crawl-space ventilation, and ventilation for cooling.

We've included a dedicated chapter on mobile homes where we discuss the ECMs particular to mobile homes. In this chapter we often refer to other sections of the guide that contain information that's relevant to both mobile homes and site-built homes.

The last chapter's topic, Air Leakage Diagnosis, is an effective tool for weatherization agencies to guide cost-effective air sealing. This chapter doesn't align to the SWS because the SWS doesn't detail testing procedures.

Like the SWS, this field guide is a living document and a work-in-progress. The field guide will change as the SWS changes. We hope you find this guide authoritative, easy to use, and well aligned to the SWS. We welcome all comments, suggestions and criticism. Thanks for your hard work and dedication in implementing the Weatherization Assistance Program.

John Krigger  
jkrigger@srmi.biz

# TABLE OF CONTENTS

## 1: Health and Safety

---

---

Fire Safety.....	20
Carbon Monoxide (CO) .....	21
Causes of Carbon Monoxide (CO) .....	22
Smoke and Carbon Monoxide (CO) Alarms .....	23
Smoke Alarms.....	24
CO Alarms.....	24
Gas Range and Oven Safety .....	25
Reducing Moisture Problems .....	28
Symptoms of Moisture Problems.....	30
Solutions for Moisture Problems .....	31
Crawl Space Moisture and Safety Issues .....	34
Ground Moisture Source-Reduction.....	35
Pollutants Source Control.....	37
Radon.....	37
Asbestos Containing Materials (ACM) .....	38
Lead-Safe Procedures .....	38
Electrical Safety.....	42
Decommissioning Knob-and-Tube Wiring.....	43
Constructing Shielding for Knob-and-Tube Wiring.....	44
Worker Health and Safety.....	44
Commitment to Safety .....	45
New Employees .....	46
Driving.....	47
Lifting and Back Injuries .....	48
Respiratory Health.....	50
Hazardous Materials.....	51
Equipment for Personal and Crew Safety .....	52
Falls.....	52
Tool Safety.....	54

Repetitive Stress Injuries.....	55
Safety for Crawl Spaces and Other Confined Areas.....	56
Safety for Extreme Weather.....	57
Kentucky H&S Plan Reference.....	58
SWS Alignment.....	82

## **2: Energy Audits and Quality Control Inspections**

---

Purposes of an Energy Audit.....	87
Energy-Auditing Judgment and Ethics.....	88
Energy-Auditing Record-keeping.....	89
Customer Relations.....	89
Communication Best Practices.....	90
Customer Interview.....	90
Deferral of Weatherization Services.....	91
Parts of an Energy Audit.....	92
Visual Inspection.....	93
Diagnostic Testing.....	93
SIR Calculations with ECM Selection.....	94
The Work Order.....	95
Questions about the Audit and Work Order.....	96
Work Inspections.....	96
In-Progress Inspections.....	96
Final Inspections.....	97
Quality Control Versus Quality Assurance.....	98
Field Monitoring.....	98
Understanding Energy Usage.....	99
Baseload Versus Seasonal Use.....	100
Energy Indexes.....	102

Customer Education . . . . .	103
SWS Alignment . . . . .	103

### **3: Weatherization Materials**

---

Air-Sealing Goals . . . . .	105
Air Sealing Safety . . . . .	106
Air Sealing and Fire Containment . . . . .	107
Air Sealing Materials . . . . .	108
Air Barrier Materials . . . . .	109
Stuffing Materials . . . . .	110
Caulking and Adhesives . . . . .	111
Liquid Foam Air Sealant . . . . .	113
Insulation Building Science . . . . .	115
Insulation Material Characteristics . . . . .	116
Fibrous Insulation Materials . . . . .	117
Operating the Insulation Blowing Machines . . . . .	121
Spray Foam Insulation Materials . . . . .	122
Fire Protection for Foam Insulation . . . . .	124
Foam Board Insulation . . . . .	124
Insulation Safety and Durability . . . . .	127
Insulation Durability . . . . .	127
SWS Alignment . . . . .	130

### **4: Attics and Roofs**

---

Air-Sealing Attics and Roofs . . . . .	133
Sealing around Manufactured Chimneys . . . . .	133
Sealing around Fireplaces and Chimneys . . . . .	134
Air Sealing Recessed Lights . . . . .	135
Sealing Stairways to Unconditioned Attics . . . . .	138
Sealing Porch Roof Structures . . . . .	139
Removing Insulation for Attic Air Sealing . . . . .	140
Sealing Joist Cavities Under Knee Walls . . . . .	141

Sealing Kitchen or Bathroom Interior Soffits . . . . .	141
Sealing Two-Level Attics . . . . .	142
Sealing Suspended Ceilings . . . . .	143
Insulating Attics and Roofs . . . . .	145
Preparing for Attic Insulation . . . . .	146
Safety Preparations for Attic Insulation . . . . .	148
Blowing Attic Insulation . . . . .	151
Closed-Cavity Attic Floors . . . . .	153
Insulating Closed Roof Cavities . . . . .	154
Exterior Rooftop Foam Insulation . . . . .	157
Installing Fiberglass Batts in Attics . . . . .	158
Cathedralized Attics (Open Cavity) . . . . .	159
Vaulted Attics . . . . .	160
Finished Knee Wall Attics . . . . .	161
Knee Wall Insulation . . . . .	164
Access Doors in Vertical Walls . . . . .	165
Walk-Up Stairways and Doors . . . . .	167
Insulating & Sealing Pull-Down Attic Stairways . . . . .	168
Parapet Walls . . . . .	169
Skylights . . . . .	169
Whole-House Fans . . . . .	170
SWS Alignment . . . . .	171

## **5: Walls**

---



---

Air Sealing Walls . . . . .	177
Built-In Cabinets/Shelves . . . . .	177
Wall Framing Around Fireplaces and Chimneys . . . . .	178
Pocket Door Cavities . . . . .	179
Cooling Appliances Installed through Walls or Windows . . . . .	179
Balloon Framed Walls . . . . .	180
Minor Air Sealing . . . . .	182
Window and Door Frames . . . . .	182
Rim Joist Area . . . . .	183
Masonry Surfaces . . . . .	183

Interior Wall Top Plates .....	183
Wall Insulation .....	184
Wall Insulation: Preparation and Follow-up.....	185
Retrofit Closed-Cavity Wall Insulation .....	189
Open-Cavity Wall Insulation .....	192
Insulated Wall Sheathing .....	196
Wall Insulation in a Retrofitted Frame Wall .....	197
Insulating Unreinforced Brick Walls .....	198
SWS Alignment.....	199

## **6: Floors and Foundations**

---

Thermal-Boundary Decisions: Floor or Foundation.....	201
Air Sealing Foundations and Floors.....	203
Plumbing Penetrations .....	203
Stairways to Unconditioned Areas .....	204
Incomplete Finished Basements .....	207
Cantilevered Floors.....	207
Preparing for Foundation or Floor Insulation .....	208
Rim-Joist Insulation and Air-Sealing.....	209
Installing Floor Insulation .....	210
Installing Fiberglass Batt Floor Insulation.....	212
Crawl-Space Wall Insulation .....	214
Basement Insulation.....	217
SWS Alignment.....	221

## **7: Windows and Doors**

---

Storm Windows .....	225
Exterior Aluminum Storm Windows.....	225
Interior Storm Windows .....	227
Window Repair and Air Leakage Reduction.....	228
Double-Hung Window Weatherization.....	228
Weatherstripping Double-Hung Windows.....	229

Window Replacement Specifications .....	231
Window Energy Specifications .....	232
Removing Old Windows .....	233
Installing Replacement Windows .....	233
Replacing Nailing-Fin Windows .....	234
Block-Frame or Finless Windows .....	236
Flush-Fin Window Replacement .....	239
Window Safety Specifications .....	240
Windows Requiring Safety Glass .....	240
Fire Egress Windows .....	243
Door Replacement and Improvement .....	244
Door Replacement .....	244
Door Adjustment and Repair .....	244
SWS Alignment .....	248

## **8: Heating and Cooling Systems**

---



---

Combustion-Safety Evaluation .....	251
Combustion Safety Tests .....	251
Leak-Testing Gas Piping .....	253
Carbon Monoxide (CO) Testing .....	254
Worst-Case CAZ Depressurization Testing .....	254
Mitigating CAZ Depressurization and Spillage .....	258
Zone Isolation for Atmospherically Vented Appliances .....	261
Electronic Combustion Analysis .....	262
Critical Combustion-Testing Parameters .....	264
Heating System Replacement .....	266
Combustion Furnace Replacement .....	266
Gas-Fired Heating Installation .....	269
Combustion Boiler Replacement .....	272
Oil-Fired Heating Installation .....	275
Evaluating Oil Tanks .....	278
Combustion Space Heater Replacement .....	279
Space Heater Operation .....	280
Unvented Space Heaters .....	281

Gas Burner Safety & Efficiency Service .....	282
Combustion Efficiency Test for Furnaces .....	282
Inspecting Gas Combustion Equipment .....	283
Testing and Adjustment .....	283
Oil Burner Safety and Efficiency Service.....	285
Oil Burner Testing and Adjustment.....	285
Oil Burner Inspection and Maintenance .....	289
Inspecting Furnace Heat Exchangers .....	291
Wood Stoves .....	292
Wood Stove Clearances.....	293
Stove Clearances .....	293
Wood Stove Inspection.....	294
Inspecting Venting Systems.....	297
Vent Connectors .....	297
Chimneys .....	300
Masonry Chimneys .....	300
Manufactured Chimneys.....	304
Chimney Terminations .....	305
Air Leakage through Masonry Chimneys .....	306
Special Venting Considerations for Gas.....	307
Venting Fan-Assisted Furnaces and Boilers .....	308
Combustion Air.....	310
Un-Confined-Space Combustion Air .....	311
Confined-Space Combustion Air .....	311
Ducted Air Distribution .....	315
Sequence of Operations .....	315
Solving Airflow Problems .....	315
Unbalanced Supply-Return Airflow Test.....	319
Evaluating Furnace Performance.....	322
Improving Forced-Air System Airflow .....	324
Evaluating Duct Air Leakage .....	327
Troubleshooting Duct Leakage .....	327
Measuring Duct Air Leakage with a Duct Blower.....	331
Measuring House Pressure Caused by Duct Leakage..	334

Sealing Duct Leaks .....	335
Sealing Return Ducts .....	335
Sealing Supply Ducts .....	337
Materials for Duct Sealing .....	340
Duct Insulation .....	340
Spray Foam Duct Insulation .....	342
Hot-Water Space-Heating Distribution .....	342
Boiler Efficiency and Maintenance .....	343
Distribution System Improvements .....	344
Steam Heating and Distribution .....	347
Steam System Maintenance .....	348
Steam System Energy Conservation .....	349
Programmable Thermostats .....	352
Electric Heat .....	352
Electric Baseboard Heat .....	353
Electric Furnaces .....	354
Central Heat-Pump Energy Efficiency .....	354
Room Heat Pumps .....	358
Ductless Minisplit Pumps .....	360
Evaluating Ducted Central Air-Conditioning Systems ...	361
Central Air-Conditioner Inspection .....	362
Air-Conditioner Sizing .....	364
Duct Leakage and System Airflow .....	364
Evaluating Air-Conditioner Charge .....	365
SWS Alignment .....	366

## **9: Ventilation**

---



---

Pollutant Control .....	373
Pollution-Control Checklist .....	374
Whole-Building Ventilation .....	374
Whole-Building Ventilation Requirement .....	375
Local Exhaust Ventilation Requirement .....	377
Infiltration Credit .....	378

Fan and Duct Specifications.....	380
Fan Specifications .....	380
Termination Fittings.....	382
Duct Sizing.....	384
Duct Materials and Installation.....	385
Whole-Building Ventilation Systems.....	386
Exhaust Ventilation.....	387
Supply Ventilation.....	388
Balanced Ventilation .....	390
Adaptive Ventilation.....	391
Attic Ventilation .....	392
Attic Ventilation as a Solution for Moisture Problems .	392
When to Install Attic Ventilation.....	392
Attic Ventilation Requirements .....	393
Power Ventilators .....	395
Unventilated Attics .....	395
Crawl Space Ventilation.....	396
Naturally Ventilated Crawl Spaces.....	396
Power-Ventilated Crawl Spaces .....	397
Conditioned Crawl Spaces .....	397
Ventilation for Cooling.....	398
Whole-House Fans .....	398
Window Fans.....	400
Air Circulation.....	401
Evaporative Coolers .....	401
SWS Alignment.....	406

## **10: Baseload Measures**

---

Refrigerator Replacement and Maintenance.....	410
Refrigerator Replacement .....	410
Refrigerator Cleaning and Tuning.....	411
Refrigerator Metering Protocol.....	412

Entertainment and Computer Systems .....	415
Lighting-Efficiency Improvements .....	416
Daylighting .....	416
Lighting Retrofit Equipment .....	417
Clothes Washer Selection/Replacement .....	419
Clothes Washer Selection .....	419
Clothes Washer Installation .....	419
Clothes Dryer Selection/Replacement .....	420
Clothes Dryer Selection .....	420
Clothes Dryer Installation .....	421
Clothes Dryers Service and Venting .....	422
Water-Heating Energy Savings .....	423
Water-Saving Shower Heads and Faucet Aerators ...	424
Water Heater Blankets .....	425
Measuring and Adjusting Hot Water Temperature ...	427
Heat Traps and Water-Heater Pipe Insulation .....	428
Selecting Storage Water Heaters .....	429
Determining a Storage Water Heater's Insulation Level ...	429
Storage Water-Heater Selection .....	431
Alternative Water-Heaters .....	431
Sidewall-Vented Gas Storage Water Heaters .....	431
On-Demand Gas Water Heaters .....	432
Heat Pump Water Heaters .....	432
Water Heater Installation .....	434
Comparing Water Heaters .....	435
Safety Comparison .....	435
Reliability Comparison .....	436
Efficiency and Energy Cost Comparison .....	437

SWS Alignment..... 438

## **11: Mobile Homes**

---

---

Mobile Home Air Sealing..... 444  
    Shell Air Leakage Locations..... 445  
    Duct Leak Locations..... 447  
    Belly Pressure Test..... 448

Mobile Home Insulation..... 450  
    Insulating Mobile Home Roof Cavities..... 450  
    Mobile Home Sidewall Insulation..... 455  
    Mobile Home Floor Insulation..... 457

Mobile Home Windows and Doors..... 460  
    Mobile Home Storm Windows..... 461  
    Replacing Mobile Home Windows..... 462  
    Mobile Home Doors..... 462

Cool Roofs for Mobile Homes..... 463

Mobile Home Skirting..... 465

SWS Alignment..... 465

## **12: Air Leakage Diagnostics**

---

---

Shell Air-Leakage Fundamentals..... 469  
    Goals of Air-Leakage Testing..... 470

House Airtightness Testing..... 472  
    Blower-Door Principles..... 472  
    Preparing for a Blower Door Test..... 474  
    Blower-Door Test Procedures..... 475  
    Approximate Leakage Area..... 478

Testing Air Barriers..... 478  
    Primary Versus Secondary Air Barriers..... 480  
    Simple Pressure Tests..... 481  
    Simple Zone Pressure Testing..... 483  
    Locating the Thermal Boundary..... 487

SWS Alignment ..... 490

**Appendices** **491**

---

---

R-values for Common Materials ..... 491

ASHRAE 62.2 Example Calculation..... 492

ASHRAE 62.2 Duct Sizing..... 493

Fire Testing and Rating ..... 494

Maximum CAZ Depressurization ..... 495

Gas Furnace Output Table ..... 496

BPI CO &Draft Decision Table ..... 497

Refrigerator Dating Chart ..... 498

**Glossary** **499**

---

---

**Index** **565**

---

---

# CHAPTER 1: HEALTH AND SAFETY

## *SWS Detail: 2.0100.1 Global Worker Safety*

This chapter discusses some of the most important hazards that you find both in residential buildings and on weatherization jobs. The SWS contains many health-and-safety requirements that relate to various cost-effective energy-conservation measures (ECMs). These SWS requirements are referenced in this chapter.

The chapter begins with health, safety, and durability of the building. If health-and-safety problems affect the cost-effective ECMs you select, solve the problems before or during the weatherization work.

Workers are the most important asset of WAP. We discuss their health and safety at the end of this chapter.

### Customer Health and Safety

House fires, moisture problems, carbon-monoxide poisoning, and lead-paint poisoning are the most common and serious health and safety problems found in homes.

Alert residents to any health and safety hazards that you find. Discuss known or suspected health concerns with occupants; take extra precautions based on occupant sensitivity to environmental hazards, such as chemicals and allergens.

- ✓ Inspect the home for fire hazards such as improperly installed electrical equipment, flammable materials stored near combustion appliances, or malfunctioning heating appliances. Discuss these hazards with occupants, and remove these hazards if possible.
- ✓ Understand and comply with the fire-containment code requirements of the IRC.

- ✓ Test combustion appliances for carbon monoxide and related hazards. Also measure carbon monoxide (CO) in the ambient air. Investigate and eliminate CO.
- ✓ Find moisture problems, and discuss them with the occupant. Solve moisture problems before or during weatherization work. *See page 25.*
- ✓ Obey the EPA Repair, Renovation, and Painting rules when working on homes built before 1978. Prevent dust during all weatherization projects. Explain the lead paint hazard and tell residents what you're doing to protect them. *See page 52.*

## Worker Health and Safety

In the worker-safety section at the end of this chapter, we discuss the most dangerous hazards present during weatherization and how to avoid these hazards. Hazards include: driving, falls, back injuries, cuts, chemical exposure, repetitive stress, and electrical shocks.

### 1.1 FIRE SAFETY

The building codes focus on preventing the spread of fire within and between buildings. A fire barrier is a wall assembly that has been tested and certified to withstand and contain a fire for a particular time duration.

A fire partition is a fire barrier that prevents the spread of fire between the sections of a building. A firewall is a structural fire barrier between buildings that is designed to remain standing during and after a fire.

Flame spread is a tested value of how fast a material burns compared to red oak planks.

A thermal barrier is a sheeting material that protects the materials behind it from reaching a temperature of 250°F or breaching during a fire. One-half-inch drywall is the most commonly used

thermal barrier and is rated for 15 minutes of protection. Fire partitions in multifamily buildings usually require a wall assembly with a 2-hour rating.


An ignition barrier is a material used with foam insulation to prevent the foam from igniting. The code specifies a number of materials that can serve as ignition barriers including drywall, plywood, fibrous insulation, galvanized steel, and intumescent paint.

*See also "Fire Testing and Rating" on page 494.*

## 1.2 CARBON MONOXIDE (CO)

*SWS Details: 2.0105.1 Combustion Worker Safety, 2.0201.2 Combustion Safety, 2.0201.1 Combustion Appliance Zone (CAZ) Testing*

Carbon monoxide is a colorless, odorless, poisonous gas. The EPA's suggested maximum 8-hour CO exposure is 9 ppm (as measured) in room air. CO at or above 9 ppm is often caused by malfunctioning combustion appliances in the home, although cigarette smoking or auto exhaust are also common CO sources. The EPA's one-hour CO limit is 35 ppm (as measured).

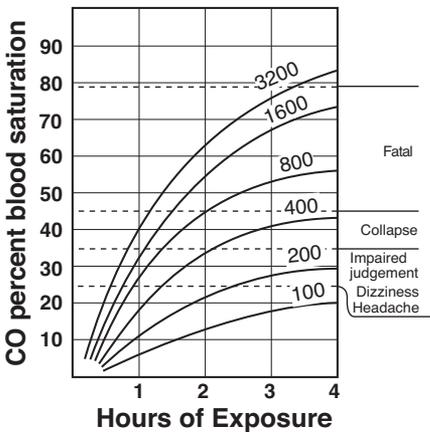

**Effects of CO:** This graph's 6 curves represent different CO exposure levels in PPM (parts per million).

Fatal

Collapse

Impaired judgement

Dizziness

Headache

## 1.2.1 Causes of Carbon Monoxide (CO)

CO is released by unvented gas space heaters, kerosene space heaters, backdrafting vented space heaters, gas ranges, leaky wood stoves, and motor vehicles idling near the home. Central furnaces and boilers that backdraft may also lead to high levels of CO.

CO is usually caused by these conditions.

- A combustion appliance is overfired compared to its rated input.
- Backdrafting combustion gases are smothering the flame.
- An object interferes with the flame (a pan over a gas burner on a range top, for example).
- Too-little combustion air.
- Rapidly moving air interferes with the flame.
- Burner misalignment causes a distorted flame.
- Flue or heat exchanger blockage interferes with the flow of flue gases.

Measure CO at the exhaust port of the heat exchanger. Identify and correct CO problems.

### Testing for Carbon Monoxide (CO)

The most common CO-test instruments use electronic sensors with a digital displays showing parts per million (ppm). Read the manufacturer's instructions on zeroing the meter — usually by adjusting the meter in outdoor air. CO test equipment must usually be re-calibrated every 6 months, using factory-specified procedures.

Air-free CO measurement includes both CO and O<sub>2</sub> sensing with a calculation to find the CO concentration in undiluted flue gases that contain no oxygen. Air-free CO measurement avoids the perception that moving the testing probe or diluting

CO are solutions to elevated levels of CO. *See "Carbon Monoxide (CO) Testing" on page 254.*

Technicians must test for CO both before and after weatherization.

### 1.3 SMOKE AND CARBON MONOXIDE (CO) ALARMS

Smoke alarms must be located:

1. In every sleeping room.
2. Outside of each sleeping area in the immediate vicinity of the bedrooms.
3. On each additional story (including basements).
4. In split level dwellings where an intervening door is located between the adjacent levels. However, in split level dwellings without an intervening door a smoke alarm installed on the upper level shall suffice for the adjacent lower level provided that the lower level is less than one full story below the upper level.

Homes with combustion appliances must also have a carbon monoxide (CO) alarm.

Install combination CO/smoke alarms in homes with combustion appliances that lack both smoke alarms and CO alarms.

Single-function alarms or combination alarms can interconnect electrically for whole-building protection. If one alarm sounds the other alarms sound too.

**Educate occupants about the alarms and what to do if the alarm sounds. Discuss the low-battery chirping sound and how to replace the battery. Tell residents that alarms last less than 10 years and that a different sound will alert them when the alarm fails.**

## 1.3.1 Smoke Alarms

### *SWS Detail: 2.0301.1 Smoke Alarm*

Install smoke alarms labeled UL 217 in buildings where they don't exist or don't work. Smoke alarms designed for the hearing impaired must be installed when the client is hearing impaired.

- ✓ Install one smoke alarm in each bedroom, in the immediate vicinity outside the bedrooms and on each floor.
- ✓ If mounted on a wall, mount the alarm from 4 to 12 inches from the ceiling.
- ✓ If mounted on a ceiling, mount the alarm at least 6 inches from the nearest wall.
- ✓ If battery powered, prefer long-life lithium batteries.
- ✓ If hard wired, connect the alarm to a circuit that is energized at all times.

Don't install smoke alarms in these situations.

- Within 12 inches of exterior doors and windows
- With an electrical connection to a switched circuit
- With a connection to a ground-fault interrupter circuit (GFCI)

## 1.3.2 CO Alarms

### *SWS Detail: 2.0301.2 Carbon Monoxide Alarm or Monitor, 2.0201.2 Combustion Safety*

CO alarms must have the capability to accurately detect and display low levels of carbon monoxide to 10ppm and comply with other program requirements. Electric plug-in CO alarms must have battery backup. CO alarms designed for the hearing impaired must be installed when the client is hearing impaired.

Install at least one CO alarm in all weatherized homes or weatherized apartments. CO alarms must comply with these specifications.

- ✓ Have a label with a UL 2034 listing and installed in accordance with the manufacturer's recommendations.
- ✓ If hard wired, connect to a circuit that is energized at all times by plugging in to an electrical receptacle.
- ✓ If battery powered, prefer long-life lithium batteries.
- ✓ Have a digital display of the CO measurement.
- ✓ Have a sensor-life alarm.

Don't install CO alarms in these situations.

- In a room that may get too hot or cold for alarm to function properly
- Within 5 feet of a combustion appliance, vent, or chimney
- Within 5 feet of a storage area for vapor-producing chemicals
- Within 12 inches of exterior doors and windows
- Within a furnace closet or room
- With an electrical connection to a switched circuit
- With a connection to a ground-fault circuit interrupter (GFCI)


## 1.4 GAS RANGE AND OVEN SAFETY

*SWS Details: 2.0100.1 Global Worker Safety, 2.0201.2 Combustion Safety*

Gas ovens can release CO into a kitchen. Oven burners are more likely to release CO compared to range-top burners so the oven burner is the most important burner to evaluate. Test the oven

for combustion safety with these steps and take the recommended actions.

1. Check oven for stored items. Turn the oven on and set it to bake on high temperature. **Sample the air-free CO level in exhaust gases at the oven vent and in the ambient air after 10 minutes.**
2. If the CO reading is over 100 ppm as measured or if the ambient-air reading rises to 35 ppm or more during the test, discontinue testing. Take action to reduce CO, including cleaning the oven, removing aluminum foil, adjusting the burner's gas control, or replacing the range and oven. Many range and oven burners are equipped with adjustable needle-and-seat valves.

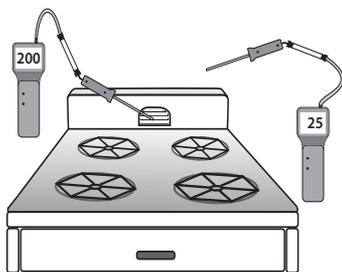

**CO from range and oven:** Measure CO at oven in undiluted flue gases. Air-free measurements require a capable analyzer.

3. If you suspect that the stove burners are producing CO, test each stove-top burner separately, using a digital combustion analyzer or CO meter. Hold the probe about 8 inches above the flame.
4. Clean and adjust burners producing more than 25 ppm as measured. Burners may have an adjustable gas control.

### Client Education about Ranges

Educate clients about the following safety practices in using their gas range.

- ✓ Never use a range burner or gas oven as a space heater.

- ✓ Open a window, and turn on the kitchen exhaust fan when using the range or oven.
- ✓ Buy and install a CO alarm, and discontinue use of the oven and range burners if the ambient CO level rises above 9 ppm, and the stove cannot be cleaned and/or repaired.
- ✓ Never install aluminum foil around a range burner or oven burner.
- ✓ Keep range burners and ovens clean to prevent dirt from interfering with combustion.
- ✓ Burners should display hard blue flames. Yellow or white flames, wavering flames, or noisy flames should be investigated by a trained gas technician.

**Caution:** To protect yourself and the occupants, measure ambient air in the kitchen during these tests. The ambient air should never be more than 35 parts per million (ppm) for one hour or 9 ppm (as measured) for any 8-hour period.

### CO Mitigation for Ovens

When you measure CO at 100 as measured or 200 ppm air-free, either at the oven vent while the oven is lit or 25 ppm as measured, 8 inches above the burner while they are lit, consider these remedies.

- Make adjustments to reduce the CO level, or recommend a service call by a gas combustion specialist to adjust the fuel-air mixture of the burners.
- Install a CO alarm in the kitchen.

In the case of CO measurements greater than the above standards, arrange an immediate service call to identify and correct the cause of CO production. Install an exhaust fan with a capacity of 100 cubic feet per minute (cfm) in the kitchen.

Kitchen exhaust fans installed as part of weatherization work must vent to out doors and be equipped with these features.

- Solid metal ducting to the outdoors.

- A weatherproof termination fitting.
- A backdraft damper, installed in the fan housing or termination fitting.
- Noise rating of less than 2 sones.

## 1.5 REDUCING MOISTURE PROBLEMS


### *SWS Detail: 2.0401.1 Air Sealing Moisture Precautions*

Moisture causes billions of dollars worth of property damage, sickness, and high energy bills each year in American homes. Water damages building materials by dissolving glues and mortar, corroding metal, and nurturing pests like mold, dust mites, and insects. These pests, in turn, cause respiratory illness.

Water reduces the thermal resistance of insulation and other building materials. High humidity also increases air-conditioning costs because the air conditioner removes moisture from the air to provide comfort.

The most common sources of moisture are leaky roofs and damp foundations. Other critical moisture sources include dryers venting indoors, showers, cooking appliances, and unvented gas appliances like ranges or decorative fireplaces. Clients control many of these moisture sources, so educate them about how to reduce the moisture sources discussed here.

Climate is also a major contributor to moisture problems. The more rain, extreme temperatures, and humid weather a region experiences, the more of its homes are vulnerable to moisture problems.

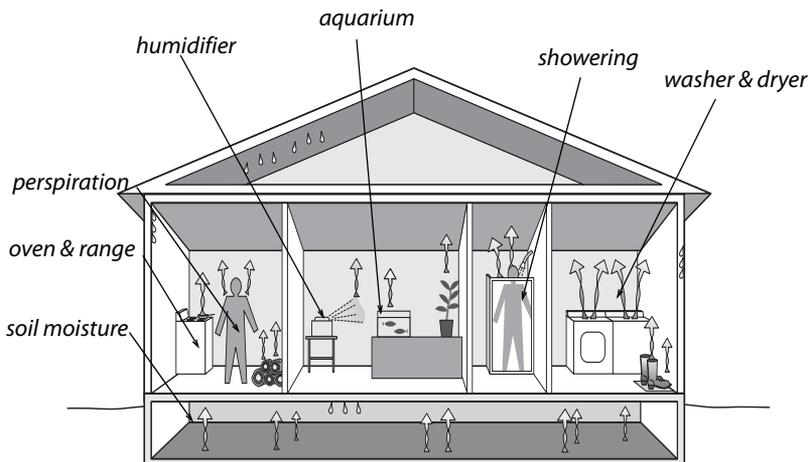

**Moisture sources:** Household moisture can often be controlled at the source by informed and motivated occupants, who work to control moisture sources like these.

Reducing moisture sources is the first priority for solving moisture problems. Next most important are air and vapor barriers to prevent water vapor from migrating through building cavities. Relatively tight homes need mechanical ventilation to remove accumulating water vapor.

**Table 1-1: Moisture Sources and Their Potential Contributions**

<b>Moisture Source</b>	<b>Potential Amount Pints</b>
Ground moisture	0–105 per day
Unvented combustion space heater	0.5–20 per hour
Seasonal evaporation from materials	6–19 per day
Dryers venting indoors	4–6 per load
Dish washing	1–2 per day
Cooking (meals for four persons)	2–4 per day
Showering	0.5 per shower


## 1.5.1 Symptoms of Moisture Problems

### *SWS Detail: 2.0401.1 Air Sealing Moisture Precautions*

Condensation on windows, walls, and other cool surfaces signals high relative humidity and the need to reduce moisture sources. During very cold weather or summer air conditioning, condensation may occur on cold surfaces. This occasional condensation isn't a major problem. However, if condensation is a persistent problem, reduce moisture sources. Adding insulation helps eliminate cold walls, ceilings, or air-conditioning ducts where water vapor condenses.

Moisture problems arise when parts of the building become wet often and stay wet for periods of time. Moisture in organic or porous building materials reaches a threshold that allows pests like mold, dust mites, and insects to thrive. These pests can cause or aggravate asthma, bronchitis, and other respiratory ailments because they produce potent biological allergens.

Rot and wood decay indicate advanced moisture damage. Unlike surface mold and mildew, wood decay fungi penetrate, soften, and weaken wood.

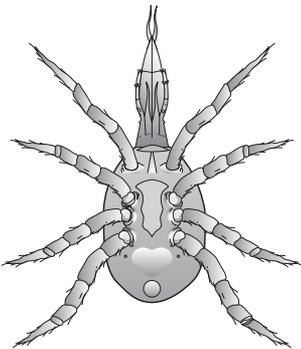

**Dust mites:** Biological pests create bioaerosols that can cause allergies and asthma.

Peeling, blistering, or cracking paint may indicate that moisture is moving through a wall, damaging the paint and possibly also the building materials underneath.

Corrosion, oxidation, and rust on metal are unmistakable signs of moisture problems. Deformed wooden surfaces may appear as the damp wood swells, and later warps and cracks as it dries.

Efflorescence is a white, powdery deposit left by water that moves through masonry and leaves minerals from mortar or the soil behind as it evaporates from the masonry surface. Concrete and masonry efflorescence indicates water movement through the home's foundation.

## 1.5.2 Solutions for Moisture Problems

*SWS Details: 2.0404.1 Stand-Alone Dehumidifiers, 2.0404.4 Basements—Dehumidification, 3.1488.3 Covers for Sump Pumps, Drains, Pits, and other Intentional Slab Penetrations*

Preventing moisture problems is the best way to guarantee a building's durability and its occupant's respiratory health. However, the solutions get progressively more expensive if simple solutions don't solve the problems.

### Inexpensive Moisture Solutions

If moisture source reduction isn't adequate to prevent moisture problems, try these solutions after preventive measures are in place.


- ✓ Install a ground moisture barrier, which is a piece of heavy plastic sheeting (6 mil minimum) laid on the ground. Black heavy plastic film works well, but tough cross-linked polyethylene is even more durable. Secure the edges to the foundation walls 6" above the ground with polyurethane adhesive and/or mechanical fasteners.
- ✓ Overlap the ground moisture barrier seams by 12" and seal with polyurethane adhesive.
- ✓ Verify that clothes dryers and exhaust fans vent to the outdoors and not into crawl spaces or attics.

- ✓ Seal water leaks in the foundation.
- ✓ Seal water leaks in the roof.
- ✓ Remove unvented space heaters, a major source of moisture, from the home.
- ✓ Educate clients about ways of reducing home moisture that are under their control.
- ✓ Educate customers to avoid excessive watering around the home's perimeter. Watering lawns and plants close to the house can dampen its foundation. In moist climates, keep shrubbery away from the foundation, to allow air circulation near the foundation.
- ✓ Insulate air-conditioning ducts to prevent summer condensation.

### More Costly Moisture Solutions


Follow these preventive measures before trying any of the solutions in the next section.

- ✓ Install or improve air barriers and vapor barriers to prevent air leakage and vapor diffusion from transporting moisture into building cavities. *See page 469.*

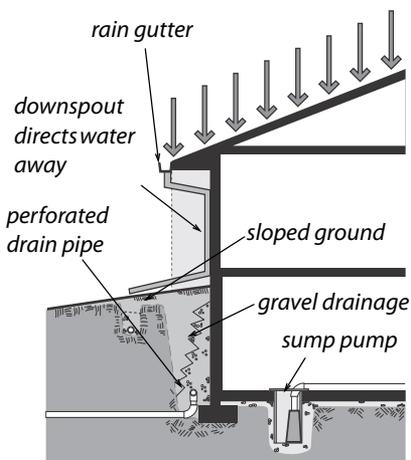

**Stopping water intrusion:**  
Take all necessary steps to protect homes from water intrusion.

- ✓ Add insulation to the walls, floor, and ceiling of a home to keep the indoor surfaces warmer and less prone to winter condensation. During cold weather, well-insulated homes can tolerate higher humidity without condensation than can poorly insulated homes.
- ✓ A sump pump is the most effective remedy when ground water continually seeps into a basement or crawl space and collects there as standing water. Persistent ground-water seepage may only be solved by connecting an interior perimeter drain to the sump. The sump should have an airtight cover to prevent sump-water evaporation.
- ✓ Ventilate the home with drier outdoor air to dilute the more humid indoor air. Ventilation is only effective when the outdoor air is drier than the inside air, such as in winter. In summer, outdoor air may be more or less humid than indoor air depending on climate and whether the home is air conditioned.

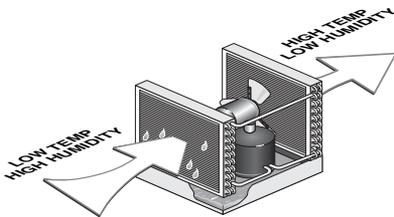

**Dehumidifiers:** In damp climates, dehumidifiers protect homes from excessive moisture.

## Dehumidifiers and Air-Conditioners for Drying

*SWS Detail: 2.0404.1 Stand-Alone Dehumidifiers, 2.0404.4 Basements—Dehumidification*

As a last resort, remove moisture from indoor air by cooling the air to below its dew point with dehumidifiers in winter and air-conditioners in summer. Using air conditioners and dehumidifiers for drying a home is the very most expensive solution. Try all the moisture solutions discussed previously before resorting to a dehumidifier.

The dehumidifier should meet these specifications.

- ✓ Must be ENERGY STAR or more efficient.
- ✓ Must have a fan-off option.
- ✓ Must retain automatic settings after power interruption.
- ✓ Must be rated for low temperature operation if located in a basement or crawl space.

When you install a dehumidifier, observe these requirements.

- ✓ Install the dehumidifier in a location that allows free air-flow around it.
- ✓ The dehumidifier should have automatic controls to limit energy and power.
- ✓ Make sure that the dehumidifier works and measure the relative humidity in the space before completing the installation.
- ✓ Drain the dehumidifiers collected water to a plumbing drain in a code-approved way.
- ✓ Give the homeowner the user guide, warranty information, and explain how to use the dehumidifier. Show the occupant how to clean or change the filter and how to clean the condensate drain.

### 1.5.3 Crawl Space Moisture and Safety Issues

*SWS Detail: 2.0111.2 Crawl Spaces—Pre-Work Qualifications, 2.0111.3 Crawl Spaces—Debris Removal, 2.0403.2 Closed Crawl Spaces—Ground Moisture Barriers, 2.0403.1 Vented Crawl Spaces—Ground Moisture Barrier*

Air, water vapor, liquid water, and pollutants move through soil and into crawl spaces and dirt-floor basements. Even if soil's surface seems dry and airtight, the soil may allow a lot of water vapor and soil gases to enter a home.


Cover the ground with an airtight moisture barrier to prevent the movement of moisture and soil gases from the ground into the crawl space using these procedures.

- ✓ The crawl space should have an access hatch or door that is 24 inches by 18 inches.
- ✓ Remove biodegradable matter, such as wood and cardboard, from the crawl space.
- ✓ Cover the ground completely with a ground moisture barrier such as 6-mil polyethylene where little or no foot traffic exists. Install reinforced or cross-linked polyethylene where the barrier will see foot traffic, such as when the crawl space is used for storage.
- ✓ The edges of the barrier should run at least 6” up the foundation walls and internal supporting structures. Fasten the barrier with wood strips, masonry fasteners, and sealant. Installers may also adhere the barrier with polyurethane adhesive or acoustical sealant to a clean and flat masonry surface.
- ✓ Seal the edges and seams with urethane, acoustical sealant, butyl caulking, or construction tape to create an airtight seal between the crawl space and the ground underneath.
- ✓ To avoid trapping of moisture against wood surfaces, ground moisture barriers must not touch wood structural members, such as posts, mud sills, or floor joists.

### 1.5.4 Ground Moisture Source-Reduction

Observe the following specifications for avoiding the deteriorating effects of ground moisture on building materials. Finish all of the following tasks before air sealing the floor or installing underfloor insulation

- ✓ Repair plumbing or sewer leaks.
- ✓ Solve all drainage problems, ground-water problems, wood-deterioration, and structural problems.

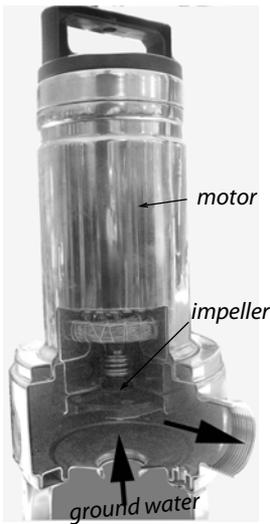

**Sump pump:** Pumps water out of a sump or basin where water collects in a basement or crawl space.

- ✓ Verify that the ground outside the home slopes away from the foundation or that water can't stand near the foundation.
- ✓ Install or repair rain gutters as necessary, and verify that downspouts discharge rainwater at least 3 feet away from the home.
- ✓ Verify that all combustion vents (chimneys), clothes-dryer vents, and exhaust fan vents are vented to outdoors and not into crawl spaces.
- ✓ Suggest a sump pump for crawl spaces or basements with a history of flooding. The sump pump should be located in an area where it collects water from the entire below-grade area and pumps it away from the foundation to daylight.
- ✓ Provide crawl-space ventilation which follows the requirements of the IRC and SWS. *See "Crawl Space Ventilation" on page 396.*

## 1.6 POLLUTANTS SOURCE CONTROL

Radon and asbestos are also important hazards to both occupants and workers.

### 1.6.1 Radon

*SWS Details: 2.0501.1 Radon—Air Sealing Considerations, 2.0501.2 Radon—Basements and Crawl spaces*

Radon is a dangerous indoor air pollutant that comes from the ground through rocky soil. Studies predict about 20,000 lung cancer deaths per year are caused by radon exposure.

Energy conservation work usually has little effect on radon concentrations. However, all housing specialists should be aware of: the radon hazard, radon testing procedures, and radon mitigation strategies.

The EPA believes that any home with a radon concentration above 4 pico-Curies per liter (pCi/l) of air should be modified to reduce the radon concentration. There are several common and reliable tests for radon, which are performed by health departments and private consultants throughout the U.S.

Since radon comes through the soil, mitigation strategies include the following.

- Installing a plastic ground barrier and carefully sealing the seams and edges
- Sealing the walls and floor of the basement
- Ventilating the crawl space or basement with an exhaust fan to dilute radon
- Depressurizing the ground underneath the basement concrete slab

The first two mitigation strategies may already be prescribed by the weatherization work order and may help to keep radon levels acceptable after air-sealing.

## 1.6.2 Asbestos Containing Materials (ACM)

### *SWS Detail: 2.0104.1 Insulation Worker Safety*

Asbestos is classified as a “known carcinogen.” Asbestos is found in the following materials: boiler and steam-pipe insulation, duct insulation, floor tile, siding, roofing, some types of vermiculite, and some adhesives. Weatherization workers must be trained to recognize asbestos and to avoid disturbing it. Penalties for mishandling asbestos-containing materials can amount to \$25,000 per day.

DOE weatherization policy requires weatherization agencies to observe the following safety precautions regarding asbestos.

- Asbestos siding comes in sheets approximately 16 inches by 24 inches. It is very weatherproof but very brittle. Remove asbestos siding only if you can remove the siding without damaging it.
- Assume that asbestos is present in old gray-colored pipe insulation and duct insulation. Don't disturb asbestos-containing pipe or duct insulation; also caution occupants to avoid disturbing asbestos.
- Don't cut, drill, scrape, sand or brush ACM.
- Don't remove vermiculite. Test vermiculite for asbestos, and use air monitoring if asbestos is present in the vermiculite in a home you're weatherizing.

Contract with certified asbestos testers and abatement specialists to mitigate asbestos problems before or during weatherization, if necessary.

## 1.6.3 Lead-Safe Procedures

### *SWS Detail: 2.0100.1 Global Worker Safety*

In 2010, The Environmental Protection Agency's (EPA) Lead-Safe Renovation, Repair, and Painting (RRP) rule became a legal mandate for weatherization work.

Lead dust is dangerous because it damages the neurological systems of people who ingest it. Children are often poisoned in pre-1978 homes because of paint disturbance during home improvement and because hand-to-mouth behavior is common. Workers are poisoned by dust containing lead.

Lead paint was commonly used in homes built before 1978. Contractors working on these older homes should either assume the presence of lead paint or perform tests to rule out its presence.


### EPA RRP Requirements

The RRP rule requires lead-safe containment procedures whenever workers disturb painted surfaces of more than 6 square feet of interior surface per room or more than 20 square feet of exterior surface per side by cutting, scraping, drilling, or other dust-creating activities in pre-1978 homes. Disturbing paint on windows and doors always requires containment.

The RRP requires certifications, warnings, dust-prevention, dust collection, and housecleaning as summarized here.

- ✓ With pre-1978 homes, either test for lead-based paint or assume that lead-based paint is present.
- ✓ Every pre-1978 weatherization or renovation job must be supervised by a certified renovator with 8 hours of EPA-approved training when workers will disturb more than the minimum paint area or when they will disturb paint on windows or doors.
- ✓ Renovation firms must be registered with the EPA and employ one or more certified renovators.
- ✓ Signs and barriers must warn occupants and passersby not to enter the work area.

- ✓ Floor-to-ceiling dust-tight barriers must prevent the spread of dust from the work area.

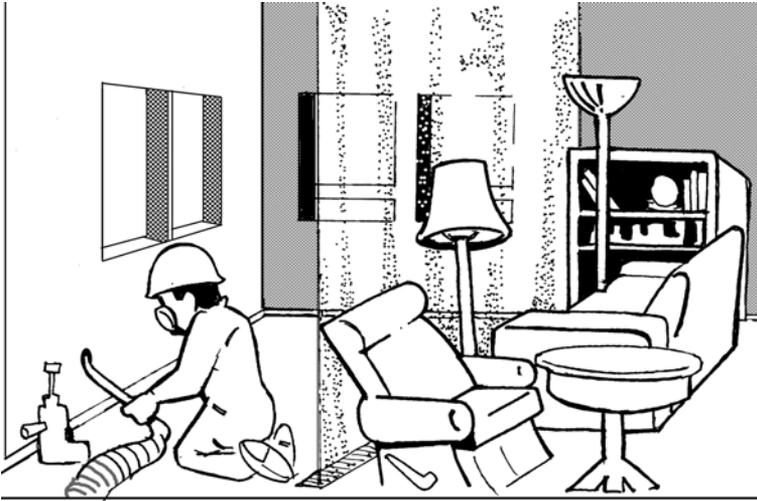

**Protective sheeting:** Dust-tight floor-to-ceiling barriers must separate work areas from living areas, according to EPA's RRP rule.

- ✓ Plastic sheeting must protect surfaces and fixtures within the work area.
- ✓ Workers must clean work surfaces sufficiently to pass an EPA-approved dust-wipe test, conducted by the certified renovator.
- ✓ Workers must not track dust from the work area into the home.

## Lead-Safe Work Practices

Lead-Safe Weatherization (LSW) is a set of procedures developed prior to the enactment of the RRP rule. LSW requires the same basic procedures as RRP in pre-1978 homes. When engaging in the paint-disturbing weatherization activities, follow these lead-safe work practices that were established by weatherization experts.

- ✓ Wear a tight-fitting respirator to protect yourself from breathing dust or other pollutants.
- ✓ Confine your work area within the home to the smallest possible floor area. Seal this area off carefully with floor-to-ceiling barriers made of disposable plastic sheeting, sealed at floor and ceiling with tape.
- ✓ Don't use heat guns or power sanders in LSW work.
- ✓ Spray water on the painted surfaces to keep dust out of the air during drilling, cutting, or scraping painted surfaces.



**Drill shroud connected to HEPA vacuum:** Collect dust where you're generating it.

- ✓ Erect an effective dust-containment system outdoors to prevent dust contamination to the soil around the home.
- ✓ Use a dust-containment system with a HEPA vacuum when drilling holes indoors.
- ✓ Avoid taking lead dust home on clothing, shoes, or tools. Wear boot covers while in the work area, and remove them to avoid tracking dirt from the work area to other parts of the house. Wear disposable coveralls, or vacuum cloth coveralls with a HEPA vacuum before leaving the work area.

Wash thoroughly before eating, drinking, or quitting for the day.

## 1.7 ELECTRICAL SAFETY


### SWS Detail: 2.0100.1 Global Worker Safety

Electrical safety is a basic housing need, requiring attention during home weatherization and repair.

Observe the following specifications for electrical safety in weatherizing existing homes.



**Non contact voltage tester:** Test voltage wires near your work area and take action to turn off the circuit if appropriate.



**S-type fuse:** An S-type fuse prohibits residents from oversizing the fuse and overloading an electrical circuit.


- ✓ Whenever working around wiring, use a non-contact voltage tester to determine whether circuits are live. Turn circuits off at circuit breakers as appropriate.
- ✓ Inspect wiring, fuses, and circuit breakers to verify that wiring isn't overloaded. Install S-type fuses where appropriate to prevent circuit overloading. Maximum ampacity for 14-gauge wire is 15 amps and for 12-gauge wire is 20 amps.
- ✓ Confirm that all wire splices are enclosed in electrical junction boxes. If you plan to cover a junction box with insulation, attach a flag to mark its location.
- ✓ Don't allow metal insulation shields to contact wiring.
- ✓ Verify that the electrical system is grounded to either a ground rod or to a water pipe with an uninterrupted electrical connection to the ground.

- ✓ Install S-type fuses where appropriate to prevent occupants from installing oversized fuses.
- ✓ Whenever you doubt the integrity of a client's electrical system, use a generator for operating power tools or insulation blowers.

## 1.7.1 Decommissioning Knob-and-Tube Wiring

### *SWS Detail: 4.1001.2 Knob and Tube Wiring*

Decommission knob-and-tube wiring before or during weatherization if possible. Try to convince your clients or their landlords to replace knob-and-tube wiring with their own funds.

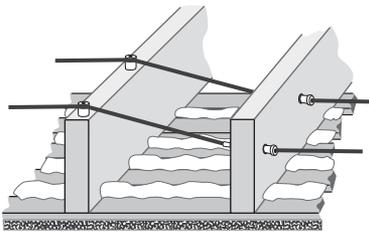

**Knob and tube wiring:** Obsolete and worn wiring should be replaced during energy retrofit work so that building cavities can be sufficiently insulated.

Use a non-contact voltage tester to determine whether the knob-and-tube wiring is live. If you're unsure about whether the wiring is still live, schedule an inspection by a qualified and experienced electrician.

If the knob-and-tube wiring in an attic is live, ask an electrician and/or an electrical inspector to determine whether the attic wiring can be decommissioned and replaced with non-metallic sheathed electrical cable. Depending on the situation, the electrician may choose one of these two options.


1. Terminate the existing attic knob-and-tube wiring, and connect the new NM circuit directly to the main service box.
2. Install a flagged junction box in the attic to connect the knob-and-tube riser to new NM cable in the attic.

Consider installing a hard-wired CO/smoke detector in a common area near the bedrooms on the new circuit.

## 1.7.2 Constructing Shielding for Knob-and-Tube Wiring

### *SWS Detail: 2.0601.1 Knob and Tube Wiring*

You may install attic insulation up to the bottom of knob-and-tube wiring, but never cover knob-and-tube wiring with insulation that covers the wires.

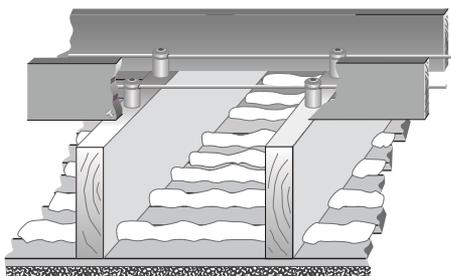

**Shielding knob and tube:** If you can't decommission knob-and-tube wiring, you may construct a dam to shield it from being covered by insulation.

- ✓ Construct structural dam to maintain a 3-inch clearance between attic insulation and knob-and-tube wiring. Do not cover the knob-and-tube wiring.
- ✓ Flag the shielding structure before insulating over it to mark it for future access or removal.

## 1.8 WORKER HEALTH AND SAFETY

### *SWS Detail: 2.0100.1 Global Worker Safety, 2.0106.1 Ventilation Worker Safety*

The personal health and safety of each employee is vitally important to every weatherization agency. Injuries are the fourth leading cause of death in the United States, while long-term exposure to toxic materials contributes to sickness, absen-

teeism, and death of workers. Both injury hazards and toxic substances are present during weatherization work.

The Occupational Safety and Health Administration (OSHA) establishes workplace safety standards. Weatherization staff and contractors must attend training on OSHA standards and observe these standards on the job. Safety always has priority over other factors affecting weatherization operations.

Some hazards deserve attention because of their statistical danger. Become aware of these most common workplace hazards.

- ✓ Vehicle accidents
- ✓ Falls
- ✓ Back injuries
- ✓ Exposure to hazardous materials
- ✓ Electrical hazards
- ✓ Repetitive stress injuries

### 1.8.1 Commitment to Safety

Workers may not remember safe work practices unless safety is periodically reinforced.

**Safety education:** Safety meetings are an essential part of a successful safety program.



- ✓ Arrange regular health and safety training.

- ✓ Conduct monthly safety meetings at headquarters and weekly safety meetings on the current jobsite.
- ✓ Provide well-equipped first-aid kits in the work vehicles and in the warehouse.
- ✓ Provide or require personal protective equipment for workers appropriate for their job duties.
- ✓ Provide a fire extinguisher in the warehouse and each work vehicle.
- ✓ Keep equipment in good condition.
- ✓ Observe all state and federal standards relating to worker health and safety.
- ✓ Keep lists of emergency-contact phone numbers for both employees and emergency services in the warehouse and in the work vehicles.
- ✓ Keep Material Safety Data Sheets (MSDSs) in the warehouse and in the work vehicles.

Safety requires communication and action. To protect yourself from injury and illness, learn to recognize hazards, communicate with co-workers and supervisors, and take action to reduce or eliminate hazards.

## 1.8.2 New Employees

New employees are several times more likely to injure themselves on the job compared to experienced workers. Before their first day on the job, new employees should learn about safety basics such as proper lifting, safe ladder usage, and safe operation of the power tools they will use on the job.



**New hire:** New hires are several times more likely to be injured than are experienced workers.

Be sure to inform new employees about hazardous materials they may encounter on the job. Show new hires the Material Safety Data Sheets (MSDS) required by OSHA for each material.


New employees should be required to use this common safety equipment.

- ✓ Proper clothing.
- ✓ Leather gloves with cuffs.
- ✓ Respirators.
- ✓ Safety glasses.
- ✓ Hearing protectors.

Ban alcohol and drugs from agency headquarters and the job. Staff members should be encouraged to refrain from smoking and to stay physically fit.

### 1.8.3 Driving

According to the Bureau of Labor Statistics, one-third of all occupational fatalities in the United States occur in motor-vehicle accidents. Staff members should organize their errands and commuting to the job site so as to minimize vehicle travel.

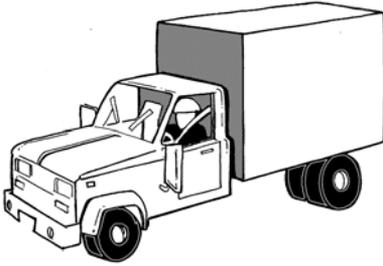

**Safe vehicles:** Maintain vehicles in good repair. Drivers and passengers should always wear seat belts.

Vehicles should be regularly inspected and repaired if necessary. Verify that these safety features are present and functioning.

- ✓ Brake system
- ✓ Steering system
- ✓ Horn
- ✓ Headlights
- ✓ Rear-view and side-view mirrors
- ✓ Directional signals
- ✓ Backup lights
- ✓ A fire extinguisher

Always wear seat belts. Before traveling to the job, secure tools and materials in the vehicle's cargo area to prevent shifting.

## 1.8.4 Lifting and Back Injuries

Back injuries account for one out of every five workplace injuries. Most of these injuries are to the lower back and result from improper lifting, crawling in tight spaces, and using heavy tools.

Workers often injure their backs by lifting heavy or awkward loads improperly or without help. Use proper lifting techniques such as lifting with the legs and keeping a straight back whenever possible. To avoid back injury, get help before trying to lift heavy or awkward loads, stay in good physical condition, and control your weight through diet and exercise.



**Awkward loads:** Ask for help when moving heavy or awkward loads.

Workers with limited lifting abilities because of weakness or prior injury should avoid heavy lifting.

These policies help prevent jobsite injuries.

- ✓ Redesign work activities: adapt equipment to minimize awkward movements on the job site.
- ✓ Perform strength-testing of workers, set lifting limits, and provide training for all workers on the causes and prevention of back injuries.
- ✓ Encourage breaks to prevent workers from being in straining positions for long time periods.
- ✓ Share the most difficult work among all capable crew members.

## 1.8.5 Respiratory Health

*SWS Detail: 2.0100.1 Global Worker Safety, 4.9901.1 General Information on Spray Polyurethane Foam (SPF), 2.0106.1 Ventilation Worker Safety*

Wear your respirator when working in a polluted environment. Common construction dust can contain toxins including lead, asbestos, and chemicals released by drilling, cutting, scraping. Liquid foam, caulking, and solvents release toxic organic vapors that require either organic vapor cartridges or a fresh-air supply.

Test your respirators to be sure they have a good fit.

- ✓ Check the straps and face piece to be sure they are soft and free of cracks.
- ✓ Strap on the respirator and adjust the straps to be snug but comfortable.
- ✓ Close the exhalation valve with a hand.
- ✓ Exhale gently and check for leaks around the edges.
- ✓ If there are leaks, adjust or repair the respirator.

When applying low pressure 2-component spray polyurethane foam, wear an air purifying mask with an organic vapor cartridge and a P-100 particulate filter.

Workers with beards, facial scars, and thick temple bars on eye-glasses must use full-face respirators to achieve a good seal. OSHA requires a completed form documenting employees' fit tests each year.

When spraying low-pressure polyurethane foam, use a respirator cartridge designed to filter organic vapors, and ventilate the area where you're spraying the foam. When spraying high-pressure polyurethane foam, use a supplied-air, positive-pressure respirator, and ventilate the area.


Learn how to recognize asbestos insulation that may be installed around older furnaces and boilers.

Control dust in your client's homes by erecting temporary barriers when you are doing work that may release dust. Wear coveralls when entering attics or crawl spaces. Coveralls should be disposable or laundered professionally.

## 1.8.6 Hazardous Materials

*SWS Detail: 2.0110.1 Material Selection, Labeling, and Material Safety Data Sheets (MSDSs), 2.0100.1 Global Worker Safety*

Your health and safety can be threatened by hazardous materials used on the job. Workers often fail to protect themselves from hazardous materials because they don't recognize the hazards. Breathing hazardous materials, absorbing them through the skin, and coming into eye contact with hazardous materials are common ways workers are injured by chemicals.

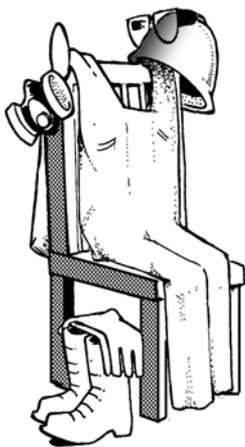

**Personal protective equipment:**  
Employees should own and maintain protective equipment to protect themselves from hazardous materials.

OSHA regulations require employers to notify and train employees about hazardous materials used on the job. A Material Safety Data Sheet (MSDS) for every workplace hazardous material should be readily available to employees. Obtain copies of MSDSs from manufacturers or their distributors. OSHA requires that the MSDSs be available at headquarters and at the jobsite for worker reference.

Learn how to handle hazardous materials used on the job. Use the personal protective equipment (PPE) that is recommended by the MSDS.

## 1.8.7 Equipment for Personal and Crew Safety

*SWS Detail: 2.0100.1 Global Worker Safety*

Worker should have their own personal protective equipment.

- Respirators with dust and organic-vapor cannisters
- Clean cloth coveralls or disposable coveralls
- Gloves
- Safety glasses
- Hearing protection
- Hard hat for head-injury hazards

Crews should equip themselves with the safety equipment listed here.

- Ladder levelers and stabilizers
- Portable lights for work in dark areas
- A water jug
- Insect spray
- Safe, heavy electrical cords with GFCI receptacles

## 1.8.8 Falls

*SWS Detail: 2.0100.1 Global Worker Safety*

Falls off ladders and stairs cause 13% of workplace injuries according to the National Safety Council. Other falls from the ladder heights account for approximately 7% of workplace injuries.



**Ladders:** Ladders are the most dangerous tools workers use.

Broken ladders and unstable ladders are both major causes of on-the-job falls. Step ladders, for instance, are often used for work that is too far off the ground, forcing workers to stand on the top step or to reach too far.

OSHA regulations include these important guidelines for ladder use.

- ✓ Maintain all ladders in good repair, and replace ladders if they have missing or damaged steps, cracked side-rails, or damaged feet.
- ✓ Extend extension ladders at least three feet above the area they access.
- ✓ Ladders shouldn't have a pitch steeper than four feet of rise for each foot that the ladder's feet are away from the building.
- ✓ Block or tie ladders firmly in place at the top and bottom if you install the ladder at a steeper angle than suggested above or on windy days.
- ✓ Don't use metal ladders where they may accidentally touch electrical conductors.

- ✓ Maintain ladders free of oil, grease, and other slipping hazards. Inspect your shoes for slipping hazard before climbing a ladder.
- ✓ Don't over-reach: instead move the ladder.
- ✓ Avoid carrying heavy loads up ladders and operating power tools from ladders.

Build scaffolding when working above-ground for sustained time periods. Each scaffold leg should be stabilized so that it supports an equal weight as other legs. Secure planks to the structure and provide handrails on the sides and ends of the walkway.



**Good housekeeping:** Clear stairs and walkways are essential to protect workers and clients alike from falls.

Workers should inspect their workplaces regularly to notice and remove slipping and tripping hazards. Workers carrying loads should create and maintain debris-free walkways.

### 1.8.9 Tool Safety

#### *SWS Detail: 2.0100.1 Global Worker Safety*

The tools used in construction work are dangerous if used improperly. About 90,000 people hurt themselves with hand tools each year. The crew chief should conduct tool safety training as frequently as necessary to insure safe tool use.

These basic safety rules can reduce the hazards of using hand and power tools.

- ✓ Use the right tool for the job.
- ✓ Keep all tools in good condition with regular maintenance.
- ✓ Inspect tools for damage before using them.
- ✓ Operate tools according to the manufacturer's instructions.
- ✓ Use appropriate personal protective equipment.
- ✓ Use double insulated power tools of ground-fault-circuit-interrupter (GFCI) outlets or extension cords to prevent electric shock.



**Electrical safety:** Maintain cords in good condition. Use ground-fault-circuit interrupter (GFCI) cords for outlets in wet conditions.

- ✓ Use generators for electrical service on the jobsite and ground them.
- ✓ Verify that generator exhaust is directed away from the home, the vehicle, and the crew.

### 1.8.10 Repetitive Stress Injuries

Repetitive stress injuries are caused by over-working certain parts of your body. Poor body posture, such as reaching above your head when operating a power drill, can encourage these injuries. Good work habits prevent this type of injury.

- ✓ Use a comfortable arm and hand posture when operating tools for a long period of time.

- ✓ Change the angle and location of your work surface frequently.
- ✓ Mix your difficult tasks with easier ones.
- ✓ Carry smaller loads.
- ✓ Take short rest breaks periodically, and stretch any tight muscles during this time.

When you purchase hand and power tools, look for models with ergonomic designs that place less stress on your body.

### 1.8.11 Safety for Crawl Spaces and Other Confined Areas

*SWS Detail: 2.0701.1 Crawl Spaces—Providing Access, 2.0701.2 Crawl Space Information Sign*

The Occupational Safety and Health Administration (OSHA) defines a confined space as a space that contains a hazard like confinement, limited access, or restricted airflow because of its small size.

#### Access to Confined Spaces

Employers must be aware of the hazards of confined spaces and have policies for protecting workers. Consider these requirements when appropriate.

- ✓ The crawl space must have an access hatch or door that is 24 inches by 18 inches.
- ✓ Workers should identify access and egress points before entering a confined space.
- ✓ If a heating and cooling system is located in the crawl space, the crawl space must have an access hatch or door measuring 22 inches by 30 inches or big enough to remove the heating and cooling system, whichever is greater.

## Chemicals in Confined Space

Observe these requirements when using chemicals in confined spaces.

- ✓ At minimum, workers using any type of chemical in a confined space must employ continuous powered ventilation using adequately sized openings to facilitate airflow into and out of the confined space.
- ✓ If workers use chemicals in significant quantities, such as spraying of two-part polyurethane foam, the workers should wear respirators that supply fresh air.
- ✓ If a confined space contains a hazard like chemical vapors or the potential to collapse or trap a worker, the space is called a permit-required confined space (PRCS). A worker must have a permit to enter the space and workers without permits must not enter. The permitted workers must have special training and equipment to enter the confined space.

### 1.8.12 Safety for Extreme Weather

#### *SWS Detail: 2.0100.1 Global Worker Safety*

Extreme weather is a common cause of job-related sickness and injury. You can avoid sickness and injury by awareness and preventive measures.

#### Hot Weather Safety

Know the signs of heat ailments and take action if you or a co-worker experiences the beginning of symptoms. Observe these hot-weather suggestions for staying cool and preventing heat ailments.

- ✓ Drink plenty of water and take salt tablets.
- ✓ Ventilate attics with fans.

- ✓ Rotate workers in attics to prevent heat exhaustion.
- ✓ Use water or ice to cool your skin.
- ✓ Rest when you feel fatigued.

### Cold Weather Safety

Workers and supervisors should know the temperature, wind speed, and precipitation forecast. Dress for extreme cold and plan work around storms and other extreme weather events.

- ✓ Dress in layers for comfort and changing temperatures.
- ✓ Wear insulated boots or heavy socks.
- ✓ Wear insulated gloves.
- ✓ Seek warm shelter if you experience numbness or uncomfortable chilling.

### Windy Weather Safety

Be aware of the forecast for windy weather and take precautions before beginning work and before the wind blows.

- ✓ Tie ladders off high and anchor them low.
- ✓ Avoid carrying sheet goods that could act as a sail allowing the wind to blow you over.
- ✓ Store materials and tools where the wind can't move them.

## 1.8.13 Kentucky H&S Plan Reference

### Health & Safety Issues

As potential hazards are identified, they are analyzed in terms of their severity and how they will be dealt with, up to and including deferral. Wherever possible, measures should be considered through the cost justification method of an  $SIR > 1$  as an Energy Conservation Measure (ECM) first, before using funds from the H&S allocation. Clients must always be informed of any Health or Safety risk discovered during the evaluation process in writ-

ing and written confirmation of receipt of that information by the client must be obtained and kept in the client file. A listing of Health and Safety issues are compiled, any of which that can't be corrected can result in a deferral on any given project. They are as follows:

**Air Conditioning and Heating Safety:**

“Red tagged”, inoperable or nonexistent heating system replacement, repair, or installation is allowed where climate conditions warrant, unless prevented by other guidance herein. Kentucky climate involves a defined heating season with a Heating Degree Day (HDD) measurement range from 4200 to slightly over 5000. However the state also has a shorter but taxing cooling season. The Cooling Degree Day (CDD) measurements in Kentucky range from 1500 to slightly less than 1000 in the eastern most mountainous region. The vast majority of the state shares the same HDD measurements as northern parts of states such as South Carolina, Georgia, Alabama, Texas, Oklahoma and New Mexico.

Research indicates of all people who die of heat stroke, about 80 percent are age 50 or older. Deaths attributed to lung disease, diabetes and hypertension increase more than 50 percent during heat waves. Heat stroke occurs 12 to 13 times more frequently in people age 65 and older than in younger persons. It is also an accepted medical fact that infants and children up to four years of age are very sensitive to the effects of high temperatures and rely on others to regulate their environment.

Considering preventable deaths may illuminate the need for allowing air conditioning measures. While there are no statistics devoted specifically to that category in Kentucky, the next two paragraphs are devoted to understanding the health risks in our state that relate to the statements above.

Each year in Kentucky there are 2,550 lung and bronchus related deaths. According to the Center for Disease Control (CDC), Kentucky: Burden of Chronic Diseases report, in 2005,

5% of Kentuckians died from stroke, and 1,187 people in Kentucky died from diabetes. In 2007, 10% of adults in Kentucky reported being diagnosed with non-pregnancy related diabetes.

While hypertension is the most prevalent cause of stroke and kidney failure, hypertension must be recognized as part of a bigger disease conglomerate almost always accompanied by obesity, diabetes, kidney disease or many other co-existing problems involving lifestyle and/or genetics. The same CDC report referenced above states that 30% of Kentucky adults have high blood pressure which puts us above the national average of 25%. The report goes on to state 39% of those surveyed had high blood cholesterol, which puts them at greater risk for developing heart disease and stroke.

Air conditioning is the number one protective factor against heat-related illness and death effecting people with health issues such as stated above. Therefore air conditioning system replacement, repair or installation is allowed to be categorized as health and safety in homes with occupants under four years old, over 65 years old and where there are at-risk occupants. Air conditioning system replacement, repair or installation must be attempted through cost justification as an ECM first before using H&S funding. Where this measure can be justified by the approved NEAT/MHEA or EA-Quip audit, replacement, repair or installation is not to be included in health and safety.

Persons requesting the need for air conditioning based on their health being at risk must provide a letter from a doctor defining the condition requiring an air conditioned environment and the maximum allowable air temperature relevant to that person's individual condition.

Repair of all combustible fuel line leaks from the meter or tank to the energy system or appliance. Materials must meet federal, state, and local code. Repair (only) of gas cooking appliances in order to eliminate gas leaks and reduce unsafe levels of carbon monoxide in living area. Repair materials must meet federal,

state and local code. Installation of protective materials on combustible surfaces adjacent to energy systems to meet NFPA clearance codes is allowable. Materials and installation must meet NFPA specifications. Materials must meet federal, state and local code.

Energy systems are repaired or replaced, under H&S, when not operational or unsafe. This measure is taken in order to eliminate unsafe levels of carbon monoxide in the living area and to ensure adequate heating. Justification documentation in the form of the appropriate heat system checklist (per energy source) which includes all required diagnostic recordings for the individual unit, and photos demonstrating the specific issue(s) with the system must be in the client file. Replacement of operational units, where diagnostic readings are attainable, must be attempted to be cost justified as a ECM using regular weatherization funds with an SIR>1 before using H&S funds. A unit with a cracked heat exchanger where diagnostic readings are attainable must be attempted to be replaced through cost justification as an ECM first before using H&S funding. Replacement of non-operational units can only be from H&S funding.

The weatherizing agency must determine presence of at-risk occupants while also ensuring systems are present, operable and performing. Agencies must discuss and provide clients with information on the appropriate use and maintenance of units, with explanation, from the subgrantee. This information must also cover the proper disposal of bulk fuel tanks when not removed (where applicable).

### **Appliances and Water Heaters:**

Replacement of water heaters under H&S is allowed on a case by case basis under the conditions outlined in the WXPM, Chapter 6, Section 6.6. Discuss and provide information and explanation on appropriate use, maintenance, and disposal of appliance/water heaters (where applicable).

Replacement and installation of appliances other than water heaters, such as stoves or washing machines, are not allowable H&S costs.

**Asbestos:**

Asbestos anywhere on the interior of the dwelling that would need to be addressed either directly or incidentally during the weatherization process is not an allowable H&S cost. Additionally, asbestos testing or abatement is not an allowable H&S cost. Policies have been in effect for asbestos presence and related work practices for many years. The approach is not to disturb, cut or drill said material and deter those measures that might do so. In instances where measures can be installed without disturbing asbestos surfaces or materials, that is the best approach. In instances where a local authority such as Code Enforcement imposes specific guidelines or requirements, service provider program staffs are to make themselves aware of those restrictions and comply with them.

In addition to this existing asbestos policy KHC acknowledges that removal of siding can potentially cause a health hazard. Therefore no handling and or altering of asbestos materials is allowed. It is mandatory that all dwelling needs evaluators, crew leaders and weatherization workers attend a course that is specifically targeted to educating these professionals on how to identify asbestos containing materials and work around them without creating a hazard. This course is presented via webinar, or web posting, by KHC Training Staff to educate the weatherization staff on how to identify asbestos containing materials and work around them without creating a hazard.

If it is determined that weatherization work cannot be performed without creating a hazard the project is to be deferred. The client is to be informed in writing of the potential hazard and the agency must not return to weatherize until an AHERA certified professional issues a clearance statement. A copy of this statement/report must be kept in the client file.

Prior to drilling or cutting an exterior wall and subsurface must be inspected for asbestos.

When vermiculite is present, unless testing determines otherwise, the unit is to be deferred. Where blower door tests are performed, it is a best practice to perform pressurization instead of depressurization. Encapsulation by an appropriately trained professional is allowed. However asbestos encapsulation and testing cost are not reimbursable by the KY WAP. Removal is not allowed.

With regard to pipes, furnaces and other small covered surfaces, assume asbestos is present in the covering materials. Encapsulation is allowed by an AHERA asbestos control professional and should be conducted prior to blower door testing. Asbestos encapsulation and testing are not reimbursable cost within the Kentucky WAP.

Clients must be informed that suspected asbestos is present and how precautions will be taken. Clients will be instructed not to disturb suspected asbestos containing material. Clients must be provided information and explanation on asbestos safety information and steps to correct deferral conditions (where applicable). The clients are required to sign a form, provided by the weatherizing agency, indicating they have been informed (where applicable).

**Biologicals and Unsanitary Conditions – odors, mustiness, bacteria, viruses, raw sewage, rotting wood, etc.:**

A sensory inspection is required. Clients must be informed of observed conditions. Clients must be provided information and explanation on how to maintain a sanitary home and steps to correct deferral conditions (where applicable).

Remediation of conditions that may lead to or promote biological concerns and unsanitary viruses is not an allowable cost. Addressing bacteria and viruses is not allowed. Cleaning or repairing biological and unsanitary conditions to perform weatherization is not allowed. Deferral may be necessary in

cases where a known agent is present in the home that may create a serious risk to occupants or weatherization workers. Also see Mold and Moisture bullet below.

### **Building Structure and Roofing:**

Site conditions identified and documented by the service provider that pose a safety hazard to its employees and subcontractors and cannot be corrected within the scope of the program.

·Building Structure – Structural problems with candidate dwellings can often lead to deferral because of their scope is beyond the means of the program to treat. Beyond simple incidental repairs, such as roof patching, there is no feasible means to address severe structural defects.

·During the pre-inspection or initial inspection of the dwelling, the evaluator must have access to all aspects of the structure in order to adequately and appropriately gather data for the NEAT or MHEA energy audit. Clothing, dogs, trash or other impediments restricting access to any portion or portions of the dwelling that block necessary access may constitute a deferral.

Building rehabilitation is beyond the scope of the WAP. H&S funds should not be used when the repair is a component of an ECM. In that case, the repair should be cost justified as an incidental repair. Clients must be notified of structurally comprised areas (where applicable).

### **Code Compliance:**

Correction of preexisting code compliance issues is not an allowable cost other than where they are triggered by performing weatherization measures. State and local (or jurisdiction having authority) codes must be followed while installing weatherization measures. Condemned properties and properties where “red tagged” health and safety conditions exist that cannot be corrected under this guidance should be deferred.

Clients must be notified of observed code compliance issues (where applicable). H&S funds should not be used when the repair is a component of an ECM, such as fixing a light fixture in order to install a CRL bulb. In this case the cost should be cost justified as an incidental repair.

KHC will begin a general code awareness training utilizing its construction specialist staff to provide residential code training to the network evaluators. This will be incorporated into the refresher courses.

### **Combustion Gases:**

Proper venting to the outside for combustion appliances, including gas dryers is required. Correction of venting is allowed when testing indicates a problem. The following inspection and testing is required per the WXP in Chapter 6 and Chapter 8 step 2, and KHC Program Notice 06-2010. Combustion safety testing is required when combustion appliances are present.

Correction of venting issues shall be completed shall be completed and should be done as an incidental repair when it is a component of an ECM. Proper venting to the outside for combustion appliances, including gas dryers is required. Combustion safety testing is required when combustion appliances are present. Inspections must include:

- Inspections of venting of combustion appliance and confirmation of adequate clearances to combustibles.
- Testing natural draft appliances for draft and spillage under worse case conditions before and after air sealing. Inspection of cooking burners for operability and flame quality.
- Replacement of Cook stoves is not allowed. Repair is an allowable H&S cost.

Clients must be provided information and explanation of combustion safety and hazards information, including the impor-

tance of using exhaust ventilation when cooking and the importance of keeping burners clean to limit the production of CO.

**Drainage – gutters, down spouts, extensions, flashing, sump pumps, landscapes, etc.:**

Drainage repairs are allowed with H&S funds only as they relate to code compliance. A repair is allowed as incidental repair when it is a component of an efficiency measure, such as a French drain when installing an air conditioning system, but must be cost justified with the ECM(s).

Major drainage issues are beyond the scope of the Weatherization Assistance Program. Homes with conditions that may create a serious health concern that require more than incidental repair should be deferred. See Mold and Moisture bullet below.

Clients must be provided information and explanation of the importance of cleaning and maintaining drainage systems, as well as the benefits of landscape design (where applicable).

**Electrical, other than Knob-and Tube Wiring:**

Minor electrical repairs are allowed where health and safety of the occupants is at risk. Upgrades and repairs are allowed when necessary to perform specific weatherization measures such as relocating an electrical outlet to allow for a dryer to be relocated for proper ventilation or proper connection of an existing water heater. A visual inspection must occur and all inspecting and testing is to be as described in the WXPM.

Clients must be provided information and explanation on the hazards of overloading circuits, basic electrical safety/risks and over current protection (where applicable). H&S funds should not be used when the repair is a component of an ECM such as a service upgrade to handle increased load of a new heat system.

**Electrical, Knob-and Tube Wiring:**

Minor electrical repairs are allowed where health and safety of

the occupants is at risk. Upgrades and repairs are allowed when necessary to perform specific weatherization measures. A visual inspection must occur and all inspecting and testing is to be as described in the WXPM.

Knob-and Tube wiring shall not be covered or encapsulated with insulation in Kentucky. The removal and replacement of knob and tube is allowed as an incidental repair to an ECM such as installing insulation.

Discuss and provide information and explanation to the client on the hazards of overloading circuits, basic electrical safety/risks and over current protection (where applicable).

### **Fire Hazards:**

Current inspection criteria take into account fire hazards associated with combustion appliances including clearances and venting systems. Through fuel specific checklists, inspectors identify such hazards and make repairs accordingly with respect to budgetary and program limitations. Required adherence to appropriate NFPA codes when repairing or replacing equipment also minimizes the potential for fire hazards.

Correction of fire hazards is allowed when necessary to safely perform weatherization. Home evaluations include checking for fire hazards during the audit. Clients must be informed of observed hazards even if they will not be treated during weatherization.

### **Formaldehyde, Volatile Organic Compounds (VOCs) and other Air Pollutants:**

Formaldehyde and Volatile Organic Compounds (VOCs) – Formaldehyde, tobacco smoke, thinners, solvents, cleaners, and any other substances capable of negatively impacting indoor air quality are identified through the On-site inspection process. Basic strategies such as proper storage and ventilation are used

to eliminate problems. Air sealing thresholds are maintained so that the presence of these pollutants are not concentrated and allowed to reach toxic amounts. However, this is primarily an occupant responsibility. In some cases, deferral may be an option.

Removal of pollutants is allowed and is required if they pose a risk to workers. If pollutants pose a risk to workers and removal cannot be performed or is not allowed by the client, the unit must be deferred. Removal of pollutants that is not necessary to perform weatherization (e.g. cleaning old paint cans and oil out of the garages) is not allowed.

Clients must be informed of observed conditions and associated risks. Client must be given written information and explanation on safety and proper disposal of household pollutants (where applicable).

-  
**Injury Prevention of Occupants and Weatherization Workers**  
**- Measures such as repairing stairs and replacing handrails:**

Workers must take all reasonable precautions against performing work on homes that will subject workers or occupants to health and safety risks. Minor repairs and installation may be conducted only when necessary to effectively weatherize the home; otherwise these measures are not allowed.

Workers are to observe if dangers are present that would prevent weatherization. Clients must be informed by evaluators and/or workers of observed hazards and associated risks (where applicable)

**Lead Based Paint:**

Presence of lead based paint associated with dwellings built before 1978. State policy mandates that all personnel working directly on dwellings shall participate in an eight (8) hour Lead Workers Safety class. Moreover, the presence of lead is an

inspection issue and current procedures are designed to identify the presence of lead on Work Orders and work safely in those situations. (See Lead Safe Weatherization Work Practices; in the WXPM.)

With respect to Lead Based Paint issues, KY WX uses an approach that addresses client safety and awareness, worker safety and awareness, and on-site practices.

The head of household of every home to be weatherized receives the informational pamphlet: "Renovating Right". The inspector also conducts a client education segment as part of the initial inspection to assure that the occupants are fully aware of the hazards posed by Lead Based Paint exposure. This procedure is documented by using a signed receipt from the head of household which confirms that the information was not only distributed, but also explained. This receipt is kept in the client file.

All workers on site on any Weatherization project, whether they be a crew based employee of one of the subcontractors or a private sector contractor, must complete an eight (8) hour Lead Safe Worker Practices Workshop. The aim of this course is to inform the worker about Lead hazards and the proper ways to deal with them, and in doing so, to work in such a way as to not expose client families (and their own families) to these hazards. All crews and contractors are required to carry HEPA vacuum machines, respirators, disposable bio suits, and all other items associated with safe Lead Work Practices.

The program manual addresses this area specifically with detailed guidance for onsite protocols:

- Wear a tight fitting respirator and disposable coveralls.
- Seal work areas within a home with tape and plastic. Cover furniture, carpet, and other surfaces with plastic drop cloths or tarps.
- Spray water on disturbed areas to minimize dust.

- Clean-up work area each day. Sweep carefully and wet mop as needed. Use a HEPA vacuum cleaner to collect dust and paint chips.

- Keep children away from work area at all times.

While this represents only a summary of the overall Lead Safe Practices and training, it illustrates KY WX's awareness of the issue and how it is integral to any weatherization project.

Lead Safe Weatherization work practices occur only due to health and safety concerns. It cannot be considered part of an efficiency measure and shall always be calculated and charged as a health and safety cost.

KHC's monitoring staff will have oversight responsibility in this area. While Lead Safe Work Practices have long been built into the program, the monitors will focus more directly on this area as they conduct their bi-annual and annual monitoring visits. Program operators will be required to show that all Lead Based Paint protocols: information sharing, Lead safe work Practices, proper equipment, and so forth are up to date and in compliance to all regulations whatever they turn out to be. Those programs that are not in compliance, and fail to comply once identified, will face the most serious sanctions that can be leveled: reduced allocation to start with, loss of contract if necessary. Special attention will be aimed at those programs failing to meet requirements in the area of Lead Safe Work Practices since it poses such tangible consequences for the households that are served.

Subgrantees must follow EPA's lead; Renovation, Repair and Painting (RRP). In addition to RRP, Weatherization requires all weatherization crews working in pre-1978 housing to be trained in Lead Safe Weatherization (LSW). Deferral is required when the extent and condition of lead-based paint in the house would potentially create further health and safety hazards.

All sub grantees and private sector contractors must have Lead

Renovator Firm status. All evaluators (inspectors) must have Lead Renovator (RRP) certification as well as all crew leaders. This is a requirement for contracting with the program. This applies to contractors performing and/or managing the following activities: weatherization related work, inspection services, energy auditing services, dwelling needs evaluation or like services. Private contractors must also meet the requirement of having adequate RRP certified employees among their ranks. As new contractors apply to work on WX projects the EPA requirements are explained during the application process.

Private contractors will be required to furnish proof of RRP and Lead Renovator Firm status as a condition of working for the WX program. The monitoring staff will routinely check that documentation is on file at each agency verifying compliance to the EPA rules.

All weatherization crews working on pre-1978 homes must receive the 8 hour LSW training and a certified renovator must be assigned to the project and be readily available.

State Monitor/Trainers must be Certified Renovators and receive the 8 hour LSW training.

The head of household of every home to be weatherized receives the informational pamphlet: "Renovating Right". The inspector also conducts a client education segment as part of the initial inspection to assure that the occupants are fully aware of the hazards posed by Lead Based Paint exposure.

The RRP requirements of client education apply. The agencies must give the client a copy of the EPA publication: July 2011 Edition of: ***The Lead-Safe Certified Guide to Renovate Right Pamphlet*** and have the client sign the Sample Pre-Renovation Form located in the back of the Pamphlet to certify the client has been given the pamphlet.

That signed form must be kept in the client's file to show proof the client has received educational material about the dangers of lead paint.

The certified renovator must be physically present at the work site while signs are being posted, containment is being established, and the work area is being cleaned after the renovation to ensure that these tasks are performed correctly. Although the certified renovator is not required to be on-site at all times, while the renovation project is ongoing, a certified renovator must nonetheless regularly direct the work being performed by other workers to ensure that the work practices are being followed. When a certified renovator is not physically present at the work site, the workers must be able to contact the renovator immediately by telephone or other mechanism. In addition, the certified renovator must perform the post-renovation cleaning verification.

### **Mold and Moisture:**

Limited water damage repairs that can be addressed by weatherization workers and correction of moisture and mold creating conditions are allowed when necessary in order to weatherize the home and to ensure the long term stability and durability of the measures. Where severe Mold and Moisture issues cannot be addressed, deferral is required.

The Kentucky Weatherization program is not a mold remediation program and funds should not be used to test, abate, remediate, purchase insurance, or alleviate existing mold conditions identified during the audit, the work performance period or the quality control inspection. Most typically, weatherization services may need to be delayed. All local agencies must include some form of notification or disclaimer to the client upon the discovery of a mold condition and what was specifically that was done to the home that is expected to alleviate the condition and/or that the work performed should not promote new mold growth.

Major moisture problems that cannot be corrected within the scope of the program such as:

·An enclosed crawlspace or basement that has standing water for significant periods of time due to inadequate ground or surface water drainage.

·Any building with no overhangs and no gutters, exhibiting signs of major moisture problems such as blistering paint and extensive mold/mildew on the inside of the house.

The clients must be provided with a disclaimer on mold and moisture awareness.

### **Occupant Preexisting or Potential Health Conditions:**

A feature of any inspection includes client education, whereby the occupant's health problems are addressed. Once a clear understanding has been reached between the program inspector and the occupant, work practices will be deployed so as not to aggravate any preexisting condition. In some rare instances, a deferral may be the only solution.

When a person's health may be at risk and/or the work activities could constitute a health of safety hazard, the occupant at risk will be required to take appropriate action based on severity of risk. Temporary relocation of at-risk occupants may be allowed on a case by case basis. Failure or the inability to take appropriate actions must result in deferral.

Occupants will be required to reveal known or suspected health concerns as part of initial application for weatherization. The occupants of the dwelling will be screened again during the audit. The client must be provided with information of known risks. It will also require that worker contact information (in the form of agency weatherization office staff phone numbers) be given to the client so client can inform of any issues.

**The weatherizing agency must determine presence of at-risk occupants before proceeding with evaluation services. The Health & Safety Client Application and Home Screening Questionnaire form must be reviewed and signed by the cli-**

**ent at the time of application intake and by evaluator before the evaluation is started.**

**Occupational Safety and Health Administration (OSHA) and Crew Safety:**

Workers must follow OSHA standards and OSHA HazCom 2012 and take precautions to ensure the health and safety of themselves and other workers. For more information, please reference the OSHA website at: <https://www.osha.gov/dsg/haz-com/index.html>

Employers that have hazardous chemicals in their workplaces are required by OSHA's Hazard Communication Standard (HCS), 29 CFR 1910.1200, to implement a hazard communication program. The program must include labels on containers of hazardous chemicals, safety data sheets (SDSs) for hazardous chemicals, and training for workers. Each employer must also describe in a written program how it will meet the requirements of the HCS in each of these areas.

Field monitoring performs unit file review for evidence of safe work practices. Field monitoring of in progress units will perform assessments to determine if crews are utilizing safe work practices.

The Kentucky Weatherization Program no longer requires the completion of either the OSHA-10 or the OSHA-30 training courses.

However, DOE will continue to encourage sub grantees to provide this training to their field staff since job site safety is very important. No part of this notice eliminates the need for sub grantees to be in compliance with OSHA standards. OSHA still requires that all workers receive training to address specific hazards that the worker can reasonably expect to encounter on a particular job site such as (but not limited to) fall protection, use

of personal protective equipment, electrocution and the safe operation of power tools.

KHC continues to strongly recommend this training for all workers as a best practice even though it is not required. This training can be obtained in various ways. The following are suggested resources.

**Online Training.** OSHA has accepted the below sites for online outreach training. We suggest that you sample them before choosing.

### **Construction 10 hour**

1. [AdvanceOnline](#)
2. [ClickSafety](#) (also Roadway, Cal-OSHA, and Spanish)
3. [Summit Training Source](#) (also Spanish version)
4. [PureSafety](#) (also Spanish version)
5. Career Safe - ([Youth](#) and [Corporate](#) versions)
6. [Redvector](#)
7. [360Training](#)
8. [University of South Florida](#)
9. [Coastal Training Technologies](#)
10. [Turner Construction](#)

### **Construction 30 hour**

1. [Turner Construction](#) (also Spanish version)
2. [ClickSafety](#)
3. [360Training](#)
4. [Summit Training Source](#)
5. [University of South Florida](#)
6. [PureSafety](#)
7. [AdvanceOnline](#)

## **Information on obtaining OSHA outreach classes in construction**

### **To find in-person training conducted by an authorized OSHA Outreach Trainer:**

- a. See [www.OutreachTrainers.org](http://www.OutreachTrainers.org) to find outreach trainers and/or their schedules
- b. We can send you lists of active trainers in your state – e-mail us if you want this list. Use the lists to contact trainers for information on their training plans.
- c. OSHA Education Center in your area may offer it - [www.osha.gov/dte/edcenters/map.html](http://www.osha.gov/dte/edcenters/map.html)
- d. The OSHA Consultation office in your area may offer it, see [www.osha.gov/dcsp/smallbusiness/consult\\_directory.html](http://www.osha.gov/dcsp/smallbusiness/consult_directory.html)

-

### **Pest:**

Pest infestation, within the dwelling or in any area outside of the dwelling, where service provider staff or subcontractors would have to work is cause for deferral. (Pests include, but are not limited to: fleas, roaches, rodents).

Clients must be informed of observed condition and associated risks.

-

### **Radon:**

Whenever site conditions permit, exposed dirt must be covered with a vapor barrier except for mobile homes without skirting or an exterior under surface that serves as a vapor barrier. In homes where radon may be present, precautions should be taken to reduce the likeliness of making radon issues worse. In extreme cases deferral may be an option. Radon testing or remediation is not an allowable H&S cost. Clients must be provided with the EPA consumer's guide to radon.

## **Refrigerant:**

Refrigerators are allowed to be replaced and an ECM only. All reclaimed refrigerant processes must follow the Clean Air Act 1990, section 608, as amended by 40 CFR82, 5/14/93. All EPA testing protocols must apply to any testing. Clients are to be advised not to disturb refrigerant. Anyone working with refrigerant, within or employed by the WAP, must have the appropriate training, either an EPA-approved section 608 type I or universal certification. Any appliance disposal must include refrigerant reclamation.

Non-certified technicians may not attach or disconnect hoses of gauges to measure pressure within the appliances, top-off or remove refrigerant from appliances or otherwise damage the integrity of the appliance.

## **Smoke, Carbon Monoxide Alarms, and Fire Extinguishers:**

1. Weatherization agencies must install carbon monoxide (CO) alarms and smoke alarms in dwelling units where these devices are nonexistent or non-functioning.
2. CO alarms must be, UL listed, installed in accordance with the manufacturer's recommendations and located in compliance with the SWFG Section 1.1.2. Installed CO alarms must have the capability to accurately detect and display low levels of carbon monoxide to 10 ppm and comply with other program requirements. Electric plug-in CO alarms must have battery backup.

Local agencies must provide the occupant(s) of the dwelling unit with verbal and written information regarding the following:

- a. Dangers of CO and smoke.
- b. How to operate and reset the CO and smoke alarms.

- c. How to read the CO alarm.
- d. How to respond to CO levels above 10 ppm.
- e. How to change the batteries of CO and smoke alarms.

3. Smoke alarms must be, installed in accordance with the manufacturer's recommendations, listed in accordance with UL 217, comply with NFPA 72 and other program requirements.

4. Where multiple smoke alarms are required interconnection is required. Actuation of any one smoke alarm shall activate all of the alarms in the individual unit. Hard wiring and interconnection is not required in existing areas provided:

- a) the alteration or repair does not cause the removal of wall or ceiling finishes exposing the structure, and
- b) no attic, crawl or basement is available which can provide access for hard wiring and interconnection without the removal of interior finishes.

5) Smoke alarms/detectors must be located:

- 1) In every sleeping room.
- 2) Outside of each sleeping area in the immediate vicinity of the bedrooms.
- 3) On each additional story (including basements).
- 4) In split level dwellings where an intervening door is located between the adjacent levels. However in split level dwellings without an intervening door a smoke alarm installed on the upper level shall suffice for the adjacent lower level provided that the lower level is less than one full story below the upper level.
- 5) Near every combustion zone. This alarm can serve the requirements of numbers 3, 4 and 5 where feasible.
- 6) Providing fire extinguishers is allowed only when solid fuel is present. Fire extinguishers must be installed, according to the

manufactures recommendations, be type ABC, UL listed, = 10 lb and with a permanently affixed wall bracket to receive the extinguisher. The client must sign a written agreement to allow a fire extinguisher to be installed in the home within sight of the solid fuel burning heat system when standing at the unit. The agency must discuss and provide information on the use and upkeep of the extinguisher to the client.

### **Solid Fuel Heating (Wood Stoves, etc):**

The weatherization agency must inspect the stove, chimney and flue. Combustion zone depressurization (CAZ) is required per the Southeast Weatherization Field Guide and the WXPM section 8.5, step 2 item 15.

Maintenance, repair, and replacement of primary indoor heating units is allowed where occupant health and safety is a concern. Maintenance and repair of secondary heating units is allowed. Replacement of secondary heating units is not allowed. This system must be operational and inspected using all WXPM test protocols before any other weatherization begins.

### **Stand Alone Electric Heaters:**

Defined as, but not limited to, heaters that do not have a permanent connection to electric power. Repair, replacement or installation is not allowed. Removal is recommended. Circuitry must be checked to ensure adequate power supply for existing space heaters.

Clients must be informed of the hazards associated with these types of heaters and the weatherization agency must collect a signed waiver from the client if removal is not allowed.

These heaters are not considered a primary heat source.

### **Space Heaters, Unvented Combustion:**

Unvented combustion space heaters are not considered a primary heat source. Removal is required, except as secondary heat source and where the unit conforms to ANSI Z21.11.2. Units that do not meet ANSI Z21.11.2 must be removed prior to weatherization but may remain until a replacement heating system is in place. Testing for air-free carbon monoxide (CO) is to be performed per the WXPM. All units must have an ANSI Z21.11.1 label.

The client must be informed of the dangers of unvented space heaters – CO, Moisture, NO<sub>2</sub>, CO can be dangerous even if CO alarm does not sound. The replacement system must be operational and inspected using all WXPM test protocols before any other weatherization begins

### **Space Heaters, Vented Combustion:**

These units will be treated as furnaces. The WXPM details the testing required during an evaluation. The replacement system must be operational and inspected using all WXPM test protocols before any other weatherization begins.

### **Spray Polyurethane Foam (SPF):**

Use EPA recommendations (available online at [http://www.epa.gov/dfe/pubs/projects/spf/spray\\_polyurethane\\_foam.html](http://www.epa.gov/dfe/pubs/projects/spf/spray_polyurethane_foam.html)) when working within the conditioned space of when SPF fumes become evident within the conditioned space. When working outside the building envelope, isolate the area where foam will be applied, take precautions so that fumes will not transfer to inside conditioned space, and exhaust fumes outside the home. Testing will include checking for penetrations in the building envelope. Sensory inspection inside the home for fumes during foam application must also occur.

The client must be informed of plans to use two-part foam and the precautions that may be necessary. Workers using foam products must receive training on the proper use of these various products and understand the specification for each applica-

tion type. Documentation of installers viewing an installation video or online training and verification of reading and understanding product use information must be kept at the service provider agency. MSDS sheets are mandatory for any foam product used and a thorough understanding of the temperature sensitivity of the product in use is required.

### **Ventilation:**

The most current version of ASHREA 62.2, and the approved Addendum b, is required to be met to the fullest extent possible, when performing weatherization activity. Implementing ASHREA 62.2 is not required where acceptable indoor air quality already exists as defined by ASHREA 62.2. Existing fans and blower systems should be updated if not adequate. Evaluation and test out measures must comply with the WXPM.

Discuss and provide information to the client on function, use, and maintenance of ventilation system and components as applicable. Also a disclaimer that ASHREA 62.2 does not account for high polluting sources or guarantee indoor air quality must be given to the client.

Training of evaluators and crew leaders has been provided by KHC. This training included proper sizing, evaluation of existing and new systems, depressurization tightness limits, critical air zones, etc.

### **Window and Door Replacement, Window Guards:**

Replacement, Repair, or installation is not an allowable H&S cost but may be allowed as an ECM if cost justified. If disturbing lead paint, follow LSW practices and the client must be informed on lead risks as indicated in the WXPM and this H&S plan when applicable. Replacement, repair or installation of doors, windows, or window guards is not an allowable H&S cost.

### **Deferrals:**

Deferrals, or "walkaways" as they are commonly known, are processed accordingly:

- a. The client shall be informed in writing as to why the dwelling cannot be weatherized. If there are conditions that the client must correct before service is provided, those conditions must also be stated in writing.
- b. The service provider is required to refer the client to any alternate program such as home rehab, if one is available in the area.
- c. The service provider shall clearly indicate in the client file why the dwelling was given "deferral" status.
- d. The service provider must document all referrals to other programs or services in the client file.
- e. The client will receive any information prescribed in the Health and Safety section of the WXPM that is appropriate.

**Client Education:**

The WXPM defines the proper time and method to disclose and distribute information on all aspects of the evaluation discovery process. This procedure is documented by using a signed receipt from the head of household which confirms that the information was not only distributed, but also explained. This receipt is kept in the client file. Draft forms have been developed to document all information discussed and given to the clients along with application and onsite interviews to verify preexisting at risk and health concerns. The use of these forms is mandatory.

## 1.9 SWS ALIGNMENT

Field Guide Topic	SWS Detail
Fire Safety Pg. 20	

<b>Field Guide Topic</b>	<b>SWS Detail</b>
Carbon Monoxide (CO) Pg. 21	2.0105.1 Combustion Worker Safety, 2.0201.2 Combustion Safety, 2.0201.1 Combustion Appliance Zone (CAZ) Testing
Causes of Carbon Monoxide (CO) Pg. 22	
Smoke and Carbon Monoxide (CO) Alarms Pg. 23	
Smoke Alarms Pg. 24	2.0301.1 Smoke Alarm
CO Alarms Pg. 24	2.0301.2 Carbon Monoxide Alarm or Monitor 2.0201.2 Combustion Safety
Gas Range and Oven Safety Pg. 25	2.0100.1 Global Worker Safety, 2.0201.2 Combustion Safety
Reducing Moisture Problems Pg. 28	2.0401.1 Air Sealing Moisture Precautions
Symptoms of Moisture Problems Pg. 30	2.0401.1 Air Sealing Moisture Precautions
Solutions for Moisture Problems Pg. 31	2.0404.1 Stand-Alone Dehumidifiers, 2.0404.4 Basements—Dehumidification 3.1488.3 Covers for Sump Pumps, Drains, Pits, and other Intentional Slab Penetrations
Crawl Space Moisture and Safety Issues Pg. 34	2.0111.2 Crawl Spaces—Pre-Work Qualifications, 2.0111.3 Crawl Spaces—Debris Removal, 2.0403.2 Closed Crawl Spaces—Ground Moisture Barriers, 2.0403.1 Vented Crawl Spaces—Ground Moisture Barrier

<b>Field Guide Topic</b>	<b>SWS Detail</b>
Ground Moisture Source-Reduction Pg. 35	
Pollutants Source Control Pg. 37	
Radon Pg. 37	2.0501.1 Radon—Air Sealing Considerations, 2.0501.2 Radon—Basements and Crawl spaces
Asbestos Containing Materials (ACM) Pg. 38	2.0104.1 Insulation Worker Safety
Lead-Safe Procedures Pg. 38	2.0100.1 Global Worker Safety
Electrical Safety Pg. 42	2.0100.1 Global Worker Safety
Decommissioning Knob-and-Tube Wiring Pg. 43	4.1001.2 Knob and Tube Wiring
Constructing Shielding for Knob-and-Tube Wiring Pg. 44	2.0601.1 Knob and Tube Wiring
Worker Health and Safety Pg. 44	2.0100.1 Global Worker Safety, 2.0106.1 Ventilation Worker Safety
Commitment to Safety Pg. 45	
New Employees Pg. 46	
Driving Pg. 47	
Lifting and Back Injuries Pg. 48	
Respiratory Health Pg. 50	2.0100.1 Global Worker Safety, 4.9901.1 General Information on Spray Polyurethane Foam (SPF), 2.0106.1 Ventilation Worker Safety
Hazardous Materials Pg. 51	2.0110.1 Material Selection, Labeling, and Material Safety Data Sheets (MSDSs), 2.0100.1 Global Worker Safety

<b>Field Guide Topic</b>	<b>SWS Detail</b>
Equipment for Personal and Crew Safety Pg. 52	2.0100.1 Global Worker Safety
Falls Pg. 52	2.0100.1 Global Worker Safety
Tool Safety Pg. 54	2.0100.1 Global Worker Safety
Repetitive Stress Injuries Pg. 55	
Safety for Crawl Spaces and Other Confined Areas Pg. 56	2.0701.1 Crawl Spaces— Providing Access, 2.0701.2 Crawl Space Information Sign
Safety for Extreme Weather Pg. 57	2.0100.1 Global Worker Safety



# **CHAPTER 2: ENERGY AUDITS AND QUALITY CONTROL INSPECTIONS**

This chapter outlines the operational process of energy audits, work orders, and final inspections as practiced by non-profit agencies and contractors working in the Department of Energy's (DOE) Weatherization Assistance Program (WAP).

## **WAP's Mission**

The mission of DOE WAP is **“To reduce energy costs for low-income families, particularly for the elderly, people with disabilities, and children, by improving the energy efficiency of their homes while ensuring their health and safety.”**

This chapter also discusses ethics, customer relations, and customer education.

## **Why We Care about Health and Safety**

The health and safety of customers must never be compromised by weatherization. Harm caused by our work would hurt our clients, ourselves, and our profession. Weatherization work can change the operation of heating and cooling systems, alter the moisture balance within the home, and reduce a home's natural ventilation rate. Weatherization workers must take all necessary precautions to avoid harm from these changes.

## **2.1 PURPOSES OF AN ENERGY AUDIT**

An energy audit evaluates a home's existing condition and outlines improvements to the energy efficiency, health, safety, and durability of the home.

Depending on the level of the audit, an energy audit may include some or all of the following tasks.

- Inspect the building and its mechanical systems to gather the information necessary for decision-making.
- Evaluate the current energy consumption along with the existing condition of the building.
- Diagnose areas of energy waste, health and safety, and durability problems related to energy conservation.
- Recommend energy conservation measures (ECMs).
- Diagnose health and safety problems and how they may be affected by the proposed ECMs.
- Predict savings expected from ECMs.
- Estimate labor and material costs for ECMs.
- Encourage behavioral changes that reduce energy waste.
- Educate residents about their energy usage and your proposed energy retrofits.
- Provide written documentation of the energy audit and the recommendations offered.

### 2.1.1 Energy-Auditing Judgment and Ethics

The auditor's good decisions are essential to the success of a weatherization program. Good decisions depend on judgment and ethics.

- ✓ Understand the requirements of the WAP program.
- ✓ Treat every client with the same high level of respect.
- ✓ Communicate honestly with clients, coworkers, contractors, and supervisors.
- ✓ Know the limits of your authority, and ask for guidance when you need it.
- ✓ Develop and maintain the inspection, diagnosis, and software skills necessary for WAP energy auditing.

- ✓ Choose ECMs according to their cost-effectiveness along with DOE and State policy, and not according to personal preference or customer preference.
- ✓ Don't manipulate Weatherization Assistant or a priority list to select or avoid particular ECMs.
- ✓ Avoid personal bias in your influence on purchasing, hiring, and contracting.

## 2.1.2 Energy-Auditing Record-keeping

The client file is the record of a weatherization completion. The client file may contain all of the following items, depending on State WAP policy.

1. Customer intake document
2. Income verification
3. Owner agreement form
4. Work plan
5. Client health-notification documents
6. Energy-education documentation
7. Moisture and mold findings
8. Hold harmless statement
9. Solid fuel inspection report
10. Manufacturer's warranties
11. Photo documentation
12. Post-inspection report

## 2.2 CUSTOMER RELATIONS

Customer satisfaction depends on the energy auditor's reputation, professional courtesy, and ability to communicate.

## 2.2.1 Communication Best Practices

Making a good first impression is important for customer relations. Friendly, honest, and straightforward communication creates an atmosphere where the auditor and clients can discuss problems and solutions openly.

Setting priorities for customer communication is important for the efficient use of your time. Auditors must communicate clearly and directly. Limit your communication with the customer to the most important energy, health, safety, and durability issues.

- ✓ Introduce yourself, identify your agency, and explain the purpose of your visit.
- ✓ Make sure that the customer understands the goals of the WAP program.
- ✓ Listen carefully to your client's reports, complaints, questions, and ideas about their home's energy efficiency.
- ✓ Ask questions to clarify your understanding of your client's concerns.
- ✓ Before you leave, give the client a quick summary of what you found.
- ✓ Avoid making promises until you have time to finish the audit, produce a work order, and schedule the work.
- ✓ Make arrangements for additional visits by crews and contractors as appropriate.

## 2.2.2 Customer Interview

The customer interview is an important part of the energy audit. Even if customers have little understanding of energy and buildings, they can provide useful observations that can save you time and help you choose the right ECMs.

- ✓ Ask the customer about comfort problems, including zones that are too cold or hot.

- ✓ Ask the customer to see their energy bills if you haven't already evaluated them.
- ✓ Ask the customer if there is anything relevant they notice about the performance of their mechanical equipment.
- ✓ Ask about family health, especially respiratory problems afflicting one or more family members.
- ✓ Discuss space heaters, fireplaces, attached garages, and other combustion hazards.
- ✓ Discuss drainage issues, wet basements or crawl spaces, leaky plumbing, and mold infestations.
- ✓ Discuss the home's existing condition and how the home may change after the proposed retrofits.
- ✓ Identify existing damage to finishes to insure that weatherization workers aren't blamed for existing damage. Document damage with digital photos.
- ✓ Ask the client to sign the necessary permissions.

### 2.2.3 Deferral of Weatherization Services

When you find major health, safety, or durability problems in a home, sometimes it's necessary to postpone weatherization services until those problems are solved. The problems that are cause for deferral of services include but are not limited to the following.

- Major roof leakage.
- Major foundation damage.
- Major moisture problem including mold infestation.
- Major plumbing problems.
- Human or animal waste in the home.
- Asbestos found in the interior and/or exterior of the home that poses a health and safety hazard.
- Major electrical problems or fire hazards.

- The home is vacant or the client is moving.
- The home is for sale.

Behavioral problems may also be a reason to defer services to a customer, including but not limited to the following.

- Illegal activity on the premises.
- Occupant's hoarding makes difficult or impossible to perform a complete audit.
- Lack of cooperation by the customer.

### Matching Funds to Avoid Deferrals

Auditors should assist customers in obtaining repair funds from the following sources whenever possible:


- Department of Housing and Urban Development (HUD) Emergency Repair Funds
- HUD Healthy Homes Initiative Funds
- Department of Agriculture (USDA) Rural Development Funds
- State and local repair funds
- Church, charity, and foundation funds

## 2.3 PARTS OF AN ENERGY AUDIT

Visual inspection, diagnostic testing, and numerical analysis are three types of energy auditing procedures we discuss in this section. These procedures should aid you in evaluating all the possible ECMs that are cost-effective according to DOE-approved software: Weatherization Assistant or approved equivalent. *See "SIR Calculations with ECM Selection" on page 94.*

To understand the features of Weatherization Assistant, consult the DOE *Weatherization Assistant training site*.

The energy audit must also propose solutions to health and safety problems related to the energy conservation measures.

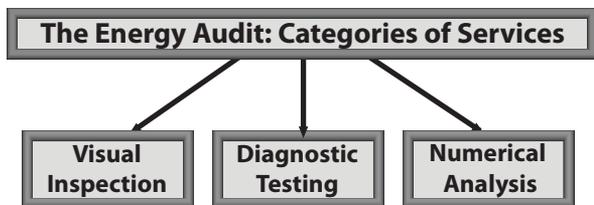

### 2.3.1 Visual Inspection

Visual inspection orients the energy auditor to the physical realities of the home and home site. Among the areas of inspection are these.

- Health and safety issues
- Building air leakage
- Building insulation and thermal resistance
- Heating and cooling systems
- Ventilation fans and operable windows
- Baseload energy uses
- The home's physical dimensions: area and volume

### 2.3.2 Diagnostic Testing

Measurement instruments provide important information about a building's unknowns, such as air leakage and combustion efficiency. Use these diagnostic tests as appropriate during the energy audit.

- Blower door testing: A variety of procedures using a blower door to evaluate the airtightness of a home and parts of its air barrier.

- Duct leakage testing: A variety of tests using a blower door and pressure pan to locate duct leaks.
- Combustion safety and efficiency testing: Combustion analyzers sample combustion by-products to evaluate safety and efficiency.
- Infrared scanning: Viewing building components through an infrared scanner shows differences in the temperature of building components inside building cavities.
- Appliance consumption testing: Refrigerators are monitored with logging watt-hour meters to measure electricity consumption.

### 2.3.3 SIR Calculations with ECM Selection

Energy auditors currently use Weatherization Assistant (WA) or other DOE-approved software, to determine which ECMs have the highest Savings-to-Investment Ratio (SIR). The ECMs with the highest SIRs are at the top of the WA priority list for a particular home.

Approved audit software must be updated at least semi-annually. This includes material, labor and fuel cost.

#### **SIR = INITIAL INVESTMENT ÷ LIFETIME SAVINGS**

The DOE WAP and the KY State WAP program require that ECMs have an SIR greater than 1. ECMs with higher SIRs should be installed before or instead of ECMs with lower SIRs.

The auditor must collect information to inform decisions about which ECMs to choose.

- ✓ Measure the home's exterior horizontal dimensions, wall height, floor area, volume, and area of windows and doors.
- ✓ Measure the current insulation levels.
- ✓ Do a blower door test to evaluate air leakage.

- ✓ Do a combustion efficiency test to evaluate the central heating system.
- ✓ Evaluate energy bills and adjust the job's budget within limits to reflect the potential energy savings.

## 2.4 THE WORK ORDER

The work order is a list of materials and tasks that are recommended as a result of an energy audit. Consider these steps in developing the work order.

- ✓ Evaluate which ECMs have an acceptable savings-to-investment ratio (SIR) using software or a priority list.
- ✓ Select the most important health and safety problems to correct, as these problems are directly related to the cost-effective ECMs.
- ✓ Provide detailed specifications so that crews or contractors clearly understand the materials and procedures necessary to complete the job.
- ✓ Estimate the cost of the materials and labor. These costs must be within 10% of actual costs.
- ✓ Verify that the materials needed are in stock at the agency or a vendor.
- ✓ Inform crews or contractors of any hazards, pending repairs, and important procedures related to their part of the work order.
- ✓ Obtain required permits from the local building jurisdiction, if necessary.
- ✓ Specify interim testing during air-sealing and heating-system maintenance to provide feedback for workers.
- ✓ Consider in-progress inspections and schedule the final inspection for the job's final day if possible.

## 2.4.1 Questions about the Audit and Work Order

The inspector asks these questions during the final inspection.

- Did the auditor find all the opportunities and identify all the hazards?
- Do the audit's ECMs comply with the Weatherization Assistant computer analysis, and the SWS?
- Did the work order adequately specify the labor and materials required by the energy audit?
- Did the crew follow the work order?
- What changes did the crew leader make to the work order?
- Did these changes benefit the client and the WAP program?
- Is the completed weatherization job, the energy audit, and the work order aligned with State policy and the SWS?

## 2.5 WORK INSPECTIONS

The inspector is responsible for the quality control of the weatherization process. Good inspections provide an incentive for auditors to produce good energy audits and work orders and for workers to do quality work. There are two common opportunities for inspections: in-progress inspections and final inspections.

### 2.5.1 In-Progress Inspections

Many ECMs are best inspected while the job is in progress. Visiting while the job is in progress demonstrates your commitment to getting the job done correctly. Either the energy auditor or the inspector may conduct an in-progress inspection.

These measures are good candidates for in-progress inspections because of the difficulty of evaluating them after completion.

- Dense-pack wall insulation

- Insulating closed roof cavities
- Furnace installation or tune-up
- Air-conditioning service
- Duct testing and sealing
- Attic air sealing

In-progress inspections are also an excellent way to provide training and technical assistance.

## 2.5.2 Final Inspections

A certified inspector completes a final inspection before the weatherization job is reported to DOE as a completion. The inspector must be a different person than the auditor.

Final inspections ensure that weatherization services were provided as specified in the work order, and that the home is left in a safe condition. The weatherization agency does the final inspection for quality control, which is a term for in-house self evaluation of jobs.

- ✓ Confirm that the crew installed the approved materials in a safe, effective, and neat way.
- ✓ Confirm that the crew matched existing finish materials for measure installation and necessary repairs.
- ✓ Review all completed work with the client. Confirm that the client is satisfied.
- ✓ Verify that combustion appliances operate safely. Do worst-case draft tests and CO tests as appropriate.
- ✓ Do a final blower door test.
- ✓ Use an infrared scanner, if available, to inspect insulation and air-sealing quality.
- ✓ Specify corrective actions whenever the work doesn't meet standards.

- ✓ Verify that the crew used the correct lead-safe procedures if these procedures were necessary in installing ECMs.
- ✓ Verify that all required paperwork, with required signatures is in the client file. *See “Energy-Auditing Record-keeping” on page 89.*

### 2.5.3 Quality Control Versus Quality Assurance

Quality control is an internal process of a weatherization program. Quality assurance is a third-party inspection performed by an inspector employed by the State or by the DOE.

Energy auditors may perform either quality-control or quality-assurance inspections. The following are important elements of these inspections.

- Verify compliance with specifications, job order, and energy audit.
- Provide feedback on material quality and worker performance, both good and bad.
- Issue instructions for correcting errors and omissions.
- Survey clients for level of satisfaction.
- Perform energy-conservation monitoring and evaluation, if appropriate.
- Report to the weatherization agency, the State, or the DOE about the quality of the weatherization work.

## 2.6 FIELD MONITORING

Field monitoring is the quality assurance visits conducted by the State weatherization program. The State monitor’s job is similar to the agency’s inspector. However, the State monitor is independent of the local weatherization agency and reports his or her inspection results to the State. The monitor describes these inspection results in these ways.

1. Strengths or areas where the agency performs well.
2. Concerns are minor problems with paperwork or job quality that the agency can easily correct.
3. Major findings, including contract violations, safety violations, or omissions of required procedures.

The monitor issues a report and the agency must respond in writing. Major findings require the agency to tell the State how the agency will correct the problems and how they will be paid for. Major findings from the DOE may require the State to propose a correction plan.

## 2.7 UNDERSTANDING ENERGY USAGE

A major purpose of any energy audit is to determine where energy waste occurs. With this information in hand, the energy auditor then allocates resources according to the energy-savings potential of each energy-conservation measure. A solid understanding of how homes use energy should guide the decision-making process.

**Table 2-1: Top Six Energy Uses for U.S. households**


<b>Energy User</b>	<b>Annual kWh</b>	<b>Annual Therms</b>
<b>Heating</b>	2000–10,000	200–1100
<b>Cooling</b>	600–7000	n/a
<b>Water Heating</b>	2000–7000	150–450
<b>Refrigerator</b>	500–2500	n/a
<b>Lighting</b>	500–2000	n/a
<b>Clothes Dryer</b>	500–1500	n/a
Estimates by the authors from a variety of sources.		

## 2.7.1 Baseload Versus Seasonal Use

We divide home energy usage into two categories: baseload and seasonal. Baseload includes water heating, lighting, refrigerator, and other appliances used year round. Seasonal energy use includes heating and cooling. You should understand which of the two is dominant as well as which types of baseloads and seasonal loads are the highest energy consumers.

Many homes are supplied with both electricity and at least one source of combustion fuel. Electricity can provide all seasonal and baseload energy, however most often there is a combination of electricity and natural gas, oil, or propane. The auditor must understand whether loads like the heating system, clothes dryer, water heater, and kitchen range are serviced by electricity or by fossil fuel.

Total energy use relates directly to potential energy savings. The greatest savings are possible in homes with highest initial consumption. Avoid getting too focused on a single energy-waste category. Consider all the individual energy users that offer measurable energy savings.

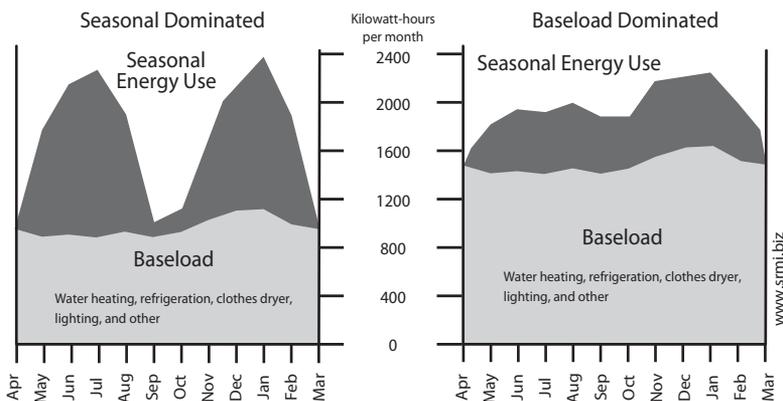

**Seasonal vs. Baseload Domination of Energy Use:** Homes with inefficient shells or in severe climates have large seasonal energy use and smaller baseload. More efficient homes and homes in mild climates are dominated by baseload energy uses.

## Separating Baseload and Seasonal Energy Uses

To separate baseload from seasonal energy consumption for a home with monthly gas and electric billing, do these steps.

1. Get the energy billing for one full year. If the customer can't produce these bills, they can usually request a summary from their utility company.
2. Add the 3 lowest bills together.
3. Divide that total by 3.
4. Multiply this three-month low-bill average by 12. This is the approximate annual baseload energy cost.
5. Total all 12 monthly billings.
6. Subtract the annual baseload cost from the total billings. This remainder is the space heating and cooling cost.
7. Heating is separated from cooling by looking at the months where the energy is used — summer for cooling, winter for heating.
8. For cold climates, add 5 to 15 percent to the baseload energy before subtracting it from the total to account for more hot water and lighting being used during the winter months.

**Table 2-2: Separating Baseload from Seasonal Energy Use**

<b>Factor and Calculation</b>	<b>Result</b>
<b>Annual total gas usage from utility bills</b>	<b>1087 therms</b>
Monthly average gas usage for water heating Average of 3 low months gas usage $(21 + 21 + 22) \div 3 = 21.3$ therms per month	21.3 therms per month
<b>Annual gas usage for water heating</b> Monthly average usage multiplied by 12 $12 \times 21.3 = 256$ therms per year	<b>256 therms</b> per year
<b>Annual heating gas usage</b> Annual total minus annual water-heating usage $1087 - 256 = 831$ therms per year	<b>831 therms</b> per year
<b>Annual total electric use from utility bills</b>	<b>6944 kWh</b>
Monthly average usage for electric baseload Average of 3 low months electricity usage $(375 + 372 + 345) \div 3 = 364$ kWh per month	364 kWh per month
<b>Annual electric usage for baseload</b> Monthly average usage multiplied by 12 $12 \times 364 = 4368$ kWh per year	<b>4368 kWh</b> per year
<b>Annual heating and cooling electrical usage</b> Annual total minus annual baseload usage $6944 - 4368 = 2576$ kWh per year	<b>2576 kWh</b> per year

### 2.7.2 Energy Indexes

Energy indexes are useful for comparing homes and characterizing their energy efficiency. They are used to measure the opportunity for application of weatherization or home performance work.

Most indexes are based on the square footage of conditioned floor space. The simplest indexes divide a home’s energy use in

either kilowatt-hours or British thermal units (BTUs) by the square footage of floor space.

A more complex index compares heating energy use with the climate’s severity. BTUs of heating energy are divided by both square feet and heating degree days to calculate this index.

## 2.8 CUSTOMER EDUCATION

Customer education is a potent energy conservation measure. A well-designed education program engages customers in household energy management and assures the success of installed energy conservation measures (ECMs).

## 2.9 SWS ALIGNMENT

Field Guide Topic	SWS Detail
Purposes of an Energy Audit Pg. 87	
Energy-Auditing Judgment and Ethics Pg. 88	
Energy-Auditing Record-keeping Pg. 89	
Customer Relations Pg. 89	
Communication Best Practices Pg. 90	
Customer Interview Pg. 90	
Deferral of Weatherization Services Pg. 91	
Parts of an Energy Audit Pg. 92	
Visual Inspection Pg. 93	
Diagnostic Testing Pg. 93	

<b>Field Guide Topic</b>	<b>SWS Detail</b>
SIR Calculations with ECM Selection Pg. 94	
The Work Order Pg. 95	
Questions about the Audit and Work Order Pg. 96	
Work Inspections Pg. 96	
In-Progress Inspections Pg. 96	
Final Inspections Pg. 97	
Quality Control Versus Quality Assurance Pg. 98	
Field Monitoring Pg. 98	
Understanding Energy Usage Pg. 99	
Baseload Versus Seasonal Use Pg. 100	
Energy Indexes Pg. 102	
Customer Education Pg. 103	

## CHAPTER 3: WEATHERIZATION MATERIALS

This chapter focuses on materials for insulation and air sealing. It begins by discussing the introductory information on air sealing and then air sealing materials, insulation building science, and insulation materials. This information supports the next four chapters on the major parts of the building shell.


### 3.1 AIR-SEALING GOALS

The job description of a weatherization contractor often includes duct sealing. Perform air leakage testing and evaluation before beginning air-sealing or duct-sealing work.

Always evaluate ventilation and perform combustion-safety testing as a part of air sealing a home. *See "Whole-Building Ventilation" on page 374.*

Reducing air leakage accomplishes several goals.

- Saves energy by reducing unintentional air exchange with outdoors
- Reduces air leakage and convection around insulation, protecting its thermal resistance
- Increases comfort by reducing drafts and moderating the radiant temperature of interior surfaces
- Reduces moisture migration into building cavities
- Reduces the pathways by which fire spreads through a building

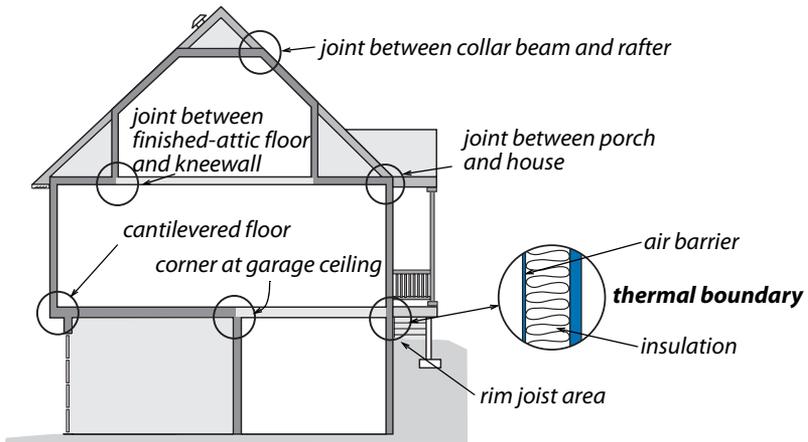

**Air leaks at the thermal boundary:** The air barrier and insulation, which should be adjacent to one other, are located at the thermal boundary. The insulation and the air barrier are often discontinuous at corners and transitions.

## 3.2 AIR SEALING SAFETY

### *SWS Detail: 2.0103.1 Air Sealing Worker Safety*

Air sealing reduces the exchange of fresh air in the home, and can alter the pressures within the home. Before air sealing, survey the home to identify both air pollutants that may be concentrated by air sealing efforts and open combustion appliances that may be affected by changes in house pressure.

Don't do air sealing when there are obvious threats to the occupants' health, the installers' health, or the building's durability that are related to air sealing. If any of the following circumstances are present, either postpone air sealing until they're corrected or correct the problems as part of the air-sealing work.

- Measured carbon monoxide levels exceed the suggested action level. *See "Carbon Monoxide (CO) Testing" on page 254.*

- Combustion zone depressurization exceeds the limits shown in *SWS 2.0299.1 Combustion Appliance Depressurization Limits Table*, or “*Maximum CAZ Depressurization*” on page 495 during a worst-case test. See “*Worst-Case CAZ Depressurization Test*” on page 255.
- Occupants will use unvented space heaters as a primary source of heat after weatherization is completed.
- The air-leakage area has moisture damage, indicated by staining, mold or rot.

### 3.2.1 Air Sealing and Fire Containment

*SWS Detail: 4.1001.5 Dense Pack Preparation, 3.1001.1 Penetrations and Chases, 3.1001.2 Chase Capping, 3.1001.3 Walls open to Attic—Balloon Framing and Double Walls*

Fire, flame and smoke spread through the paths of least resistance. Many building assemblies harbor concealed voids or cavities within walls, ceilings and attics. During a fire, these pathways spread fire and make fire-fighting difficult.

In new buildings, the IRC requires builders to seal all shafts and hidden air leaks between living spaces and intermediate zones with fire-blocking materials.

The building codes define a fire-block as a material installed to “resist the free passage of flame through concealed spaces.” Fire-blocking materials don’t need to be non-combustible.

We recommend that you use fire-blocking materials, discussed next, when doing retrofit air sealing.

Insulation reduces heat transmission by resisting the conduction, convection, and radiation of heat through the building shell. Insulation combined with an air barrier creates the thermal envelope between the conditioned indoors and outdoors.

Installing insulation is one of the most effective energy-saving measures. You can ensure insulation's safety and effectiveness by following these guidelines.

- ✓ Install insulation in a way that enhances fire safety and doesn't degrade it. *See "Preparing for Attic Insulation" on page 146.*
- ✓ Comply with lead-safe practices when disturbing paint in pre-1978 homes. *See "Lead-Safe Work Practices" on page 40.*
- ✓ Prevent air movement through and around the insulation with an effective air barrier. Make sure that the air barrier and insulation are aligned (next to one another).
- ✓ Protect insulation from moisture by repairing roof and siding leaks, providing site drainage, and by controlling vapor sources within the home. *See "Insulation Durability" on page 127.*
- ✓ Install insulation to meet or exceed the guidelines of the International Energy Conservation Code (IECC) 2012 and the DOE's Standardized Work Specifications.

### 3.3 AIR SEALING MATERIALS

Air barriers must resist severe wind pressures. Use strong air barrier materials like structural wood paneling, drywall, or sheet metal to seal large air leaks, especially if your region has powerful winds. Attach these strong materials with mechanical fasteners and seal them with caulk or adhesive. If a technician needs to access a shaft or penetration in the future use a caulk that isn't a strong adhesive, such as acrylic latex.

Use caulk by itself for sealing small cracks. Use liquid foam for cracks larger than  $\frac{1}{4}$  inch.

### 3.3.1 Air Barrier Materials

Air barrier materials should themselves be air barriers and also rated as fire blocks. *See Table 12-1 on page 480.*

Plywood, OSB, etc.

Three-quarter-inch plywood, OSB, and particle board are IRC-approved fire-blocking materials, and they're strong enough to resist windstorms. Attach these structural sheets with screws or nails along with any sealant or adhesive that effectively air seals the joint.

Drywall

Half-inch drywall constitutes a 15 minute thermal barrier, and is also an ignition barrier. When air sealing a fire-rated assembly in a commercial or multi-family building, choose five-eighths - inch drywall and a fire-rated caulking. Fasten drywall with screws and construction adhesive. Don't use drywall in damp locations where it may get wet.

Steel and Aluminum Sheet Metal

Being non-combustible, sheet metal is used to seal around chimneys and other heat producing components. To seal around chimneys, cut the galvanized steel accurately, with less than a 1/8-inch gap, so that you can seal the gap with high temperature, non combustible caulk.

Foam Board

Foam board may be a desirable product for air sealing; however it has less structural strength and fire resistance than the other materials discussed previously.

## Cross-Linked Polyethylene House Wrap

House wrap and polyethylene sheeting are air barriers. These flexible materials aren't rated as fire-blocks, and they are structurally weak.

### 3.3.2 Stuffing Materials

Stuffing materials are used to insulate a cavity, to give the cavity a bottom, or to serve as supporting part of an air seal.

#### Backer Rod

Backer rod and caulking are the most reliable and long-lasting air seals. Backer rod is closed-cell polyethylene foam that creates a bottom barrier in a gap before caulking. Backer rod doesn't bond to the caulking, and so prevents three-sided adhesion that could tear the caulking bead apart with the materials' expansion and contraction of temperature extremes.

#### Fiberglass Batts

Fiberglass batts reduce air convection in cavities where they're installed. However, fiberglass batts are air permeable, even if compressed. Batts can support two-part foam sprayed over the opening of a cavity. Fiberglass batting is a good stuffing material for use with non-combustible caulk for penetrations through fire-rated assemblies because of its low combustibility.

#### Blown Cellulose or Fiberglass

Blown cellulose and fiberglass reduce air convection and air leakage through closed cavities. However neither material is an air barrier even when blown at high densities. Both are considered fire-blocks when installed in closed cavities because they block the passage of flames.

### 3.3.3 Caulking and Adhesives

The adhesion and durability of caulking and adhesives depends on their formulation and on the surfaces to which they're applied. Some caulks and adhesives are sensitive to dirt and only work well on particular surfaces, while others are versatile and dirt-tolerant. Remove debris and clean the joint to create a long lasting seal.

#### Water-Based Caulks

A wide variety of paintable caulks are sold under the description of acrylic latex and vinyl. These are the most commonly used caulks and the easiest to apply and clean up. Siliconized latex caulks are among the most adhesive and durable sealants in this group. Don't apply water-based caulks to building exteriors when rain is forecast since they aren't waterproof until cured, and they stain nearby materials if they are rained upon while curing. Don't apply water-based caulks during freezing weather.

#### Silicone Caulk

Silicone has great flexibility, but its adhesion varies among different surfaces. Silicone is easy to gun even in cold weather. Silicone isn't as easy to clean up as water based caulks, though it's easier than polyurethane or butyl. Silicone isn't paintable, so choose an appropriate color. High temperature silicone can tolerate temperatures above 400° F and is used with galvanized steel to air seal around chimneys.

#### Polyurethane Caulk

Polyurethane has the best adhesion and elasticity of any common caulk. It works very well for cracks between different materials like brick and wood. Polyurethane resists abrasion and is used to seal critical joints in concrete slabs and walls. It is also good for sealing the fastening fins of windows to walls. Polyurethane is almost as sticky and adhesive as a construction adhesive. Cleaning it up is difficult so neat workmanship is essential.

Polyurethane caulk doesn't gun easily, and should be room temperature or higher. Polyurethane caulk doesn't hold paint.

### Acoustical Sealant

This solvent-based or water-based adhesive is used to seal laps in polyethylene film and house wrap. Acoustical sealant is very sticky, adheres well to most construction materials, and remains flexible. Acoustical sealant is used to seal building assemblies for sound deadening. Acoustical sealant is also used to seal the seams of polyethylene vapor barriers and ground moisture barriers.

### Water Soluble Duct Mastic

Duct mastic is the best material for sealing ducts, including cavities used for return ducts. A messy but highly effective sealant, duct mastic can be applied with a thickness of  $\frac{1}{8}$ -inch with a brush or rubber glove. Have a bucket of warm water handy to clean your gloved hands and a rag to dry the gloves. Spread the mastic and use fiberglass fabric web tape to reinforce cracks more than  $\frac{1}{8}$ -inch in diameter. Thorough cleaning of dust and loose material isn't necessary. Mastic bonds tenaciously to everything, including skin and clothing.

### Stove Cement

Stove cement is a material that can withstand temperatures up to 2000° F. It is used to seal wood stove chimneys and to cement wood stove door gaskets in place.

### Non-Combustible Caulk

Some elastomeric caulks are designed specifically for use in fire-rated assemblies. They can withstand flame and temperatures to 2000° F. Use this type of sealant when sealing penetrations through fire-rated assemblies in multifamily buildings.

## Fire-Rated Mortar

Used with other air-sealing materials to seal various sized holes and gaps in multifamily buildings with fire-rated building assemblies. This mortar covers the foam to create a non-combustible surface for an air seal.

## Construction Adhesives

Construction adhesives are designed primarily to bond materials together. But they also create an air seal if applied continuously around the perimeter of a rigid material. They are often used with fasteners like screws or nails but can also be used by themselves. Some construction adhesives act like contact adhesives to bond lightweight materials without mechanical fasteners.

Use specially designed construction adhesives for polystyrene foam insulation because many general-purpose adhesives decompose the foam's surface.

### 3.3.4 Liquid Foam Air Sealant

Liquid closed-cell polyurethane foam is a versatile air sealing material. Closed-cell foam is packaged in a one-part injectable variety and a two-part sprayable variety. It has a high R-value per inch and is ideal for insulating and air sealing small, poorly insulated, and leaky areas in a single application.

Installation is easy compared to other materials to accomplish the same air sealing tasks. However, cleanup is difficult enough that you probably don't want to clean up multiple times on the same job. Instead identify all the spots needing foam application, make a list, and foam them one after another.

#### One-Part Foam

This gap filler has tenacious adhesion. One-part foam is best applied with a foam gun rather than the disposable cans. Cleanup is difficult if you're careless. When squirted skillfully

into gaps, one-part foam reduces air leakage, thermal bridging, and air convection. One-part foam isn't effective or easy to apply to gaps over about one inch or to bottomless gaps. This product can leave small air leaks because it cracks when the materials around it move or shift.

### Two-Part Foam

Good for bridging gaps larger than one inch. Two-part foam is popular for use with rigid patching materials to seal large openings. Cut foam board to close-enough tolerances around obstacles and fill the edges with the two-part foam. Two-part foam should be sprayed to at least an inch of thickness when it serves as an adhesive for foamboard patches over large holes for strength.

### Foam Construction Adhesive

Polyurethane foam dispensed from foam guns is an excellent adhesive for joining many kinds of building materials. It works well for joining foam sheets together into thick slabs for vertical access doors and attic hatches.



**One-part foam:** A contractor uses an applicator gun to seal spaces between framing members and around windows.



**Two-part foam:** A contractor air seals and insulates around an attic hatch dam with two-part spray foam.

### 3.4 INSULATION BUILDING SCIENCE

*SWS Details: 4.1001.6 Unvented Roof Deck—Preparation for Spray Polyurethane Foam, 4.1001.7 Vented Roof Deck—Preparation for SPF*

Insulation reduces heat transmission by resisting the conduction, convection, and radiation of heat through the building shell. Insulation combined with an air barrier creates the thermal envelope between the conditioned indoors and outdoors.

Installing insulation is one of the most effective energy-saving measures. You can ensure insulation's safety and effectiveness by following these guidelines.

- ✓ Install insulation in a way that enhances fire safety and doesn't degrade it. *See "Safety Preparations for Attic Insulation" on page 148.*
- ✓ Comply with lead-safe practices when disturbing paint in pre-1978 homes. *See "Lead-Safe Work Practices" on page 40.*
- ✓ Prevent air movement through and around the insulation with an effective air barrier. Make sure that the air barrier and insulation are aligned (next to one another) using procedures outlined starting on *page 133.*
- ✓ Protect insulation from moisture by repairing roof and siding leaks, providing site drainage, and by controlling vapor sources within the home. *See "Solutions for Moisture Problems" on page 31.*
- ✓ Install insulation to meet or exceed the guidelines of the International Energy Conservation Code (IECC) 2012 and the DOE's Standardized Work Specifications.

### 3.5 INSULATION MATERIAL CHARACTERISTICS

*SWS Detail: 4.1003.7 Ignition and Thermal Barriers—Spray Polyurethane Foam*

The purpose of insulation is to provide thermal resistance that reduces the rate of heat transmission through building assemblies. Characteristics such as R-value per inch, density, fire safety, vapor permeability, and airflow resistance help weatherization specialists choose the right insulation for the job.

### 3.5.1 Fibrous Insulation Materials

Fibrous insulation materials are the most economical insulations for buildings. If blown at a high density, fibrous insulations aren't air barriers themselves, but they may contribute to the air-flow resistance of a building assembly that functions as an air barrier. The term *mineral wool* describes both fiberglass and *rock wool*. Rock wool is both a generic term and a trade name. We use rock wool in the generic sense as an insulating wool spun from rocks or slag. Fiberglass is wool spun from molten glass.

Cellulose was once made from virgin wood fiber under trade names like Balsam Wool. Now cellulose is manufactured primarily from recycled paper, treated with a fire retardant.


A vapor permeable air barrier should cover fibrous insulation installed vertically or horizontally in human-contact areas to limit exposure to fibers, which may cause respiratory distress.

#### Fiberglass Batts and Blankets

Most fiberglass batts are either 15 inches wide or 23 inches wide to fit 16-inch or 24-inch spacing for wood studs or joists. However, manufacturers also provide 16-inch or 24-inch widths for metal stud construction.

The advertised R-values of batts vary from 3.1 per inch to 4.2 per inch depending on density. Installed fiberglass R-values may be 5% to 30% less than advertised depending on installation quality and the effectiveness of the assembly's air barrier.

**Evaluating batt performance:** The thermal performance of batts depends on density and installation.

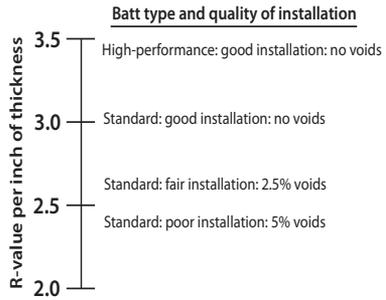

Installers must cut and fit batts very carefully. Batts achieve their advertised R-value only when they are touching all six sides of the cavity it inhabits.

*See “Open-Cavity Wall Insulation” on page 192.*

Fiberglass blankets are typically three to six feet wide. Blankets come in a variety of thicknesses from 1 to 6 inches. Fiberglass blankets are used to insulate metal buildings, to insulate crawl spaces from the inside, and to insulate water heaters.

Although fiberglass doesn’t absorb much moisture, the facings on blankets and batts can trap water in the batts, which can dampen building materials and provide a water source for pests.

### Facings for Fiberglass Batts

Insulation manufacturers make batts and blankets with a number of facings, including the following.

- Unfaced: Vapor permeable and Class-A fire rating of  $\leq 25$  flame spread.
- Kraft paper: A Class II vapor retarder that is flammable (Class-C) with a flame spread  $\geq 150$ .
- Foil-kraft: foil bonded to kraft paper. A vapor barrier with a flame spread of  $\geq 75$ .
- Foil-skrim-kraft (FSK): Aluminum foil bonded to kraft paper with skim netting in-between as reinforcement. A

vapor barrier available as a Class-A material with a flame spread of  $\leq 25$ .


- White poly-skrim-kraft (PSK): White polyvinylchloride bonded to kraft paper with skim netting in-between as reinforcement. A vapor barrier available as a Class A fire-rated material with a flame spread of  $\leq 25$ . The white surface maximizes light reflection.

## Blown Fiberglass

Loose fiberglass is blown in attics from 0.4 to 0.6 pcf and at that density the R-value is around 3.2 per inch. Blown fiberglass is non-combustible as a virgin product. However, some blown fiberglass is made from chopped batt waste that contains a small amount of combustible binder.

Fiberglass manufacturers now provide two blowing products, one for standard densities of up to about 1.4 pcf, and another for dense-packing to more than 2.0 pcf.

In closed cavities, installers blow fiberglass from 1.2 to 2.2 pcf, with the R-value per inch varying from 3.6 to 4.2. Higher density achieves a higher R-value. The high-density fiberglass is typically reserved for walls where the superior resistance to settling, airflow, and convection has extra value in resisting airflow driven by the chimney effect.



**Insulation hoses, fittings, and the fill tube:** Smooth, gradual transitions are important to the free flow of insulation.

## Blown Cellulose

Cellulose is the most inexpensive insulation and among the easiest insulations to install. Loose cellulose is blown in attics from 0.6 to 1.2 pcf and at that density range, the R-value is around 3.7

per inch. Expect around 15% settling within five years after installation.

In wall cavities, cellulose is blown at a higher density of between 3.5 to 4.0 pcf, to prevent settling and to maximize its airflow resistance. At that high density, cellulose's R-value per inch is around 3.4. Evaluate the strength of wall cladding before blowing a wall with cellulose to prevent damage during installation.

Cellulose absorbs up to 130% of its own weight in water. Before anyone discovers a moisture problem, the cellulose could be soaked, shrunken, double its dry weight, and far less thermally resistant. Avoid using cellulose in regions with an annual average precipitation of more than 50 inches or an annual average relative humidity of more than 70%. We believe that cellulose shouldn't be installed in the following places regardless of climate.

- Horizontal or sloped closed roof cavities
- Floor cavities above crawl spaces or unconditioned basements
- Crawl space walls

## Rock Wool

Rock wool is a type of mineral wool like fiberglass. Rock wool has a small market share in North America. Rock wool batts have similar R-values per inch as fiberglass batts and contain flammable binders. Rock wool itself is non-combustible so blown rock wool doesn't burn.

Rock wool is also the most moisture-resistant insulation discussed here. In rainy and humid climates, rock wool is the least likely insulation to harbor moisture or support pests.

## Damp Spray Fibrous Insulation

Installers mix fibrous insulation with sprayed water and a small amount of adhesive in damp-spray applications either in open cavities or directly adhered to building surfaces. Sprayed cellu-

lose contains a non-corrosive fire retardant to prevent metal corrosion when used in contact with metal building components.

### 3.5.2 Operating the Insulation Blowing Machines

*SWS Detail: 4.1001.5 Dense Pack Preparation, 4.1088.7 Insulating Inaccessible Attics*

Perform these important steps before and during insulation-blowing.

- ✓ Verify that the electrical source can provide the ampere draw of the insulation machine.
- ✓ Measure the pressure created by a blowing machine by connecting the hose to a fitting attached to a manometer. Close the feed gate and turn the air to the highest setting. The blowing machine should develop 2.9 pounds per square inch (psi) or 80 inches of water (IWC).
- ✓ Verify that you're blowing the correct density of fibrous insulation by using the bag's weight or the manufacturer's coverage tables.

**Blower pressure gauge:** For blowing closed cavities, blower pressure should be at least 80 IWC or 2.9 psi. Measure the pressure with maximum air, feed gate closed, and agitator on.



### 3.5.3 Spray Foam Insulation Materials

*SWS Details: 4.1001.6 Unvented Roof Deck—Preparation for Spray Polyurethane Foam, 4.1001.7 Vented Roof Deck—Preparation for SPF, 2.0100.3 Global Worker Safety*

Spray Polyurethane Foam (SPF) is combustible and creates toxic smoke. Foam insulation usually requires covering with a thermal barrier or an ignition barrier, discussed in [“Fire Protection for Foam Insulation” on page 124](#). SPF comes in two formulations: closed-cell and open-cell. Both are described below.

Spray foam is an insect-friendly material that can aid termites and carpenter ants in establishing a colony in wood structures. Mitigate all sources of ground water before installing foam near a foundation. When foam is installed on the outside of foundations, the surrounding soil should be treated with a termiticide if necessary. Inside a crawl space, foam must never provide a direct link from the ground to wood materials. The International Residential Code (IRC) forbids foam below grade in “very heavy” termite-infested areas.

**Caution:** SPF is hazardous to installers. Installers must wear special personal protective equipment and ventilate spaces during installation. SPF can also harm occupants who breathe the toxic vapors during installation. SPF requires precise mixing of the two components at specific temperature ranges. Improperly mixed or installed spray foam can emit vapors for months or years resulting in long-term respiratory hazards.

#### Closed-Cell Spray Polyurethane Foam

Closed-cell polyurethane spray foam (SPF) is an air barrier and a vapor barrier and is the most expensive insulation discussed here. Closed-cell SPF is a good value when space is limited, where an air or vapor barrier is needed, or where its structural strength and durability are needed.

Spray foam professionals install closed-cell SPF from two 55-gallon containers through hoses and a nozzle that mix the material. The closed-cell foam installs at approximately 2 pcf density and achieves an R-value of 6 or more per inch. However, roofing applications call for a density near 3 pcf.

Closed-cell polyurethane foam is also packaged in smaller containers in the following products.

- One-part high-expanding foam for air sealing.
- One-part low-expanding foam for air sealing.
- Two-part high-expanding foam for air sealing and insulation of surfaces.

### Open-Cell Polyurethane Spray Foam and Injectable Foam

Polyurethane open-cell foam is installed at between 0.5 pcf to 1.0 pcf and achieves an R-value of around 3.7 per inch to 4.7 per inch depending on density.

These open-cell formulations are injected into a hole, one inch or smaller, through an injection nozzle and not a fill tube. (The plastic fill tube would clog and isn't cleanable.) The open-cell foam can subject a wall cavity to some pressure, so evaluate wall-cladding strength before injecting it.

Open-cell foam can absorb both water vapor and liquid water. Open-cell foam can hold moisture and become a medium for mold growth. We recommend that contractors don't install low-density spray foam in the following locations.

- Underside of roof decking
- Underside of floor decking above crawl spaces
- Crawl space walls

## 3.5.4 Fire Protection for Foam Insulation

*SWS Detail: 4.1003.7 Ignition and Thermal Barriers—Spray Polyurethane Foam*

Plastic foam is the generic term used by the IRC 2012 for both rigid and spray foams. Plastic foams are combustible, and create toxic smoke when they burn. The IRC 2012 requires a thermal barrier (half-inch drywall) for spray foam in all living areas and storage areas. Instead of a thermal barrier, installers may use an ignition barrier (1.5 inches of fibrous insulation or intumescent paint) to cover foam in attics and crawl spaces that aren't used for storage.

Fire protection requirements vary among foam formulations, according to the amount and type of fire retardant. Foam insulations generally fit into one of two classifications.

- Class 2 or Class B; flame spread 26-75
- Class 1 or Class A;  $\leq 25$  flame spread

Code jurisdictions and individual building officials vary in their interpretation of the IRC depending on these three factors.

1. Foam manufacturer's fire-testing reports, specifically flame spread.
2. The possibility that residents might use the space for storage or even living space.
3. The possibility that no one may ever enter the space again.

## 3.5.5 Foam Board Insulation

Foam board is combustible and creates toxic smoke. Foam insulation usually requires covering with a thermal barrier or an ignition barrier, discussed in *"Fire Protection for Foam Insulation"* on page 124.

Foam board is an insect-friendly material that can aid termites in establishing colonies in wood structures. Mitigate all sources of ground water before installing foam near a foundation. When foam is installed on the outside of foundations, the surrounding soil should be treated with a termiticide. Inside a crawl space, foam must never provide a direct link from the ground to wood materials where termites or carpenter ants are common. The International Residential Code (IRC) forbids foam below grade in “very heavy” termite-infested areas.

### Expanded Polystyrene (EPS) Foam Board

EPS foam board, sometimes called beadboard, is the most inexpensive of the foam insulations. EPS varies in density from 1 to 2 pcf with R-values per inch of 3.9 to 4.7, increasing with increasing density. EPS is packaged in a wide variety of products by local manufacturers. Products include structural insulated panels (SIPs), tapered flat-roof insulation, EPS bonded to dry-wall, and EPS embedded with fastening strips.

EPS is flammable and produces toxic smoke when burned. It has a low maximum operating temperature (160 degrees F) that is a concern for using EPS under dark-colored roofing or siding. EPS has shrunk in some installations.

EPS is very moisture resistant and its vapor permeability is similar to masonry materials, which makes EPS a good insulation for masonry walls.

Dense EPS (2 pcf) is appropriate for use on flat roofs and below grade. Dense EPS is also more dimensionally stable and less likely to shrink. Use weatherproof coverings to prevent degradation by ultraviolet light and freezing and thawing at ground level.

### Extruded Polystyrene (XPS) Foam Board

XPS is produced by only a few manufacturers and is popular for below-grade applications. XPS is more expensive than EPS and

has an R-value of 5.0 per inch. XPS may be the most moisture-resistant of the foam boards.

XPS is flammable and produces toxic smoke when burned. XPS must be covered by a thermal barrier when installed in living spaces. XPS has a low maximum operating temperature (160 degrees F) that is a concern for using XPS under shingles or dark-colored siding. XPS has shrunk in some installations. Use weatherproof coverings to prevent degradation by ultraviolet light and freezing and thawing at ground level.

### Polyisocyanurate (PIC) Foam Board

PIC board has the highest R-value per inch (R-6 or a little more) of any common foam board. PIC is packaged with a vapor permeable facing or an aluminum-foil (vapor barrier) facing. PIC is expensive but worth the cost when the thickness of insulation is limited.

PIC is combustible and produces toxic smoke during a fire. However some products have fire retardants that allow installation in attics and crawl spaces without a thermal barrier or ignition barrier.

PIC has a low maximum operating temperature (<200 degrees F) that may be a concern for using PIC under dark-colored roofing or siding. Use the high-density (3 pcf) PIC board for low-sloping roof insulation.

### Polystyrene Beads

Polystyrene (EPS) beads can be poured or blown into cavities. The cavities must be airtight or the beads will escape, making an annoying mess. EPS beads have an R-value between 2.2 and 2.5 per inch. Beads work well for filling hollow masonry walls.

### Vermiculite and Perlite

These expanded minerals are pour-able and used when a non-combustible insulation or high temperature insulation is

needed. R-value per inch is between 2.0 and 2.7 per inch. These products are good for insulation around single-wall chimney liners to prevent condensation in the liner. Existing vermiculite may contain asbestos, and it must not be disturbed by anyone except a licensed asbestos abatement specialist.

## 3.6 INSULATION SAFETY AND DURABILITY

Insulation activities require awareness about safety. Reference the following safety-related sections of this guide if necessary.

- ✓ See “*Asbestos Containing Materials (ACM)*” on page 38.
- ✓ See “*Decommissioning Knob-and-Tube Wiring*” on page 43.
- ✓ See “*Respiratory Health*” on page 50.

The following fire-safety and durability issues are particularly important to installing foam insulation.

- Foam insulation requires a thermal barrier covering of at least half-inch drywall when installed in a living space.
- Foam may require an ignition barrier when installed in attics or crawl spaces or it may not.
- A *thermal barrier* is a material, usually drywall, that protects combustible materials behind it from heat and flame creating a fire.
- An *ignition barrier* is designed to delay the ignition of the material it protects. Ignition barriers include plywood, galvanized steel, damp-spray fiberglass, and intumescent paint. Intumescent paint is a proprietary latex coating designed to delay the ignition of foam insulation in a fire.

### 3.6.1 Insulation Durability

Moisture is the most common and severe durability problem in insulated building assemblies. Moisture fosters rot by insects and microbes. Entrained moisture reduces the thermal resis-

tance of many insulation materials. Moisture affects the chemistry of some building materials: metals for example.

Moisture prevention includes denying moisture access to building cavities, allowing condensed water to drain out, and allowing moisture to dry to the indoors, outdoors, or both.

Retrofitting insulation can affect the preventive measures listed here. Consider the function and relevance of these building components whenever you install insulation.

- **Air barrier:** Air can carry moisture into building cavities from indoors or outdoors where the moisture can condense and dampen insulation and other building materials. Air leakage is an energy problem too. The air barrier is any continuous material or building assembly that provides acceptable resistance to air leakage.
- **Vapor retarder:** Vapor diffusion can carry large amounts of water vapor into building cavities where it can condense and dampen insulation and other building materials. Vapor retarders resist water vapor diffusion from indoors into cavities where condensation can dampen insulation and other building materials.
- **Ground-moisture barrier:** The ground under a building is the most potent source of moisture in many buildings, especially those built on crawl spaces. Most crawl spaces require ground-moisture barriers to prevent the ground from being a major cause of moisture problems.
- **Water resistive barrier (WRB):** Asphalt paper or house wrap, under siding and roofing, serves as the home's last defense to wind-driven rain, which can dampen sheathing and other building materials. This water resistive barrier must be protected during insulation and incorporated into window openings during window replacement.
- **Vapor permeable materials:** Most common building materials are permeable to water vapor, which allows the water vapor to follow a gradient from wet to dry. This pro-

cess allows building assemblies to dry out to both indoors and outdoors. Vapor permeable materials are essential for fail-safe building assemblies in most climates.

- **Flashings:** Seams and penetrations in building assemblies are protected by flashings, which prevent water from entering these vulnerable areas.
- **Drainage features:** Intentional or unintentional drainage features of buildings allow water to drain out of cavities. Examples: Masonry veneers have intentional drainage planes and weep openings near their bottoms. Cathedral ceilings drain water out through their soffit vents unintentionally.
- **Water storage:** Masonry veneers and structural masonry walls have the ability to store rainwater and dry out during dry weather.
- **Ventilation:** Roofs, attics, crawl spaces and even some walls have ventilation features that dry out wet building assemblies.
- **Termiticide:** When foam insulation is installed below grade in regions with termites, apply a termiticide to the soil in amounts determined by the labeling of the termiticide.

Consult with experts when necessary to preserve, protect, or install these moisture-prevention features, according to local climate and established best practices.

### 3.7 SWS ALIGNMENT

Field Guide Topic	SWS Detail
Sealing Major Air Leaks and Bypasses	3.1001.1 Penetrations and Chases, 3.1001.2 Chase Capping, 3.1001.3 Walls Open to Attic— Balloon Framing and Double Walls
Air Sealing Safety	2.0103.1 Air Sealing Worker Safety
Air Sealing and Fire Containment	4.1001.5 Dense Pack Preparation 3.1001.1 Penetrations and Chases, 3.1001.2 Chase Capping, 3.1001.3 Walls open to Attic— Balloon Framing and Double Walls
Insulation Building Science	4.1001.6 Unvented Roof Deck— Preparation for Spray Polyurethane Foam, 4.1001.7 Vented Roof Deck— Preparation for SPF
Insulation Material Characteristics	4.1003.7 Ignition and Thermal Barriers— Spray Polyurethane Foam
Fibrous Insulation Materials	
Operating the Insulation Blowing Machines	4.1001.5 Dense Pack Preparation 4.1088.7 Insulating Inaccessible Attics

<b>Field Guide Topic</b>	<b>SWS Detail</b>
Spray Foam Insulation Materials	4.1001.6 Unvented Roof Deck— Preparation for Spray Polyurethane Foam, 4.1001.7 Vented Roof Deck— Preparation for SPF 2.0100.3 Global Worker Safety
Fire Protection for Foam Insulation	4.1003.7 Ignition and Thermal Barriers—Spray Polyurethane Foam
Foam Board Insulation	
Insulation Safety and Durability	
Insulation Durability	
Air Sealing Materials	
Air Barrier Materials	
Stuffing Materials	
Caulking and Adhesives	
Liquid Foam Air Sealant	



## CHAPTER 4: ATTICS AND ROOFS

This chapter discusses air sealing and insulating attics and roofs. Whether the thermal boundary is at the attic floor or the roof, the air barrier and the insulation should be adjacent to one another and continuous at that location.

### 4.1 AIR-SEALING ATTICS AND ROOFS

Air sealing attics and roofs may be the most important and cost effective weatherization measure and one of the most challenging. The attic or roof is a prominent location for air-leakage and moisture damage. Building fires tend to spread through large air leaks in the attic. Air-sealing can prevent these problems.

#### 4.1.1 Sealing around Manufactured Chimneys


##### *SWS Detail: 3.1001.1 Penetrations and Chases*

Several types of manufactured chimneys are common in residential buildings. We explain these in *“Manufactured Chimneys” on page 304*. Observe the required clearances listed in *“Clearances to Combustibles for Common Chimneys” on page 304*.

Install the chimney’s air seal with an insulation shield if you’ll retrofit insulation after air sealing.

- ✓ Remove the insulation from around the manufactured chimney.
- ✓ Cut light gauge aluminum or galvanized steel in two pieces with half-circle holes for the chimney that create small caulk-able cracks.
- ✓ Bed the metal in sealant and staple, nail, or screw the metal in place.
- ✓ Caulk around the junction of the chimney and the metal air seal with non-combustible caulk.

- ✓ Cut and assemble a metal insulation shield that extends above the level of the planned retrofit insulation.
- ✓ Move the existing insulation that you removed back into place around the insulation shield.

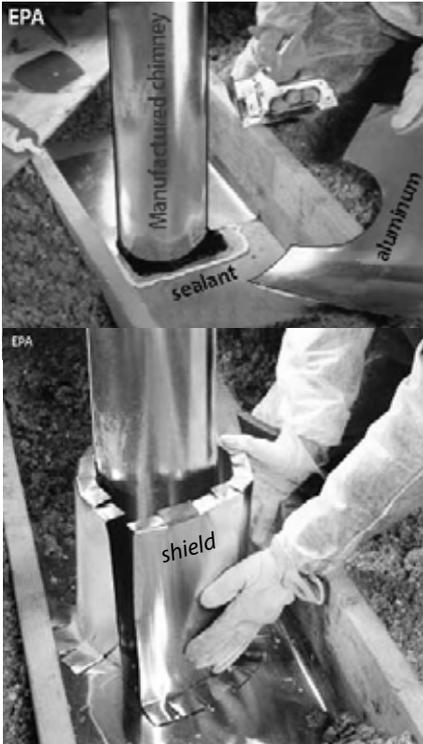

**Sealing manufactured chimneys:** When installing retrofit insulation in addition to air sealing, install a shield on top of the air seal that extends above the level of the new insulation.


## 4.1.2 Sealing around Fireplaces and Chimneys

### *SWS Detail: 3.1001.1 Penetrations and Chases*

Leaks around fireplace chimneys are often severe air leaks. Use this procedure to seal air leaks through the chimney chase.

- ✓ Cut sheet metal to fit the gap that borders the chimney with overlaps connecting to nearby attic framing lumber.

- ✓ Bed the sheet metal air seal in sealant, and then fasten the sheet metal to the attic framing with staples, nails, or screws.
- ✓ Seal the metal patch to chimney or flue with a non-combustible sealant.
- ✓ Seal other gaps between the attic and the chimney chase.
- ✓ For large chimney chases, cover the chase opening with structural material such as plywood. Maintain clearances between the structural seal and the metal or masonry chimney as listed in *“Clearances to Combustibles for Common Chimneys”* on page 304.

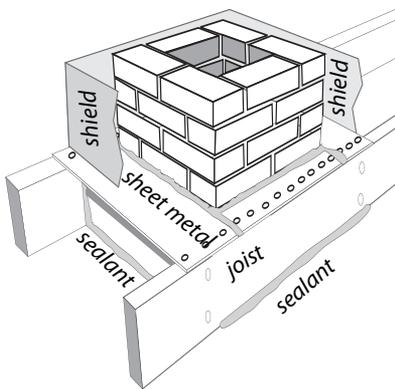

**Sealing around chimneys:** Chimneys require both an air seal and a shield if retrofit insulation is installed with air sealing.

### 4.1.3 Air Sealing Recessed Lights

*SWS Details: 3.1003.5 Dropped Ceiling with Light Boxes and Fixtures, 3.1003.6 Dropped Soffits, 4.1001.1 Non-Insulation Contact (IC) Recessed Light*

The most common type of recessed light fixture is the round can. However all recessed light fixtures are potential air leaks and air-leakage conduits. Many recessed light fixtures have safety switches that turn them off at around 150° F. Too much insulation covering the fixture or foam insulation could cause the safety switch to cycle.

There are three kinds of recessed can lights found in buildings. (IC means insulation contact. AT means airtight.)

1. Older cans that aren't rated for contact with insulation, known as non-IC-rated cans.
2. IC-rated cans that may be covered with fibrous insulation but not foam insulation.
3. ICAT-rated cans that are airtight in addition to being rated for insulation contact.


Consider the following options for reducing air leakage through recessed can lights.

- Build a drywall box over the fixture leaving at least 3 inches clearance from insulation on all sides and to the lid of the enclosure. Seal the airtight box to surrounding materials with foam to form an airtight assembly.
- Install an airtight trim assembly in the existing can that will greatly reduce the can's air leakage. Install a compact fluorescent or LED light as a replacement for the hot inefficient incandescent bulb.
- Install an airtight LED-retrofit assembly in the existing can. This option assures that the light is energy-efficient and low heat because you can replace an incandescent bulb with an LED.
- Replace the recessed fixture with a new one, designed to be airtight and carefully seal around the airtight fixture.

Recessed light fixtures should contain 60-watt bulbs or less. Compact fluorescent lamps (CFLs) or LED lamps are preferred for recessed light fixtures because CFLs and LEDs operate cooler than incandescent lamps.

**Caution:** Don't cover IC-rated or airtight IC-rated fixtures with spray foam insulation. The foam's high R-value and continuous contact could overheat the fixture.

*See also "Safety Preparations for Attic Insulation" on page 148.*

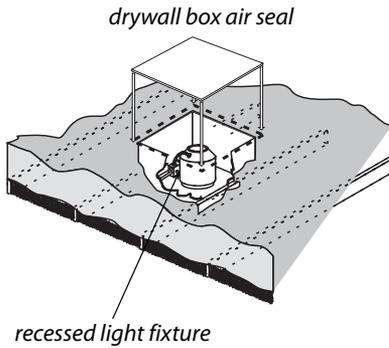

**Air seal and shield for non-IC can:**  
This drywall box is an insulation shield and air seal, but allows the fixture some air circulation for cooling.



**Low-air-leakage trim retrofit:**  
These kits employ a standard Edison base. Install a CFL or an LED in the base for maximum energy savings.



**Airtight LED retrofit for can lights:** These retrofit fixtures provide a low-wattage LED with a low-air-leakage enclosure that inserts into the existing can light.

## 4.1.4 Sealing Stairways to Unconditioned Attics

*SWS Details: 3.1002.1 Interior with Sloped Ceiling, 3.1002.2 Stairwell to Attic—Door at Bottom with No Ceiling Above, 3.1002.3 Stairwell to Attic—Door at Top with Finished Ceiling Above*

There are a variety of stairways and hatchways that provide access from the building to an unconditioned attic.

The following components of these stairways may need air sealing and insulation depending on whether they are at the thermal boundary.


- The risers and treads of the stairways
- The surrounding triangular walls
- Vertical or horizontal doors or hatches
- The framing and sheeting surrounding the doors or hatches
- Sloping ceilings above the stairways

Consider the following air-sealing measures.

- ✓ Study the geometry of the stairway and decide where to establish the air barrier and install the insulation.
- ✓ Weatherstrip around doors and hatches if the door or hatch is at the thermal boundary.
- ✓ Seal the walls, stair-stringer space, and ceiling if they are at the thermal boundary.
- ✓ Seal gaps between the door frame and the framing with one-part foam, two-part foam, or caulking.
- ✓ Build a dam 10 inches high above the top of the floor joists around hatch. Make the dam strong enough to support the weight of anyone entering the attic and to hold back blown in cellulose. Air seal this dam to the surrounding structure of the hatch.

- ✓ With existing insulation dams, clear existing fibrous insulation from around dam around the hatch framing. Spray two-part foam around the perimeter to reduce heat loss through the hatch framing.

See also *"Walk-Up Stairways and Doors"* on page 167.

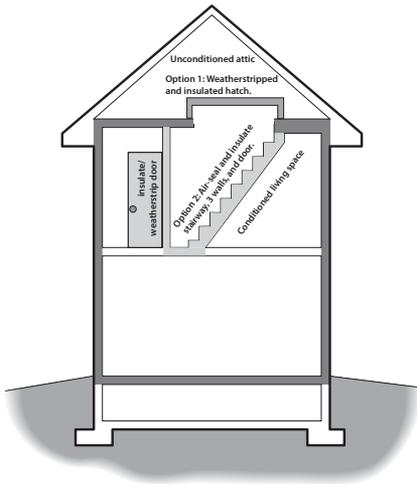



**Stairways at the thermal boundary:** The stairway may be within the thermal boundary or outside it. Only walls, ceilings, doors, and hatches at the thermal boundary require thorough air sealing. The door as shown is open.

#### 4.1.5 Sealing Porch Roof Structures

Porch roofs on older homes were often built at the framing stage or before the water resistive barrier (WRB) and siding were installed. The porch's roof sheathing, roofing, and tongue-and-groove ceiling aren't air barriers. The loosely fitting wall sheathing or unsheathed wall allows air into the wall cavities where it migrates into the conditioned space or convects heat into or out of the building.

Consider these options for air sealing leakage through a porch roof.

- Remove part of the porch ceiling and install a rigid air barrier or cover the area with closed-cell spray foam.
- Dense-pack the porch-roof cavity to reduce the airflow through the porch roof and wall cavities.

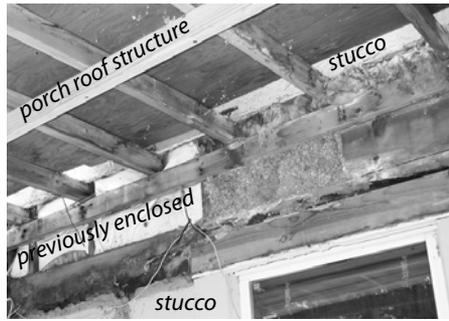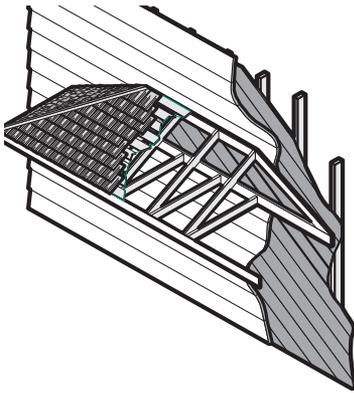

**Porch air leakage:** Porch roof cavities often allow substantial air leakage because of numerous joints, and because there may be no siding or sheathing installed in the wall behind the roof and ceiling.

#### 4.1.6 Removing Insulation for Attic Air Sealing

Attic air sealing is essential for successful air sealing jobs. Removing insulation from an attic for the purpose of air sealing may be worth the cost and effort. Batts and blankets can be rolled up, moved out of the way, and re-used. Loose fill insulation can be vacuumed with commercial vacuum machines available from the same suppliers that sell insulation-blowing machines. Many insulation companies own large vacuums for loose-fill insulation.



**Removing attic insulation:** Technicians vacuum and collect existing attic insulation for re-use or disposal because of moisture damage or to allow effective air sealing.

## 4.1.7 Sealing Joist Cavities Under Knee Walls

*SWS Detail: 4.1004.1 Preparation for Dense Packing, 4.1004.2 Preparation for Batt Insulation*

Floor joist cavities beneath knee walls allow air from a ventilated attic space to enter the floor cavity between stories. This is a problem of homes with a finished attic, also known as story-and-a-half homes.


Connect the knee wall with the ceiling of the space below by creating a rigid seal under the knee wall. Use a combination of rigid foam with one-part or two-part foam sealing the perimeter. Or, use fiberglass batt with spray two-part foam as a strong airtight seal covering over the fiberglass batt.

## 4.1.8 Sealing Kitchen or Bathroom Interior Soffits

*SWS Detail: 3.1001.1 Penetrations and Chases, 3.1001.2 Chase Capping, 3.1003.6 Dropped Soffits*

Many modern homes have soffits above kitchen cabinets and in bathrooms. Large rectangular passages link the attic with the soffit cavity. At best, the air convects heat into or out of the conditioned space. At worst, attic air infiltrates the conditioned space through openings in the soffit or associated framing.

- ✓ Seal the soffit with plywood or drywall, bedded in sealant and fastened to ceiling joists and soffit framing with screws, nails or staples.
- ✓ Seal the patch's perimeter thoroughly with two-part foam or caulking.

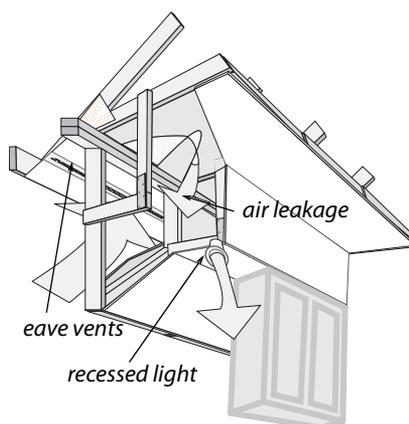


**Kitchen soffits:** The ventilated attic is connected to the soffit and the wall cavity through framing flaws. Any hole in the soffit creates a direct connection between the kitchen and attic. The photo shows a soffit sealed from the attic with foam board reinforced with two-part spray foam.

## 4.1.9 Sealing Two-Level Attics

### *SWS Detail: 3.1001.3 Walls Open to Attic—Balloon Framing and Double Walls*

Split-level and tri-level homes have a particular air leakage problem related to the walls and stairways dividing the homes' levels.

- ✓ Seal wall cavities below the ceiling joists from the attic with a rigid material fastened to studs and wall material.
- ✓ Or insert folded fiberglass batt into the wall cavity and spray with at least one inch of two-part foam to create a rigid air seal.
- ✓ Dense-pack the transitional wall or insulate it with fiberglass batts. Either way install an air barrier on the attic side of the wall.
- ✓ Seal all penetrations between both attics and conditioned areas.

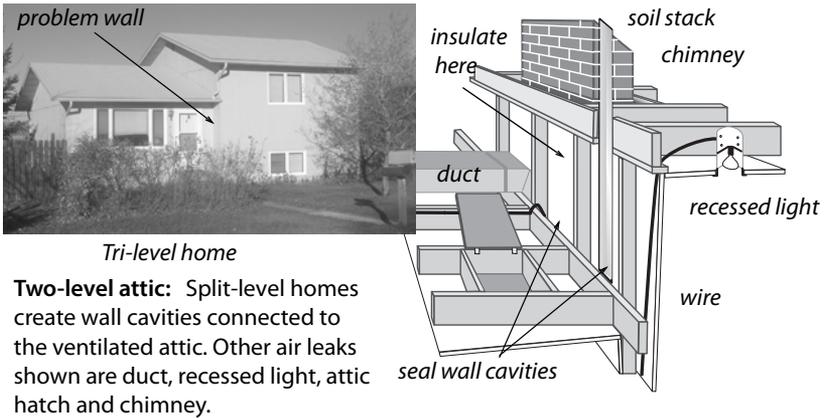

**Two-level attic:** Split-level homes create wall cavities connected to the ventilated attic. Other air leaks shown are duct, recessed light, attic hatch and chimney.

#### 4.1.10 Sealing Suspended Ceilings

*SWS Detail: 3.1003.1 New Ceiling Below Original—Old Ceiling Intact or Repairable, 3.1003.2 Ceiling Leaks Not Repairable—No Air Barrier Above, 3.1003.4 3-D Walls, 3.1003.3 Above Closets and Tubs, 3.1003.5 Dropped Ceiling with Light Boxes and Fixtures*

Suspended ceilings are seldom airtight, especially the T-bar variety. T-bar ceilings and other non-structural suspended ceilings may not be a practical location to establish an air barrier.


- The ceiling was installed room by room.
- The amount of spray foam necessary to seal the joints may be too heavy for the non-structural suspended ceiling to support.
- Technicians may need access to the crawl space above the suspended ceiling in multiple locations to work on utilities installed above the ceiling.

Take down some panels of a suspended ceiling to inspect the suspended ceiling or gain access from above. Observe these options for air-sealing non-structural suspended ceilings.


- A plaster ceiling above a non-structural suspended ceiling is weak and failing. You plan to install insulation on top of existing insulation above the failing ceiling. Reinforce the existing plaster with screws and plaster washers. Screw dry-wall over areas of missing plaster. Seal the joints and perimeter with spray foam.
- An insulated roof deck above a non-structural suspended ceiling may be the only practical place to establish an air barrier. The perimeter walls and the wall-roof junction may be leaky and uninsulated. Insulate and air seal the perimeter walls above the suspended ceiling if necessary to complete the insulation and air barrier at the thermal boundary.

Ceilings suspended using lumber or steel studs, on the other hand, may be structural enough to walk on.

- The suspended ceiling is strong enough to walk on its structure. Seal the ceiling joints, penetrations, and perimeter with spray foam. Insulate the walls between the suspended ceiling and upper ceiling. Either insulate above the suspended ceiling or above the upper ceiling.

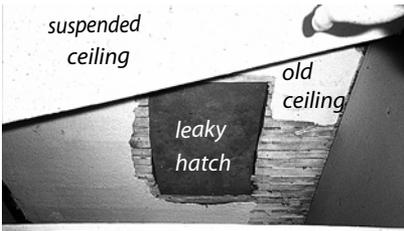

**Sealing existing upper ceilings:** With a non-structural suspended ceiling and a damaged plaster ceiling above, seal the plaster ceiling above if it's impractical to air seal the suspended ceiling.

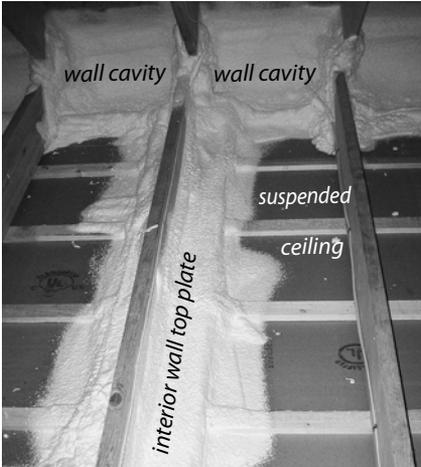

**Sealing structural suspended ceilings:** Two-part foam air seals and insulates an interior wall top plate and the wall cavity between the ceiling and roof deck.



**Sealing the roof deck:** Seal the roof wall junction with spray foam. Insulate the walls above the suspended ceiling. Insulate the roof deck if there's no insulation on top of the roof deck.

## 4.2 INSULATING ATTICS AND ROOFS

Attic and roof insulation are two of the most cost-effective energy conservation measures.

Buildings with flat ceilings are usually insulated at the ceiling and this is attic insulation. An attic is a space under a roof where a person can walk or crawl.

Buildings with sloping ceilings or flat roofs are usually insulated in the roof cavity. Roof cavities are spaces that aren't usually accessible for walking or crawling.

A majority of buildings have fibrous insulation in their attics or roof cavities. Fibrous insulation is the most economical insulation for attics and roof cavities. Attics and roof cavities need ventilation for drying, cooling, and to prevent ice dams. *See “Fibrous Insulation Materials” on page 117.*


## 4.2.1 Preparing for Attic Insulation

*SWS Detail: 4.1001.4 Vented Eave or Soffit Baffles, 4.1001.1 Non-Insulation Contact (IC) Recessed Lights*

Installers perform these preparatory steps before insulating the attic.

- ✓ Before insulating the attic, seal air leaks and bypasses as described previously. *See “Air-Sealing Attics and Roofs” on page 133.* Verify attic air-tightness as described in *“Simple Zone Pressure Testing” on page 483.*
- ✓ Repair roof leaks, remove other moisture sources, and repair other attic-related moisture problems before insulating attic. Don't do any retrofit work in the attic until all attic moisture problems have been repaired.
- ✓ Vent all kitchen and bath fans outdoors through appropriate roof fittings, side wall fittings, or soffit fittings. *See “Fan and Duct Specifications” on page 380.*
- ✓ Install a hatch if none is present, preferably at a large gable vent on the home's exterior.

- ✓ An interior attic hatch should be at least 16 inches wide and 24 inches long if horizontal and 36 inches high if vertical.
- ✓ Insulate the hatch to the maximum practical R-value. The roof's height above the hatch may limit rigid board foam you can attach to the back of the hatch door.

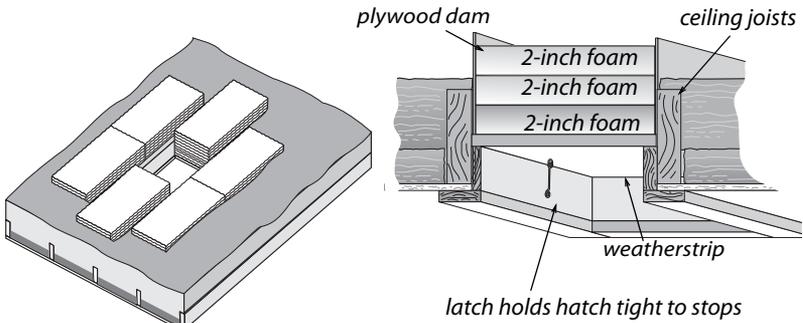

**Batts form attic-insulation dam:**  
Where head space is limited, fiberglass batts are a good choice for a low-profile insulation dam.

**Insulated attic hatch:** Building a dam prevents loose-fill insulation from falling down the hatchway. Foam insulation prevents the access hatch from being a thermal weakness. Install foam to achieve attic-insulation R-value of R-38. Foam can be glued together in layers.

- ✓ Build an insulation dam around the attic access hatch two inches above the height of the insulation. Build the dam with rigid materials like plywood or oriented-strand board so that the dam supports the weight of a person entering or leaving the attic.
- ✓ Install vent chutes or baffles to prevent blown insulation from plugging the space between soffit vents and the attic. The baffles help to maximize the amount of insulation that you can install over top plates without clogging ventilation paths. Baffles also help prevent the wind-washing of insulation caused by cold air entering soffit vents. They should extend at least 4 inches above the finished insulation level.

## 4.2.2 Safety Preparations for Attic Insulation

*SWS Detail: 4.1001.1 Non-Insulation Contact (IC) Recessed Light, 4.1006.3 Whole-House Fan, 4.1005.2 Accessible Floors—Loose Fill Installation, 4.1005.3 Accessible Floors—Batt Insulation Over Existing Insulation, 4.1005.4 Accessible Floors—Loose Fill Over Existing Insulation, 4.1001.2 Knob and Tube Wiring*

Before insulating the attic, protect the heat-producing fixtures, such as recessed light fixtures and chimneys, by installing shields. Without shields, the light fixture or chimney might ignite the insulation. Or, the insulation might cause a light fixture or chimney to become hot enough to ignite something else.

The shielding enclosure must often serve as the air-seal for the chimney or light fixture.

### Protecting Recessed Light Fixtures

There are three different types of recessed light fixtures and light-fan fixtures. (IC = insulation contact)

1. Non-IC-rated fixtures that must not touch insulation.
2. Type IC-rated fixtures that may be covered with fibrous insulation.
3. Type IC-AT, which are reasonably airtight (AT) and safe for contact by fibrous insulation.

Consider these options when preparing recessed light fixtures for attic insulation.

- Remove the recessed light fixture and replace it with a surface-mount fixture.
- Replace non-IC-rated fixtures with airtight IC-rated fixtures (IC-AT). You can cover these IC-AT fixtures with fibrous insulation after sealing the gap between the fixture and the surrounding materials.


- If the existing fixture is rated IC, you can seal the fixture's enclosure to the ceiling with caulk and cover the fixture with fibrous insulation. Or you can shield the fixture with an enclosure, seal the enclosure to the ceiling with foam, and then cover the enclosure with insulation.
- Shield all existing non-IC-rated fixtures with airtight enclosures that extend above the level of the retrofitted insulation. Seal the enclosure to the ceiling with foam, and then surround the enclosure with insulation, but don't insulate over its top.
- In cavities that are sheathed on both sides, either shield non-IC recessed lights or replace them before dense-packing the cavities.
- Spray foam insulation must not contact or surround recessed light fixtures or any other heat-producing devices.

If an existing older recessed fixture, which aren't labeled IC must remain in place, do these steps.

- ✓ Install non-insulating enclosures around these heat-producing recessed lights and fan-light fixtures.
- ✓ Maintain 3 inches of clearance between the insulation shield and the fixture on the sides and top.

**Recessed light fixtures:**

Cover recessed light fixtures with fire-resistant drywall or sheet-metal enclosures to reduce air leakage to allow installers to safely insulate around the box.

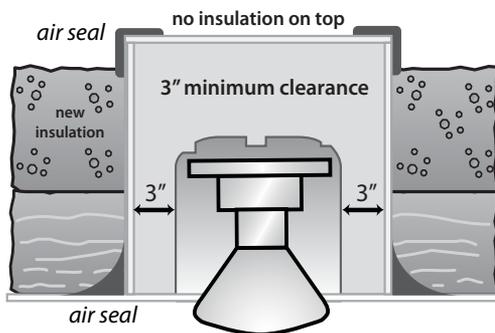

- ✓ Build the insulation shield to extend 4 inches above the finished attic insulation.

- ✓ Fasten the shields securely to the ceiling so they don't move or collapse.
- ✓ Notch the shields around wires.
- ✓ Seal the shield's enclosure to the ceiling with foam or caulk.


## Protecting Chimneys

The requirements for protecting chimneys from contact with insulation vary widely from one building department to another. We know of three common approaches to insulating around chimneys, which are listed here beginning with the most restrictive.

1. Air-seal around the chimney using non-combustible material like 26 gauge galvanized steel. Seal the steel to the chimney with a high-temperature sealant.
2. After air sealing gaps, install non-combustible insulation shields around masonry chimneys and manufactured metal chimneys to keep insulation at least 3 inches away from these chimneys.
3. A clearance smaller than 3 inches may be allowed if the attic insulation is non-combustible or if the specifications of the vent material allow a clearance less than 3 inches. For example: type B gas vent has a typical minimum clearance of 1 inch and all-fuel chimneys have a typical minimum clearance of 2 inches.
4. If the insulation is non-combustible, such as blown fiberglass or rock wool, no clearance between insulation and manufactured or masonry chimneys is necessary if this option is permitted by local building officials.

**Air-sealed chimney with metal shield:** Metal flashing bridges the gap between the chimney and the framing. A metal shield keeps the insulation 3 inches away from the chimney.

*maintain 3-inch clearance*

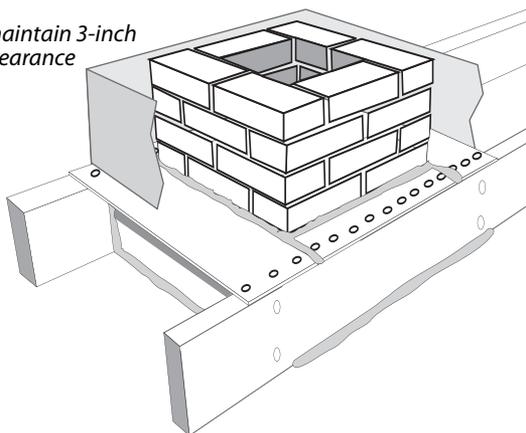

## Electrical Junction Boxes

Observe these specifications during attic-insulation preparation.

1. Install covers on all electrical junction boxes that lack covers.
2. Use caulk or two-part foam to air seal electrical boxes that penetrate the ceiling (for light fixtures and fans), before blowing fibrous insulation over the boxes.
3. Flag the electrical boxes so that an electrician can find the boxes for future electrical work.

## Knob-and-Tube Wiring

If knob-and-tube wiring is present in the attic, consider decommissioning it prior to installing insulation. *See “Decommissioning Knob-and-Tube Wiring” on page 43.*

### 4.2.3 Blowing Attic Insulation

*SWS Detail: 4.1001.5 Dense Pack Preparation, 4.1005.4 Accessible Floors—Loose Fill Over Existing Insulation, 4.1005.8 Loose Fill Over Existing Insulation on Accessible Attic Floors*

Install attic insulation to a cost-effective R-value, depending upon existing insulation level and climatic region. Air seal attics before installing attic insulation. Air sealing may require removing existing insulation and debris that obstruct air sealing. *See “Removing Insulation for Attic Air Sealing” on page 140.*

Blown insulation is usually better than batt insulation because blown insulation forms a seamless blanket. Blown fibrous attic insulation settles: cellulose settles 10% to 20% and fiberglass settles 3% to 10%. Blowing attic insulation at the highest achievable density helps minimize both settling and air circulation within the blown insulation.

Observe these specifications when blowing loose-fill attic insulation.

- ✓ Calculate how many bags of insulation are needed to achieve the R-value specified on the work order from the table on the bag’s label.
- ✓ Install insulation depth rulers: one for every 300 square feet.
- ✓ Maintain a high density by moving as much insulation as possible through the hose with the available air pressure. The more the insulation is packed together in the blowing hose, the greater is the insulation’s installed density.
- ✓ Fill the edges of the attic first, near the eaves or gable end, then fill the center.
- ✓ When filling a tight eaves space, push the hose out to the edge of the ceiling. Allow the insulation to fill and pack against the baffle.
- ✓ Install insulation to a consistent depth. Level the insulation with a stick if necessary.
- ✓ Post an insulation certificate, with insulation type, installed thickness, coverage area, and insulation R-value at the attic entrance.

**Blown-in attic insulation:** Blown insulation is more continuous than batts and produces better coverage. Insulation should be blown at a high density to minimize settling and air convection.



#### 4.2.4 Closed-Cavity Attic Floors

*SWS Detail: 4.1003.4 Cape Cod Side Attic Roof—Dense Pack Installation, 4.1005.6 Enclosed Attic Storage Platform Floor — Dense Pack Installation*

The ceiling joists in the attic are often covered by a wood floor for storage. You may have to remove some floor boards or drill the floor sheathing to install dense-packed insulation.



**Finished attic floor:** Find the large air leaks underneath the flooring and seal them before insulating the space between the joists.

- ✓ Inspect and thoroughly seal the floor cavity's air leaks before blowing insulation.

- ✓ Protect recessed light fixtures and other heat-producing devices in the floor cavity.
- ✓ Then dense-pack fiberglass or cellulose insulation into the spaces between the ceiling joists.

## 4.2.5 Insulating Closed Roof Cavities

*SWS Detail: 4.1002.1 Above Deck Roof Insulation—Preparation, 4.1002.2 Above Deck Roof Insulation—Installation, 4.1001.5 Dense Pack Preparation, 4.1003.1 Pitched/Vaulted/Cathedralized Ceilings—Loose Fill Over, 4.1003.2 Pitched/Vaulted/Cathedralized Ceilings—Dense Pack Over, 4.1003.3 Unvented Flat Roof with Existing Insulation SWS Detail: 4.1003.5 Unvented Roof Deck—Spray Polyurethane Foam Installation*

Many homes have cathedral ceilings or flat roofs that are only partially filled with insulation. The IRC 2012 building code requires one of these two approaches to insulate a roof cavity.

1. A ventilated space of at least one inch between the roof insulation and the roof sheathing.
2. Foam roof insulation in addition to the cavity insulation of between R-5 and R-35 depending on climate.

Many cathedral roof cavities have been dense-packed with fiberglass insulation without ventilation or foam roof insulation. Some experts believe that this is an effective solution. However, this solution usually requires engineered plans approved by the building department when a building permit is required.

### Ventilated Closed Roof Cavities

Inspect the roof cavities for baffles that will maintain a one-inch air space between the new insulation and the roof deck. To prepare for roof-cavity insulation, without existing baffles and with a ventilated space above the insulation, use this procedure.

- ✓ Remove either the roofing and sheathing or the interior ceiling to gain full access to the cavity.
- ✓ Remove recessed light fixtures and replace them with surface-mounted light fixtures. Carefully patch and air seal the openings.
- ✓ Install fiberglass or foam insulation to meet the IECC 2012 regional minimum roof-assembly R-value requirements.
- ✓ Install openings into the ventilation channel above the insulation totaling  $\frac{1}{150}$  of the roof area. If the ceiling has a vapor barrier the requirement is reduced to  $\frac{1}{300}$  of the roof area.
- ✓ In cold climates, install a vapor barrier at the ceiling. At minimum paint an oil-based primer over the interior dry-wall or plaster.
- ✓ Repair roof leaks or install a new water-tight roof. Replace moisture-damaged sheathing as part of the roof replacement.
- ✓ Install an air-barrier ceiling (drywall) if the existing ceiling isn't an adequate air barrier, for example tongue-and-groove paneling.
- ✓ Seal other air leaks with great care, especially at the perimeter and around ridge beams.
- ✓ When replacing the roof, consider installing 1-to-8 inches of rigid high-density foam insulation on top of the roof deck. If you choose this option, dense-pack the existing roof cavity first.

### Un-Ventilated Closed Roof Cavities: Preparation

Many homes have cathedral ceilings, vaulted ceilings, or flat roofs that are partially filled with insulation and would require removing the roof or the ceiling in order to install baffles for ventilation.

**Important Note:** Whether roof cavities can be safely dense-packed with fiberglass insulation and without ventilation is controversial and depends on climate. The colder the climate, the higher the risk of problems. Dense-packing the cavities prevents most convection and moist-air infiltration, which are leading causes of moisture problems in roof cavities. Consult a knowledgeable local engineer before deciding to dense-pack a roof cavity with fiberglass. Don't insulate roof cavities with cellulose because of its moisture absorption and susceptibility to moisture damage.

To prepare for dense-packing the roof-cavity, consider the following steps.

- ✓ Reduce or eliminate sources of moisture in the home. *See "Solutions for Moisture Problems" on page 31.*
- ✓ Verify that the ceiling has a vapor retarder and air barrier on the interior. If not, install a vapor retarder and air barrier.
- ✓ Remove recessed light fixtures and replace them with IC-AT fixtures or surface-mounted fixtures. Carefully patch and air seal the openings if you replace the recessed fixtures with surface-mounted ones.
- ✓ Seal other ceiling air leaks, large and small, with great care.
- ✓ When replacing the roof during roof-cavity insulation, consider installing 1-to-8 inches of rigid high-density foam insulation on top of the roof deck. If you replace the roof, dense-pack the existing roof cavity first.
- ✓ Don't insulate the roof deck without first filling the closed roof cavity beneath the roof because the roof assembly's thermal resistance will be reduced by air convection inside the roof cavity.

### Blowing Insulation into the Closed Roof Cavity

Always use a fill tube when blowing closed roof cavities. Insert the tube into the cavity to within a foot of the end of the cavity.

Access the cavity through the eaves, the roof ridge, the roof deck, or the ceiling. Consider one of these procedures.

- Drilling holes in the roof deck after removing shingles or ridge roofing.
- Removing soffit and blowing insulation from the eaves.
- Drilling and blowing through a drywall ceiling.
- Carefully removing a tongue-and-groove plank and blowing insulation into cavities through this slot.



**Blowing from the eaves:** Some vaulted ceilings can be blown from the eaves and/or the ridge.



**Blowing from the roof deck:** Technicians remove a row of shingles, drill, and blow fiberglass into this vaulted roof cavity.

## 4.2.6 Exterior Rooftop Foam Insulation

Only install rooftop foam insulation over dense-packed roof cavities. A ventilation space between existing insulation and the new rooftop insulation reduces the foam's R-value. Roofers use this method mainly when re-roofing low-sloping roofs.

- ✓ Use high density foam board: 2 pcf for polystyrene or 3 pcf for polyisocyanurate if the roof is flat or low sloping.

- ✓ Flash all external penetrations according to the roofing manufacturer's specifications.
- ✓ Use a cool roofing material such as white rubber or white metal to limit the foam's temperature during intense summer sunshine and to minimize cooling costs.
- ✓ Contact a design professional to make sure the roof will drain properly after foam installation.

Many foam manufacturers can taper expanded polystyrene foam, providing wedge-shaped pieces to create slope for drainage. *See “Expanded Polystyrene (EPS) Foam Board” on page 125. See “Polyisocyanurate (PIC) Foam Board” on page 126.*

## 4.2.7 Installing Fiberglass Batts in Attics

### *SWS Detail: 4.1005.3 Accessible Floors—Batt Insulation Over Existing Insulation*

Follow these specifications when installing fiberglass batts in an attic. Fiberglass batts aren't the best insulation for attics because of all their seams.

- ✓ When layering batts, install new layers at right angles to underlying layers if the top of the existing batts are level with or above the ceiling joist or truss bottom chord.
- ✓ Install un-faced fiberglass insulation whenever possible.
- ✓ If you must install faced batts, install them with the facing toward the heated space. Never install faced insulation over existing insulation.
- ✓ Cut batts carefully to ensure a tight fit against the ceiling joists and other framing.

## 4.2.8 Cathedralized Attics (Open Cavity)

*SWS Details: 4.1003.2 Pitched/Vaulted/Cathedralized Ceilings—Dense Pack Over, 4.1003.5 Unvented Roof Deck—Spray Polyurethane Foam Installation, 4.1001.7 Vented Roof Deck—Preparation for SPF, 4.1003.7 Ignition and Thermal Barriers—Spray Polyurethane Foam*

A cathedralized attic has insulation attached to the bottom of the roof deck and is also called a hot roof. Choose to insulate the bottom of the roof deck instead of insulating the ceiling when the building owner wants to use the attic or to enclose an attic air handler and leaky ducts within the home's thermal boundary.

**Important:** Insulating the roof deck presents a risk of moisture problems from roof leaks or condensation. To avoid moisture condensation within the insulation or at the bottom of the roof deck during cold weather, use air-impermeable insulation such as closed-cell foam or install an air barrier and vapor retarder to the rafters.

### Spray Foam Roof-Deck Insulation

Use these procedures for spraying high-density, closed-cell foam on the underside of the roof deck.

- ✓ Remove any vapor retarder in the ceiling insulation at the floor of the attic.
- ✓ Create an airtight insulation dam at the eaves to form an air barrier at the roof-wall junction and to prevent spray foam from escaping into the soffit.
- ✓ Spray
- ✓ Comply with fire safety provisions of the IRC as discussed in *“Closed-Cell Spray Polyurethane Foam” on page 122.*

Use **only** high-density closed-cell spray foam and not low-density open-cell spray foam for application to the bottom of a roof deck.

## Fiberglass Roof-Deck Insulation

Insulating the rafter space with an air-permeable insulation requires an air barrier, vapor retarder, and Class I (or A) fire-rated material at the roof cavity's lower boundary. Consider these two alternatives.

1. Install the rafter's depth of fiberglass batts and then a material or combination of materials that constitutes an air barrier, vapor retarder, and Class I fire barrier.
2. Blow dense-packed fiberglass insulation between the roof deck using a rigid sheeting or flexible insulation restraint. Dense-pack the fiberglass at a minimum of 2.0 pcf.



*Insulated gable*

**Unventilated attic:** The unventilated attic or cathedralized attic is a last resort when an air handler and leaky ducts are in the attic.

## 4.2.9 Vaulted Attics

*SWS Detail: 4.1003.1 Pitched/Vaulted/Cathedralized Ceilings—Loose Fill Over*

A vaulted attic is framed with a special truss that creates a sloping roof and a sloping ceiling. Access to the cavity varies from difficult to impossible. Install insulation from either the top of the roof deck or through the ceiling. Insulation, installed at the ceiling, must have some stability to prevent gravity from pulling it downhill or wind from piling it, leaving some areas under-

insulated. Consider the following options to insulating uninsulated or partially insulated vaulted attics.

1. Insulate the ceiling with fiberglass batts. Install the batts parallel to the framing if the top of existing insulation is below the framing. Install the batts perpendicular to the framing if the top of the existing insulation is above the framing.
2. Insulate the bottom of the roof deck, as described previously for a cathedralized attic, if you remove the ceiling.
3. Insulate the ceiling with sprayed foam, damp-spray fibrous insulation, or batts from the roof with the roof sheathing removed.
4. Fill the cavity to approximately 100% with loosely blown fiberglass from indoors or through the roof.
5. Preserve or install openings into the ventilation space above the insulation totaling  $\frac{1}{150}$  of the roof area. If the ceiling has a vapor retarder the requirement is  $\frac{1}{300}$  of the roof area.

#### 4.2.10 Finished Knee Wall Attics

*SWS Detail: 4.1004.1 Preparation for Dense Packing, 4.1005.1 Accessible Floors—Batt Installation*

Finished attics require special care when installing insulation. They often include five separate sections that require different air-sealing and insulating methods. Seal air leaks in all these assemblies before insulating them. If necessary, remove the planking and insulation from the side-attic floor to expose the air leaks


Use these specifications when insulating finished attics.

- ✓ Seal large air leaks between conditioned and non-conditioned spaces.

- ✓ Inspect the structure to confirm that it has the strength to support the weight of the insulation.
- ✓ Insulate access hatches to the approximate R-value of the assembly through which it is located.

**Attic floor and knee wall:**

Establish an air barrier at the attic floor and knee wall if you insulate these assemblies.

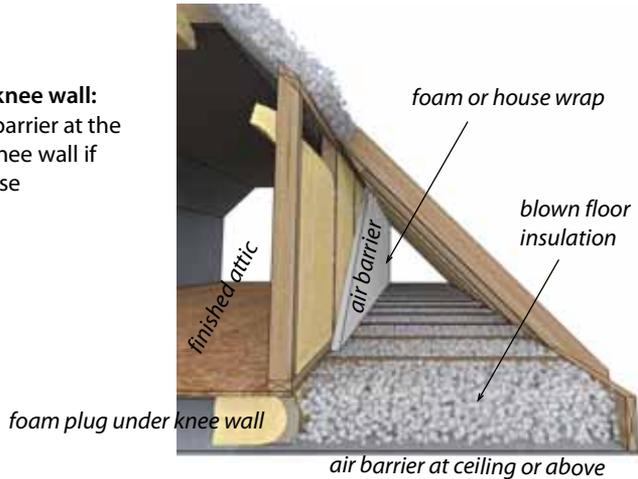

## Attic Floor

There are a number of options for insulating the attic floor of a finished attic with knee walls. By attic floor, we mean the ceiling of the living space below with its ceiling joists and any floor sheathing installed over the joists for a storage platform.

- Install blown fibrous insulation over the ceiling, which should be an air barrier.
- Install blown fibrous insulation over existing insulation.
- Install fiberglass batts over the ceiling, which should be an air barrier.
- Install fiberglass batts over the existing insulation.

Whichever of these options that you choose, do the necessary air sealing to the attic floor before installing insulation. Also observe the preparations and safety precautions discussed in


*“Preparing for Attic Insulation” on page 146 and “Safety Preparations for Attic Insulation” on page 148.*

## Exterior Walls of Finished Attic

Insulate these walls as described in *“Retrofit Closed-Cavity Wall Insulation” on page 189* or *“Open-Cavity Wall Insulation” on page 192.*

## Collar-Beam Attic


Insulate this type of half-story attic as described in *“Blowing Attic Insulation” on page 151.*

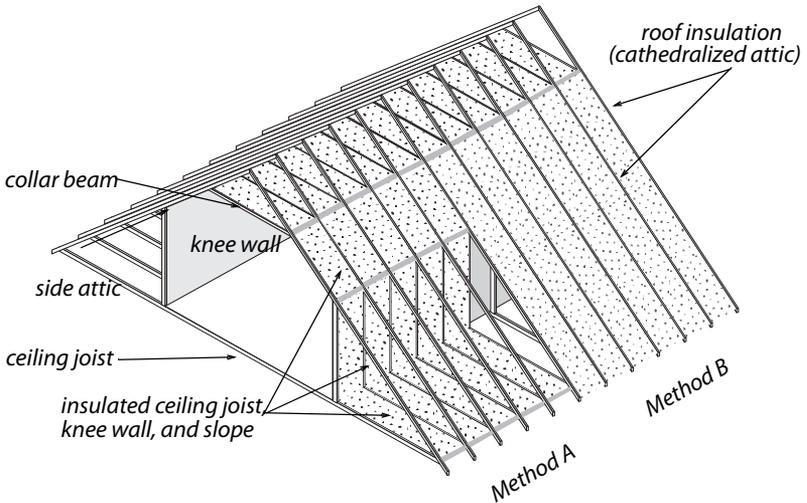

**Finished attic:** This illustration depicts two approaches to insulating a finished attic. Either A) insulate the knee wall and side attic floor, or B) insulate the roof deck.

## Sloped Roof

Insulate sloped roof with densepack fiberglass or cellulose insulation. Install plugs of fiberglass batt, or other vapor permeable material, at the ends of this cavity to contain the blown insulation while allowing it to breathe.

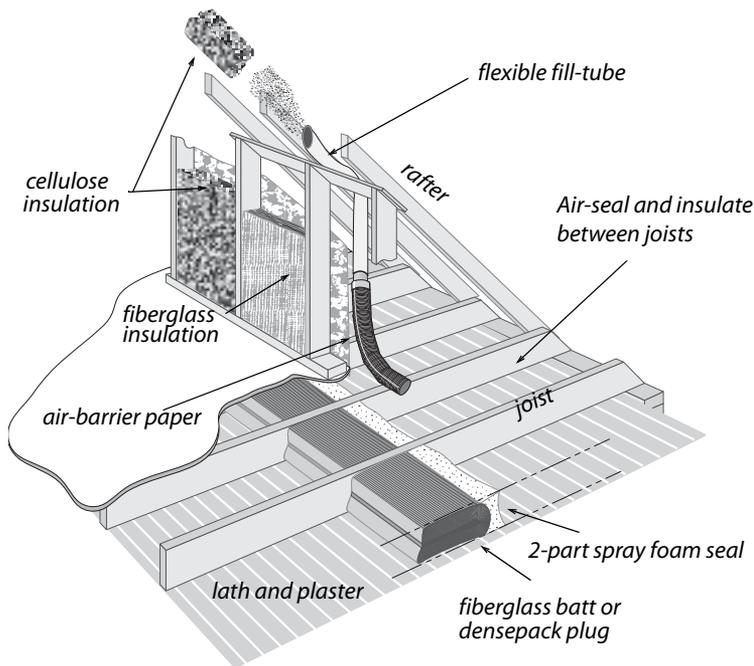

**Finished attic best practices:** Air sealing and insulation combine to dramatically reduce heat transmission and air leakage in homes with finished attics.

## 4.2.11 Knee Wall Insulation

*SWS Details: 4.1004.1 Preparation for Dense Packing, 4.1004.3 Strapping for Existing Insulation, 4.1004.4 Knee Wall Without Framing, 4.1004.5 Knee Walls and Gable End Walls—Preparation for and Installation of Spray Polyurethane Foam (SPF)*

Insulate knee walls using any of these methods.

- Install un-faced fiberglass batts and cover the insulation with house wrap on the attic side. Prefer R-15, 3.5-inch fiberglass batts.
- Install the house wrap or another insulation restrainer first and reinforce it with wood lath. Then blow dense-packed fibrous insulation into the cavity through the house wrap

and patch the house wrap with tape. (Cellulose: 3.5 pcf; fiberglass 2.2 pcf)

- Spray the cavities with open-cell or closed-cell polyurethane foam after gaining access to the cavities and removing surface dirt to ensure good adhesion.
- For knee walls without framing, mechanically fasten rigid insulation to the wall's surface.

### Preparation for Kneewall Insulation

Make whatever repairs and seal air leaks before installing the knee-wall insulation.

- ✓ Seal all large air leaks with structural materials.
- ✓ Seal all joints, penetrations, and other potential air leaks in the cavities with caulk or foam.
- ✓ Before installing caulk or spray foam insulation, clean dust and any other material that might interfere with the spray foam's adhesion.

### Air Sealing and Insulating under the Knee Wall

To seal and insulate under the knee wall, create an airtight and structurally strong seal in the joist spaces under the knee wall. Consider these options.

- Install sealed wood blocking between the floor joists covered with spray foam.
- Insert 2-inch-thick foam sheets and foam their perimeters with one-part or two-part foam.
- Insert a fiberglass batt into the cavity and foam its face with an inch of two-part closed-cell spray foam.


## 4.2.12 Access Doors in Vertical Walls


*SWS Detail: 4.1006.2 Access Doors and Hatches*

For kneewall access doors, observe the following.


- ✓ Insulate knee-wall access hatches and collar-beam access hatch with 3 or more inches of rigid-foam insulation. Or install a fiberglass batt stapled to the access door in such a way as to not compress the fiberglass batt.
- ✓ Weatherstrip the hatch and install a latch or other method to hold the access door closed against the weatherstrip.

**Insulated access door in knee wall:** Try to achieve at least R-13, or better.

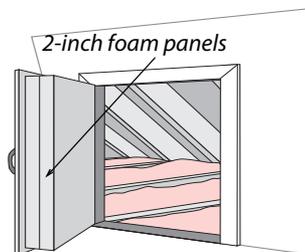

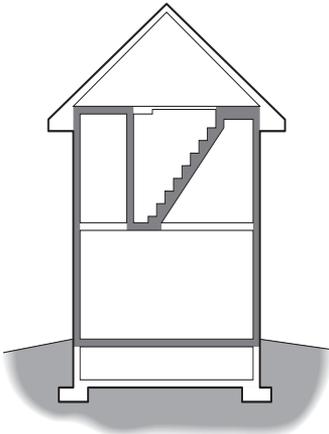

**Insulating and sealing attic stair walls, doors, and stairs:** Insulating and air sealing these is one way of establishing the thermal boundary.

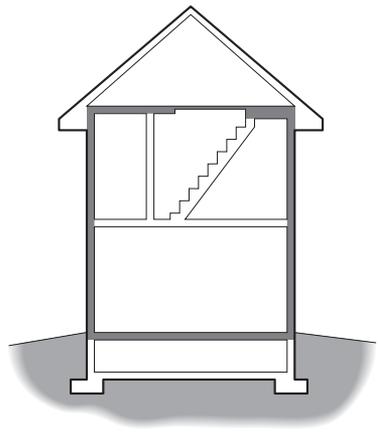

**Insulating and weatherstripping the attic hatch:** Air sealing around the hatch and insulating the hatch is an alternative method.



#### 4.2.13 Walk-Up Stairways and Doors

*SWS Detail: 4.1006.2 Access Doors and Hatches, 3.1002.1 Interior with Sloped Ceiling, 3.1002.3 Stairwell to Attic—Door at Top with Finished Ceiling Above, 3.1002.2 Stairwell to Attic—Door at Bottom with No Ceiling Above*

Think carefully about how to install a continuous insulation blanket and air barrier around or over the top of an attic stairway. If you enter the attic by a stairwell and standard vertical door, use these instructions.

- ✓ Blow dense-pack fibrous insulation into walls of the stairwell.
- ✓ Install a threshold or door sweep, and weatherstrip the door.
- ✓ Insulate or replace the door with an insulated door if cost effective.
- ✓ Blow dense-packed insulation into the sloping cavity beneath the stair treads and risers.

You can also establish the thermal boundary at the ceiling level, but this requires a horizontal hatch at the top of the stairs.


When planning to insulate stairwells, investigate barriers such as fire blocking that might prevent insulation from filling cavities you want to fill. Also consider what passageways may lead to areas you don't want to fill such as closets.

#### 4.2.14 Insulating & Sealing Pull-Down Attic Stairways

##### *SWS Detail: 4.1006.1 Pull-Down Stairs*

Pull-down attic stairways are sometimes installed above the access hatch. Building a foam-insulated box or buying a manufactured stair-and-hatchway cover are good solutions to insulating and sealing this weak point in the ceiling insulation. Install weatherstripping around the insulated box.

Educate the client on the purpose and operation of stair-and-hatchway cover, and ask them to carefully replace it when they access the attic.

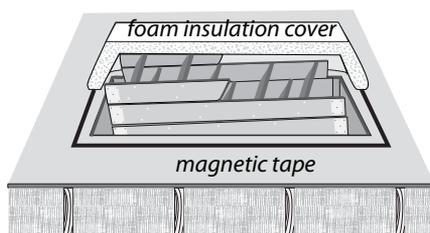

**Manufactured pull-down-stair covers:** Manufacturers provide insulated stair covers for use with walkable attic floors or with dams to be surrounded by fibrous insulation.

## 4.2.15 Parapet Walls

*SWS Details: 4.1088.4 Parapet Walls—Dense Pack, 4.1088.5 Parapet Walls—Spray Polyurethane Foam (SPF)*

Parapet walls are a continuation of exterior walls that rise above the roof. Parapet walls are often an air-leakage and thermal bridging problem because the insulation and air barrier aren't continuous between the exterior wall and roof.


Inspect the parapet area from both indoors and outdoors and decide how to connect the wall insulation and air barrier with the roof insulation and air barrier. Consider these two alternatives.

1. Install an air barrier and dense-pack the wall cavity of the parapet.
2. Spray foam the parapet to connect the insulation and air barrier of the exterior wall with attic or roof insulation and air barrier.

## 4.2.16 Skylights

*SWS Details: 4.1088.3 Skylights*

Skylights are places where the insulation and air barrier may not be continuous. Inspect the insulation and air barrier of the skylight shaft. Install insulation and air seals as necessary to make a continuous insulated and air-sealed assembly as shown in the illustration.

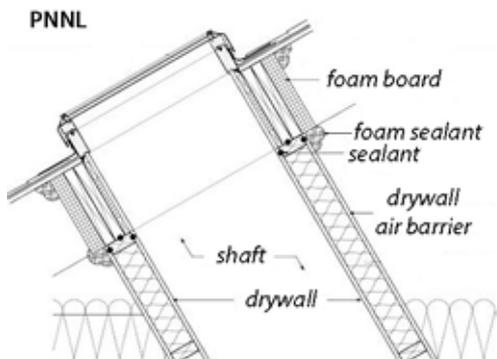

**Insulated and air sealed skylight:** The skylight shaft must be insulated and air sealed from the ceiling to the roof.

## 4.2.17 Whole-House Fans

### *SWS Detail: 4.1006.3 Whole-House Fan*

Whole-house fans can create significant thermal bridging if they aren't dammed and insulated thoroughly around their perimeter. Whole-house fans can leak a lot of air if they lack an airtight seasonal cover.



**Whole house fans:** The whole-house fan has a dam to allow the sides of its opening to be thoroughly insulated. The movable insulation is installed at the grille indoors.

- ✓ Build a foam panel as thick as practical and install it inside the whole-house fan's frame from indoors.
- ✓ Use clips or other restrainers to hold the panel in place.
- ✓ Install weatherstrip around the perimeter to limit air leakage.

### 4.3 SWS ALIGNMENT

<b>Field Guide Topic</b>	<b>SWS Detail</b>
Air-Sealing Attics and Roofs Pg. 133	
Sealing around Manufactured Chimneys Pg. 133	3.1001.1 Penetrations and Chases
Sealing around Fireplaces and Chimneys Pg. 134	3.1001.1 Penetrations and Chases
Air Sealing Recessed Lights Pg. 135	3.1003.5 Dropped Ceiling with Light Boxes and Fixtures, 3.1003.6 Dropped Soffits, 4.1001.1 Non-Insulation Contact (IC) Recessed Light
Sealing Stairways to Unconditioned Attics Pg. 138	3.1002.1 Interior with Sloped Ceiling, 3.1002.2 Stairwell to Attic—Door at Bottom with No Ceiling Above, 3.1002.3 Stairwell to Attic—Door at Top with Finished Ceiling Above
Sealing Porch Roof Structures Pg. 139	
Removing Insulation for Attic Air Sealing Pg. 140	

<b>Field Guide Topic</b>	<b>SWS Detail</b>
Sealing Joist Cavities Under Knee Walls Pg. 141	4.1004.1 Preparation for Dense Packing, 4.1004.2 Preparation for Batt Insulation
Sealing Kitchen or Bathroom Interior Soffits Pg. 141	3.1001.1 Penetrations and Chases, 3.1001.2 Chase Capping 3.1003.6 Dropped Soffits
Sealing Two-Level Attics Pg. 142	3.1001.3 Walls Open to Attic—Balloon Framing and Double Walls
Sealing Suspended Ceilings Pg. 143	3.1003.1 New Ceiling Below Original—Old Ceiling Intact or Repairable, 3.1003.2 Ceiling Leaks Not Repairable—No Air Barrier Above, 3.1003.4 3-D Walls, 3.1003.3 Above Closets and Tubs, 3.1003.5 Dropped Ceiling with Light Boxes and Fixtures
Insulating Attics and Roofs Pg. 145	
Preparing for Attic Insulation Pg. 146	4.1001.4 Vented Eave or Soffit Baffles 4.1001.1 Non-Insulation Contact (IC) Recessed Lights

<b>Field Guide Topic</b>	<b>SWS Detail</b>
Safety Preparations for Attic Insulation Pg. 148	4.1001.1 Non-Insulation Contact (IC) Recessed Light, 4.1006.3 Whole-House Fan 4.1005.2 Accessible Floors—Loose Fill Installation, 4.1005.3 Accessible Floors—Batt Insulation Over Existing Insulation, 4.1005.4 Accessible Floors—Loose Fill Over Existing Insulation 4.1001.2 Knob and Tube Wiring
Blowing Attic Insulation Pg. 151	4.1001.5 Dense Pack Preparation 4.1005.4 Accessible Floors—Loose Fill Over Existing Insulation, 4.1005.8 Loose Fill Over Existing Insulation on Accessible Attic Floors
Closed-Cavity Attic Floors Pg. 153	4.1003.4 Cape Cod Side Attic Roof—Dense Pack Installation 4.1005.6 Enclosed Attic Storage Platform Floor —Dense Pack Installation
Insulating Closed Roof Cavities Pg. 154	4.1002.1 Above Deck Roof Insulation—Preparation, 4.1002.2 Above Deck Roof Insulation—Installation, 4.1003.3 Unvented Flat Roof with Existing Insulation, 4.1001.5 Dense Pack Preparation
Exterior Rooftop Foam Insulation Pg. 157	

<b>Field Guide Topic</b>	<b>SWS Detail</b>
Installing Fiberglass Batts in Attics Pg. 158	4.1005.3 Accessible Floors—Batt Insulation Over Existing Insulation
Cathedralized Attics (Open Cavity) Pg. 159	4.1003.2 Pitched/Vaulted/Cathedralized Ceilings—Dense Pack Over, 4.1003.5 Unvented Roof Deck—Spray Polyurethane Foam Installation, 4.1001.7 Vented Roof Deck—Preparation for SPF, 4.1003.7 Ignition and Thermal Barriers—Spray Polyurethane Foam
Vaulted Attics Pg. 160	4.1003.1 Pitched/Vaulted/Cathedralized Ceilings—Loose Fill Over
Finished Knee Wall Attics Pg. 161	4.1004.1 Preparation for Dense Packing, 4.1005.1 Accessible Floors—Batt Installation
Access Doors in Vertical Walls Pg. 165	
Walk-Up Stairways and Doors Pg. 167	4.1006.2 Access Doors and Hatches, 3.1002.1 Interior with Sloped Ceiling, 3.1002.3 Stairwell to Attic—Door at Top with Finished Ceiling Above, 3.1002.2 Stairwell to Attic—Door at Bottom with No Ceiling Above
Insulating & Sealing Pull-Down Attic Stairways Pg. 168	4.1006.1 Pull-Down Stairs

<b>Field Guide Topic</b>	<b>SWS Detail</b>
Parapet Walls Pg. 169	4.1088.4 Parapet Walls—Dense Pack, 4.1088.5 Parapet Walls—Spray Polyurethane Foam (SPF)
Skylights Pg. 169	4.1088.3 Skylights
Whole-House Fans Pg. 170	4.1006.3 Whole-House Fan



## **CHAPTER 5: WALLS**

This chapter discusses air sealing and insulation for walls in existing buildings. Air sealing begins by inspecting the discontinuities in walls, such as the following.

- Inside and outside corners of walls.
- Openings for windows and doors.
- Protrusions and indentations in walls.

Insulation begins by evaluating the existing wall insulation and deciding on the cost-effectiveness of installing additional wall insulation. Other wall-insulation issues may include the following.

- Whether to insulate from interior or exterior of the home.
- How to open a wall cavity and restore it after insulating the wall cavity.
- How to install insulation to the wall's surface.

### **5.1 AIR SEALING WALLS**

Most wall air leakage involves the wall's discontinuities, joints, and irregularities.

#### **5.1.1 Built-In Cabinets/Shelves**

Built-in cabinets and shelves are a feature of older homes and present challenges for air sealing. Sealing these areas from inside the cabinet requires care and attention to appearances.

- ✓ If possible, establish both an air barrier and insulation behind the cabinet, out of sight of the occupants.
- ✓ Install drywall or wood wherever the cabinet is open to a wall cavity after insulating the cavity.

- ✓ Use caulking that is compatible with the colors of the surrounding wood if you seal its interior-facing side.

**Built-ins and other connected air leaks:** Built-in cabinets, a chimney chase, and recessed lights create a major air leakage problem in this living room.




## 5.1.2 Wall Framing Around Fireplaces and Chimneys

### *SWS Detail: 3.1001.1 Penetrations and Chases*

Leaks around fireplace chimneys are often severe air leaks. Use this procedure to seal air leaks through the chimney chase.

- ✓ Cut sheet metal to fit the gap that borders the chimney with overlaps connecting to nearby framing lumber.
- ✓ Bed the sheet metal air seal in sealant, and then fasten the sheet metal to the framing with staples, nails, or screws.
- ✓ Seal the metal patch to chimney or flue with a non-combustible sealant.
- ✓ For large chimney chases, cover the chase opening with structural material such as plywood. Maintain clearances between the structural seal and the metal or masonry chimney as listed in *“Clearances to Combustibles for Common Chimneys”* on page 304.

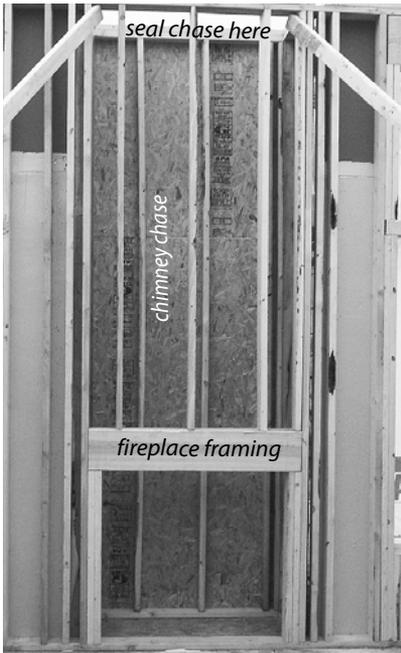

**Chimney chase:** Chimney chases can be multistory air-leak conduits if they're not sealed at floors and ceilings.


### 5.1.3 Pocket Door Cavities

#### *SWS Detail: 3.1201.4 Pocket Door*

When located on the second floor, cap the top of the entire wall cavity in the attic with rigid board, caulked and mechanically fastened.

### 5.1.4 Cooling Appliances Installed through Walls or Windows

Room air conditioners, room heat pumps, and evaporative coolers are sometimes installed through walls or in windows. The units installed in windows are often very leaky because of the temporary nature of the air seals.

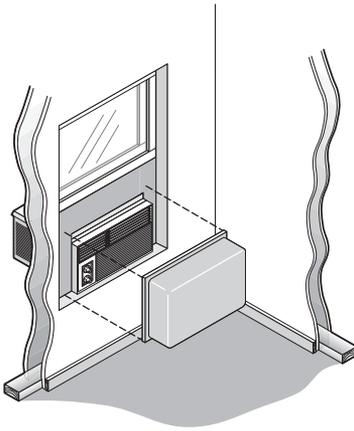

**Room-air-conditioner cover:** If you can't take the unit out for the winter, cover it with a room-air-conditioner cover.


- Remove window units in the fall and re-install in the spring.
- If the client doesn't want to remove the unit seasonally, cover the unit with a room-air-conditioner cover as shown here.
- Units installed through walls should have a sheet-metal sleeve that seals well to the surrounding framing and finish. This metal sleeve provides a smooth surface to seal to the room air conditioner or heat pump.
- Seal the unit's perimeter with one-part foam or caulking, depending on the width of the joint.

### 5.1.5 Balloon Framed Walls

*SWS Detail: 3.1001.3 Walls Open to Attic—Balloon Framing and Double Walls*

Balloon framed two-story walls are common in older homes. Some modern homes have balloon framed gable walls, where the studs rise above the level of the ceiling joists and are cut at an angle to frame the gable. Even when these balloon framed gable walls are full of insulation, air can convect through the insula-


tion. On occasion, windstorms have blown the insulation out of the wall cavity into the attic.

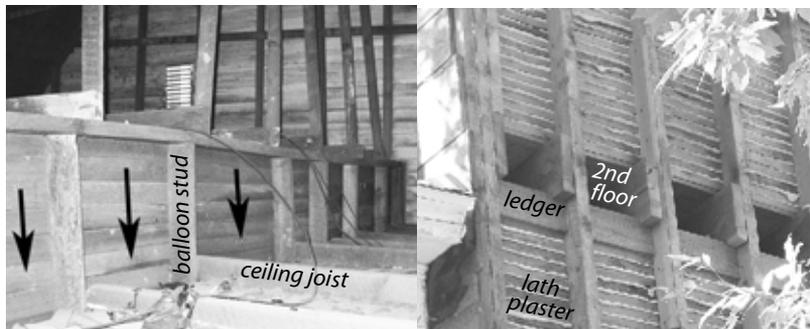

**Balloon framed walls:** Wall cavities, shown from outdoors at right and from the attic at left, are open to the floor cavity, the attic, and the crawl space.

- ✓ Dense-pack insulation into the wall cavities to reduce air leakage and convection.
- ✓ Dense-pack insulation into an air-permeable bag inserted with the fill tube into the balloon-wall floor cavity.
- ✓ Seal stud cavities from the attic, basement, or crawl space with a insulation plug, covered with a 2-part foam air seal.
- ✓ Or seal the tops and bottoms of cavities with a rigid barrier, such as drywall or plywood, sealed and bonded to surrounding materials 2-part foam.


*See also "Wall Insulation" on page 184.*

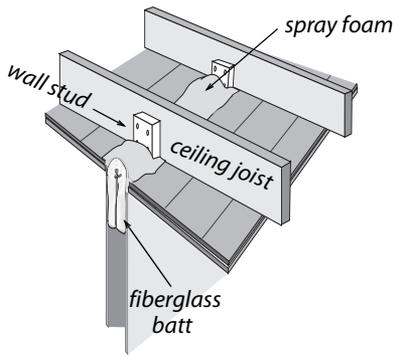

interior wall


### Balloon framed interior walls:

Fiberglass insulation covered by a 1-inch layer of two-part foam seals wall cavities.

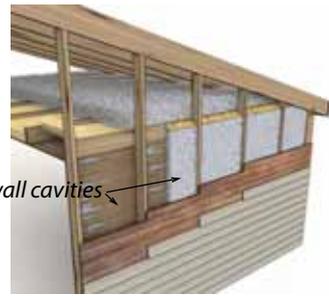

open wall cavities

**Balloon framed gable:** Studs extend above the ceiling allowing convection from the attic.

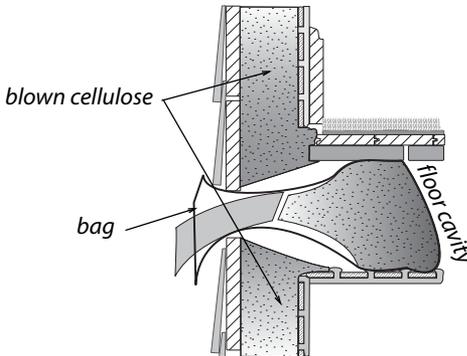

### Sealing wall-floor junction:

Blown insulation reduces convection through walls and floors. A bag helps contain and pack the blown insulation that extends into the floor cavity.


## 5.2 MINOR AIR SEALING

Minor air sealing includes sealing small openings with such materials as caulk or weather stripping.

### 5.2.1 Window and Door Frames

Sealing from the exterior serves to keep bulk water out and protect the building. If the crack is deeper than  $\frac{5}{16}$ -inch, it should be backed with a material such as backer rod and then sealed with caulk. Any existing loose or brittle material should be

removed before the crack is re-caulked. *See also "Windows and Doors" on page 225.*

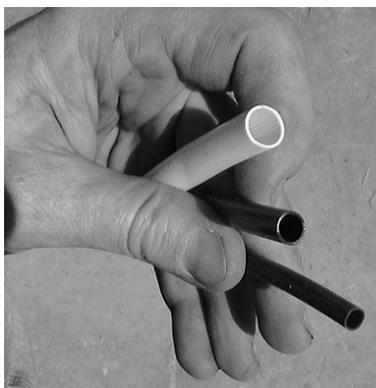

**Silicone bulb weatherstrip:** Silicone bulb has its own adhesive or is adhered to surfaces with silicone caulking.

## 5.2.2 Rim Joist Area



The rim joist area is composed of several joints. They can be sealed from the basement or crawl space with caulk or foam. Remove dust before applying sealant. *See also "Rim-Joist Insulation and Air-Sealing" on page 209.*

## 5.2.3 Masonry Surfaces

Masonry surfaces are best sealed with a cement-patching compound, mortar mix, or high quality caulking, such as polyurethane. For cement-based patches, buy a mix designed for patching and prime the damaged areas with a concrete adhesive.

## 5.2.4 Interior Wall Top Plates

Drywall is installed after interior walls are constructed. The top plates of interior walls are open to the attic. Top plate shrinkage opens up cracks that run the entire length of the interior wall. Move insulation and seal the cracks with caulking or two-part foam.

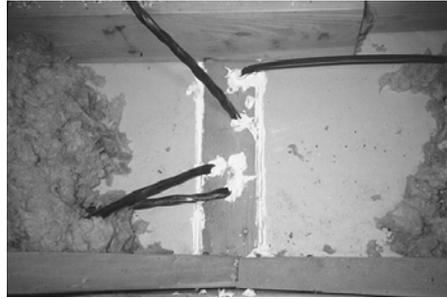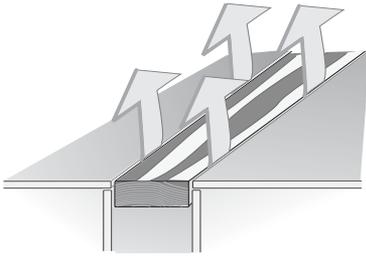

**Leaky top plates:** The cracks along top plates are from lumber shrinkage. They are small cracks but there are long lengths of them.

### 5.3 WALL INSULATION

Install wall-cavity insulation with a uniform coverage and density. Wall cavities encourage airflow like chimneys. Convection currents or air leakage can significantly reduce wall insulation's thermal performance if channels remain for air to migrate or convect.

#### Blown Wall-Insulation Types

Cellulose, fiberglass, and open-cell polyurethane foam are the leading insulation products for retrofit-installation into walls.

**Table 5-1: Wall Insulation Density and R-Value per Inch**

Insulation Material	Density	R-Value/in.
Fiberglass (virgin fiber)	2.2 pcf	4.1
Cellulose	3.5 pcf	3.4
Open-cell urethane foam	0.5 pcf	3.8
pcf = pounds per cubic foot		

## 5.3.1 Wall Insulation: Preparation and Follow-up

*SWS Detail: 4.1101.1 Exterior Wall Dense Packing, 4.1101.2 Exterior Wall Insulating Sheathing, 4.1101.3 Exterior Wall Spray Polyurethane Foam (SPF)—Masking and Surface Preparation, 4.1101.4 Exterior Wall Spray Polyurethane Foam (SPF)—Electrical System Considerations*

Inspect and repair walls thoroughly to avoid damaging the walls, blowing insulation into unwanted areas, or causing a dust hazard.

### Preparing for Wall Insulation

Before starting to blow insulation into walls, take the following preparatory steps.

- ✓ Calculate how many bags of insulation are needed to achieve the R-value specified on the bag's label.
- ✓ Inspect walls for evidence of moisture damage. If an inspection of the siding, sheathing, or interior wall finish shows a moisture problem, don't install sidewall insulation until the moisture problem is identified and solved.
- ✓ Inspect indoor surfaces of exterior walls to assure that they are strong enough to withstand the force of insulation blowing. Reinforce interior sheeting as necessary.
- ✓ Inspect for interior openings or cavities through which insulation may escape. Examples include balloon-framing openings in the attic or crawl space, pocket doors, unbacked cabinets, interior soffits, and openings around pipes under sinks, and closets. Seal these openings to prevent insulation from escaping the wall cavity.
- ✓ Verify that exterior wall cavities aren't used as return or supply ducts. Either avoid insulating these cavities, or remove the ducts and reinstall them somewhere else.

- ✓ Verify that electrical circuits inside the walls aren't overloaded. Maximum ampacity for 14-gauge copper wire is 15 amps and for 12-gauge copper wire is 20 amps. Install S-type fuses to prevent circuit overloading if necessary. Don't insulate cavities containing knob-and-tube wiring. *See "Electrical Safety" on page 42.*

**Balloon-framed gable wall insulation:** Spray foam plug or other rigid dam prevents insulation from escaping the wall cavity. The dam also prevents air circulation or wind washing through wall insulation.



## Patching and Finish after Insulating

The insulators, the home owner, and others should agree about the patching method and the final appearance of the wall finish. The insulators are usually responsible for patching holes and returning the interior or exterior finish to its previous condition or some pre-agreed level of finish.


- ✓ Patch the exterior wall sheathing with wood plugs, plastic plugs, or spray foam insulation.
- ✓ Use caulk or putty and primer to dress exposed exterior plugs.
- ✓ Seal gaps in external window trim and other areas that may admit rain water into the wall.
- ✓ Patch interior finish with standard plastering methods or a chair rail trim board.

- ✓ Install drywall with joint compound to open cavities to comply with IRC fire codes.

## Wall Insulation Quality Control

Retrofit wall insulation has more risk of incomplete application than insulation that you can visually inspect. Consider these quality control options to verify the proper coverage and density of retrofit wall insulation.

- Viewing the wall through an infrared camera.
- Looking through an electrical outlet or other access hole for insulation.
- Calculation of installed weight of installed insulation compared to wall-cavity volume and required density.

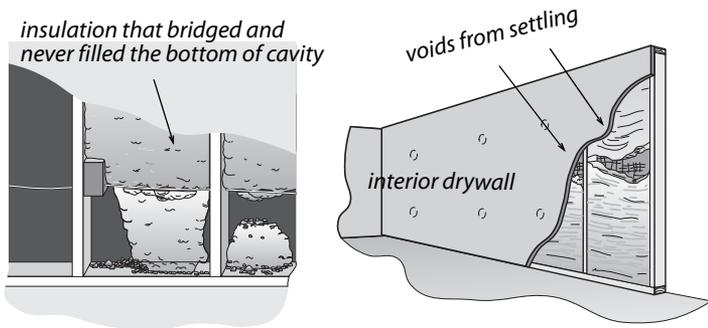

**Problems with low density insulation:** Blowing insulation through one or two small holes usually creates voids inside the wall cavity. This is because insulation won't reliably blow at an adequate density more than about one foot from the nozzle. Use tube-filling methods whenever possible, using a 1.5-inch hose inserted through a 2-inch or larger hole.

## Drilling Exterior Sheathing: Insulation Retrofit

Avoid drilling through siding. Where possible, carefully remove siding and drill through sheathing. This procedure avoids the potential lead-paint hazard of drilling the siding. Drilling through only the sheathing also makes it easier to insert flexible fill tubes since the holes pass through only one layer of material.


If you can't remove the siding, consider drilling the walls from inside the home. Obtain the owner's permission before drilling indoors, and practice lead-safe weatherization procedures. [See page 52.](#)

Consider these possible methods of removing siding.

- Cut completely through the paint on wood-siding joints with a sharp utility knife before carefully prying the siding off.
- Use a zip tool to remove metal or vinyl siding.
- Insulate homes with brick veneer or blind-nailed asbestos siding from the indoors.
- Use a decorative chair rail to cover holes drilled indoors.

Restore holes drilled for insulation to an appearance as close to original as possible, or in a manner that is satisfactory to the customer.

**Removing metal siding:** A zip tool separates joints in metal siding.

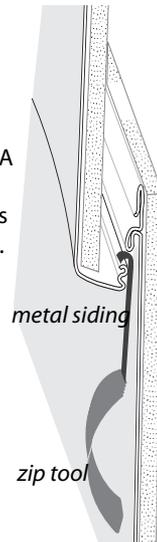

## 5.3.2 Retrofit Closed-Cavity Wall Insulation


*SWS Detail: 4.1103.1 Dense Pack Exterior Walls, 4.1103.2 Additional Exterior Wall Cavities*

This section describes six ways of installing wall insulation.

1. Blowing walls with fibrous insulation using a fill tube from indoors or outdoors.
2. Installing batts in an open wall cavity.
3. Injecting liquid foam into a closed wall cavity.
4. Spraying wet-spray fiberglass or cellulose into an open wall cavity.
5. Spray open-cell or closed-cell foam into an open wall cavity.
6. Blowing fibrous insulation behind netting.

### Blowing Walls with a Fill-Tube

Install dense-pack wall insulation using a blower equipped with separate controls for air and material feed. Mark the fill tube in one-foot intervals to help you verify when the tube reaches the top of the wall cavity.

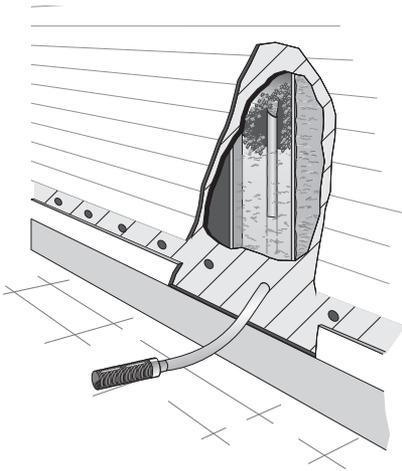

**Tube-filling walls:** This method can be accomplished from inside or outside the home. It is the preferred wall insulation method because it is a reliable way to achieve a uniform coverage and density.

To prevent settling, cellulose insulation must be blown to at least 3.5 pounds per cubic foot (pcf) density. Fiberglass dense-pack must be 2.2 pcf and the fiberglass material must be designed for dense-pack installation.


Insulate walls using this procedure.

1. Drill 2-to-3-inch diameter holes to access the stud cavity.
2. Probe all wall cavities through holes, before you fill them with the fill tube, to identify fire blocking, diagonal bracing, and other obstacles.
3. Start with several full-height, unobstructed wall cavities so you can measure the insulation density and calibrate the blower. An 8-foot cavity (2-by-4 on 16-inch centers) should consume a minimum of 10 pounds of cellulose or 6 pounds of fiberglass.
4. Insert the hose all the way to the top of the cavity. Start the machine, and back the hose out slowly as the cavity fills.

5. Then fill the bottom of the cavity in the same way.
6. After probing and filling, drill whatever additional holes are necessary for complete coverage. For example: above windows, missed areas with fire blocking.
7. Use the blower's remote control to achieve a dense pack near the hole while limiting spillage.
8. Seal and plug the holes, repair the weather barrier, and replace the siding.

### Insulating the Wall-Floor Junction of Balloon-Framed Walls

When insulating the perimeter of balloon-framed walls between the first and second floors, blow an insulation plug into the perimeter floor cavities for both thermal resistance and air-sealing. This insulation plug prevents the floor cavity from being a duct for air migration and leakage. Using a fill tube, blow the insulation into a air-permeable bag that expands inside the cavity. The bag limits the amount of insulation necessary to air-seal and insulate this area.

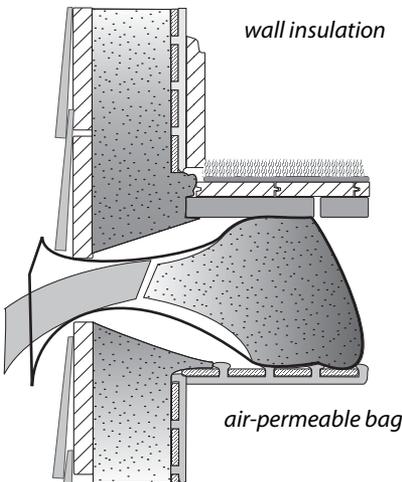

**Balloon framing:** Floor cavities are usually connected to wall cavities. Blow a plug of insulation into the floor cavity to seal this leaky uninsulated area.

## Injecting Liquid Foam

Injecting liquid foam is more expensive than blowing fibrous insulation but offers better performance when existing walls are partially filled by batts. The batts are often 1-to-2 inches thick and are usually flush with the interior drywall or plaster. Try injecting the foam from outdoors to fill the cavity and compress the batt slightly. From indoors, the foam may just stretch the batt facing and fail to create a fully insulated wall cavity.


Open-cell polyurethane foam, formulated to expand less than the sprayed variety, is the leading wall-retrofit foam. Technicians install the foam through holes (<1 inch) spaced about two feet apart using a simple nozzle that barely enters the cavity. Technicians use drinking straws or other indicators to judge the level that the foam has filled during installation. Technicians don't normally use fill tubes to inject open-cell foam because the tube would be too difficult to clean.

*See “Fire Protection for Foam Insulation” on page 124.*

### 5.3.3 Open-Cavity Wall Insulation

*SWS Details: 4.1102.1 Open Wall Insulation—General, 4.1102.2 Open Wall—Spray Polyurethane Foam (SPF) Installation*

Fiberglass batts are the most common open-cavity wall insulation. Batts achieve their rated R-value only when installed carefully. If there are gaps between the cavity and batt at the top and bottom, the R-value can be reduced by as much as 30 percent. The batt should fill the entire cavity without spaces in corners or edges.

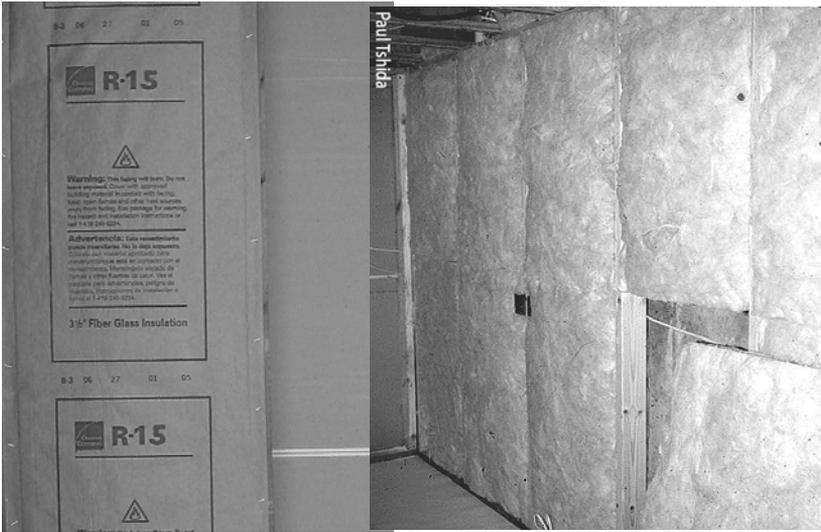


**R-15 fiberglass batts:** Install R-15 batts in open walls and attach them to the face of the stud as shown above. Or install unfaced batts as shown below. Either way, cut the batts accurately and install them carefully.

- ✓ Use unfaced friction-fit batt insulation where possible. Fluff the batts during installation to fill the depth of the wall cavity.
- ✓ Choose medium- or high-density batts: R-13 or R-15 rather than R-11, and R-21 rather than R-19.
- ✓ Seal all significant cracks and gaps in the wall structure before or after you install the insulation.
- ✓ Insulate behind and around obstacles with scrap pieces of batt before installing batts.
- ✓ Staple faced insulation to outside face of studs on the warm side of the cavity. Don't staple the facing to the side of the studs, even though drywallers may prefer that method, because this method leaves an air space that encourages convection currents.
- ✓ Cut batt insulation to the exact length of the cavity. A too-short batt creates air spaces above and beneath the batt,

allowing convection. A too-long batt bunches and folds, creating air pockets.

- ✓ Split batt around wiring, rather than letting the wiring compress the batt to one side of the cavity.
- ✓ Fiberglass insulation, exposed to the interior living space, must be covered with minimum half-inch drywall or other material that has an ASTM flame spread rating of 25 or less.
- ✓ Fiberglass batts exposed to unoccupied spaces like attics must be covered with an air barrier such as house wrap or foam sheeting to prevent R-value degradation by convection and human exposure to fibers.

See *“Fiberglass Batts and Blankets”* on page 117.

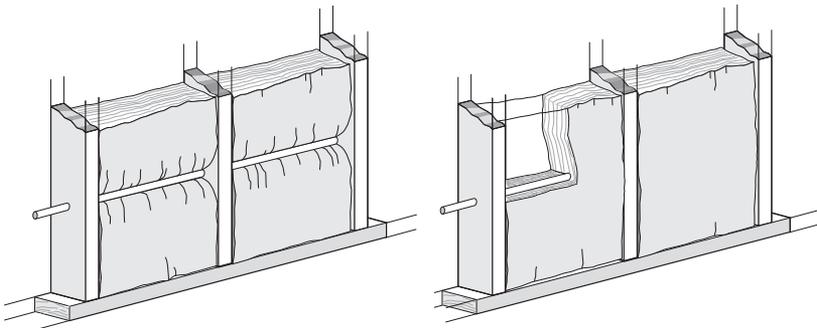

**Fiberglass batts, compressed by a cable:**

This reduces the wall's R-value by creating a void between the insulation and interior wallboard.

**Batt, split around a cable:** The batt attains its rated R-value.

## Sprayed Open-Cavity Wall Insulation

Both fibrous and foam insulation can be sprayed into open wall cavities. Varieties include the following.

- Fiberglass or cellulose mixed with water and glue at a special nozzle sprayed into the open wall cavity with the excess shaved off (fibrous damp-spray insulation).



**Spraying open-cell foam:** The sprayed open-cell foam is left short of filling the cavity or else shaved off.

- Open-cell or closed-cell polyurethane foam sprayed into an open wall cavity and either held short of filling the whole cavity or with the excess foam shaved off after it cures.

### Blowing Open Wall Cavities behind Netting or Fabric

Blowing dry fibrous insulation behind netting or fabric is a common way of insulating open walls before drywall application, especially with cellulose. However, you must install the insulation to a sufficient density to resist settling.

- ✓ Verify density of at least 3.5 pcf for cellulose or 2.2pcf for fiberglass.
- ✓ Select a restrainer netting or fabric that will allow the above densities without bulging excessively.
- ✓ Fasten the netting or fabric with power-driven staples, 1.5 inches apart.
- ✓ Roll bulging insulation with a roller to facilitate drywall installation.

## 5.3.4 Insulated Wall Sheathing

### *SWS Detail: 4.1103.3 Insulated Sheathing and Insulated Siding Installation*

Insulated wall sheathing covers the wall surface with insulation, reducing thermal bridging through structural framing. Insulated sheathing is an excellent retrofit, when you replace the siding and windows.

Insulating wall sheathing is usually foam board, such as polystyrene or polyisocyanurate. Always fill the wall cavity with insulation before installing insulated sheathing.

#### Fastening Insulating Sheathing

Fastening the insulating sheathing requires one of the following to secure the insulation to the wood sheathing or masonry under it.

- A batten board
- An embedded strip
- A broad staple
- A long screw with a large washer
- A special adhesive (masonry)

Use appropriate fasteners for wood or masonry materials. Wood battens or embedded strips allow attachment of a variety of siding materials. The embedded strips work best with steel, aluminum, or vinyl siding, which are lightweight and drain water through weep holes in every unit of siding.



**Foam sheathing with battens:** One-by-four battens are applied to 4 inches of foam board on the exterior provide a fastening strip for siding and trim.

**Foam with embedded strips:** Strips of plywood or OSB are spaced on 16 or 24 inch centers at the factory. Wide corner pieces can be added on the job with foam cutting and grooving tools.



### 5.3.5 Wall Insulation in a Retrofitted Frame Wall

Retrofitters, seeking superior energy performance, sometimes build a wood-frame wall attached to the interior or exterior of the existing wall. Common insulation choices include all the wall-insulation choices discussed previously. Vapor retarders and air barriers must be incorporated into the new wall assembly as appropriate for the climate and existing wall characteristics. The exterior side of a retrofitted insulated frame should have sheathing and a water resistive barrier like house wrap.



**Frame wall for insulation:**

Technicians fastened a frame wall with brackets that place the wall away from the existing exterior wall by a half inch so that the sprayed foam can flow behind the studs and plates to reduce thermal bridging.



**Open-cell polyurethane foam:** The foam was sprayed into the cavities and the excess shaved off. New sheathing, house wrap, siding, and windows follow later.

### 5.3.6 Insulating Unreinforced Brick Walls

#### *SWS Detail: 4.1103.3 Insulated Sheathing and Insulated Siding Installation*

Unreinforced means that the builders used no steel or other metal reinforcement. There are three types of unreinforced brick walls.

1. Traditional brick walls with header bricks that hold two layers of stretcher bricks together. Larger buildings may have three or more brick layers instead of two.
2. Various types of hollow brick walls with usually one layer of brick on either side of an air space.
3. Wood-frame brick veneer walls with a single layer of brick veneer that is attached to a typical wood frame wall.

All three of these brick assemblies may have structural problems depending on the condition of the bricks and mortar joints.

Mortar can turn to dust over the decades; hollow brick walls can be frighteningly fragile; and small movements can topple 100-year-old brick veneer. **Consult a structural engineer before making any modification to an unreinforced brick building.**



**Hollow brick wall:** Two separate single brick walls are held together by wood lath embedded in the mortar joint.

## 5.4 SWS ALIGNMENT

Field Guide Topic	SWS Detail
Air Sealing Walls Pg. 177	
Built-In Cabinets/Shelves Pg. 177	
Wall Framing Around Fireplaces and Chimneys Pg. 178	3.1001.1 Penetrations and Chases
Pocket Door Cavities Pg. 179	3.1201.4 Pocket Door
Cooling Appliances Installed through Walls or Windows Pg. 179	
Balloon Framed Walls Pg. 180	3.1001.3 Walls Open to Attic—Balloon Framing and Double Walls
Minor Air Sealing Pg. 182	

<b>Field Guide Topic</b>	<b>SWS Detail</b>
Window and Door Frames Pg. 182	
Rim Joist Area Pg. 183	
Masonry Surfaces Pg. 183	
Interior Wall Top Plates Pg. 183	
Wall Insulation Pg. 184	
Wall Insulation: Preparation and Follow-up Pg. 185	4.1101.1 Exterior Wall Dense Packing, 4.1101.2 Exterior Wall Insulating Sheathing, 4.1101.3 Exterior Wall Spray Polyurethane Foam (SPF)—Masking and Surface Preparation, 4.1101.4 Exterior Wall Spray Polyurethane Foam (SPF)—Electrical System Considerations
Retrofit Closed-Cavity Wall Insulation Pg. 189	4.1103.1 Dense Pack Exterior Walls, 4.1103.2 Additional Exterior Wall Cavities
Open-Cavity Wall Insulation Pg. 192	4.1102.1 Open Wall Insulation—General, 4.1102.2 Open Wall—Spray Polyurethane Foam (SPF) Installation
Insulated Wall Sheathing Pg. 196	4.1103.3 Insulated Sheathing and Insulated Siding Installation
Wall Insulation in a Retrofitted Frame Wall Pg. 197	
Insulating Unreinforced Brick Walls Pg. 198	4.1103.3 Insulated Sheathing and Insulated Siding Installation

## CHAPTER 6: FLOORS AND FOUNDATIONS

The importance of defining the thermal boundary at the building's lower reaches depends on how much of the building's heat loss is moving through the foundation or floor. The building's thermal boundary may not be obvious because of the lack of insulation at both the floor and the foundation. The building owner and energy auditor must choose where to insulate and air seal if these ECMs are cost-effective.

Either the first floor or the foundation wall is the thermal boundary. After choosing, air seal and insulate the chosen thermal boundary.


### 6.1 THERMAL-BOUNDARY DECISIONS: FLOOR OR FOUNDATION

The results of air-barrier tests can help in selecting the thermal boundary's location. *See "Air Leakage Diagnostics" on page 469.*

Moisture problems, the location of heating and cooling equipment, and the necessity of crawl-space venting are other important considerations.

#### House-to-crawl-space pressure:

Many homes with crawl spaces have an ambiguous thermal boundary at the foundation. Is the air barrier at the floor or foundation wall? Answer: in this case, each forms an equal part of the home's air barrier.

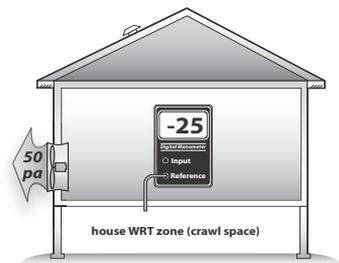

The tables presented next summarize the decision factors for choosing between the floor and the foundation wall as the air barrier. You may also encounter situations that aren't addressed here.

When a home has a basement and crawl space connected, both [Table 6-1 on page 202](#) and [Table 6-2 on page 203](#) are relevant to the decision-making process of selecting the air barrier and site for insulation, if insulation is cost-effective. A basement may even be divided from its adjoining crawl space to enclose the basement within the thermal boundary and to place the crawl space outside the thermal boundary.

**Table 6-1: Crawl Space: Where Is the Thermal boundary?**

<b>Factors favoring foundation wall</b>	<b>Factors favoring floor</b>
Ground moisture barrier and good perimeter drainage present or planned	Damp crawl space with no improvement offered by weatherization
Foundation walls test tighter than floor	Floor air-sealing and insulation are reasonable options, considering access and obstacles
Vents can be closed off	Floor tests tighter than foundation walls
Furnace, ducts, and water pipes located in crawl space	No furnace or ducts present
Concrete or concrete block walls are easily insulated	Building code or code official forbids closing vents
Floor air-sealing and insulation would be more difficult than sealing and insulating the foundation	Rubble masonry foundation wall
Foundation wall is insulated	Floor is already insulated

**Table 6-2: Unoccupied Basement: Where Is the Thermal Boundary?**

<b>Favors foundation wall</b>	<b>Favors floor</b>
Ground drainage and no existing moisture problems	Damp basement with no solution during weatherization
Interior stairway between house and basement	Floor air-sealing and insulation is a reasonable option, considering access and obstacles
Ducts and furnace in basement	No furnace or ducts present
Foundation walls test tighter than the floor	Floor tests tighter than foundation walls
Basement may be occupied some day	Exterior entrance and stairway only
Laundry in basement	Rubble masonry foundation walls
Floor air-sealing and insulation would be very difficult	Dirt floor or deteriorating concrete floor
Concrete floor	Badly cracked foundation walls

## 6.2 AIR SEALING FOUNDATIONS AND FLOORS

The floor and foundation are complex structures that can be difficult to air seal. This section describes the most problematic air leakage location in the floor and foundation, and how to seal them.

### 6.2.1 Plumbing Penetrations

*SWS Detail: 3.1001.1 Penetrations and Chases, 3.1001.2 Chase Capping*

Seal gaps with expanding foam or caulk. If the gap is too large, stuff it with fiberglass insulation, and spray foam over the top to seal the surface of the plug.

- ✓ Fit large openings with a rigid patch bedded in a sealant like latex caulk or foam tape, which isn't an adhesive.
- ✓ Screw the patch in place, so that a plumber can remove the screws if necessary for access.
- ✓ Seal holes and gaps around pipes with expanding foam or caulk.



**Sealing large plumbing penetrations:** Bed drywall or wood sheathing in sealant and fasten with nails or screws. Fill gaps around the penetrations with one-part foam to complete this airtight seal.

## 6.2.2 Stairways to Unconditioned Areas

*SWS Detail: 3.1002.1 Interior with Sloped Ceiling, 3.1002.2 Stairwell to Attic—Door at Bottom with No Ceiling Above, 3.1002.3 Stairwell to Attic—Door at Top with Finished Ceiling Above*

A variety of stairways and hatchways provide access from the building to an unconditioned basement.

The following components of these stairways may need air sealing and insulation depending on whether they are at the thermal boundary.

- The risers and treads of the stairways
- The surrounding triangular walls
- Vertical or horizontal doors or hatches


- The framing and sheeting surrounding the doors or hatches
- Sloping ceilings above the stairways

Consider the following air-sealing measures.


- ✓ Study the geometry of the stairway and decide where to establish the air barrier and install the insulation.
- ✓ Weatherstrip around doors and hatches if the door or hatch is at the thermal boundary.
- ✓ Seal the walls, stair-stringer space, and ceiling if they are at the thermal boundary.
- ✓ Seal gaps around door frame or hatch frame perimeters with one-part foam, two-part foam, or caulking.



**Unfinished stairways:** Unfinished spaces underneath stairs create major air leakage pathways between floors and between the attic and crawl space or basement.

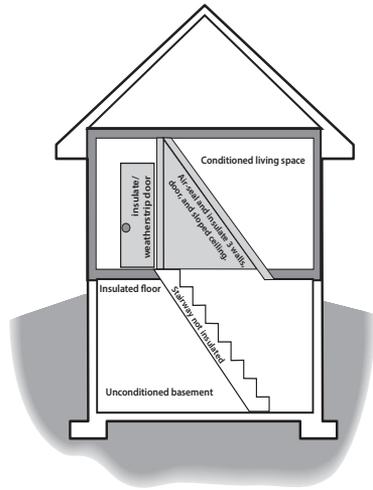

**Stairways at the thermal boundary:** The stairway may be within the thermal boundary or outside it. Only walls, ceilings, doors, and hatches at the thermal boundary require thorough air sealing. The door as shown is open.

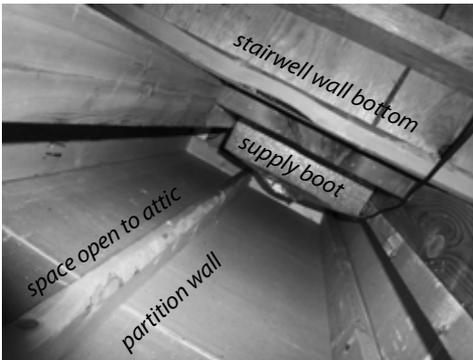


**Stairway wall within the thermal boundary:** Double wall forming the stairwell connects an unfinished area under the basement stairs with the living spaces, attic, and the space behind the finished basement walls.

## 6.2.3 Incomplete Finished Basements

Discontinuous wall segments can allow heated basement air to circumvent the finished and insulated wall, carrying heat with it. Complete the finished walls or at least install air barriers between finished living area and unconditioned area between the insulated wall and the foundation wall. Here are two suggestions.

- ✓ Bridge the gap with wood sheeting, bedded in sealant, and caulk the crack around four sides of this long narrow patch.
- ✓ Stuff the gap with pieces of fiberglass batt and spray two-part foam over the gap, at least an inch thick

*See also "Basement Insulation" on page 217.*

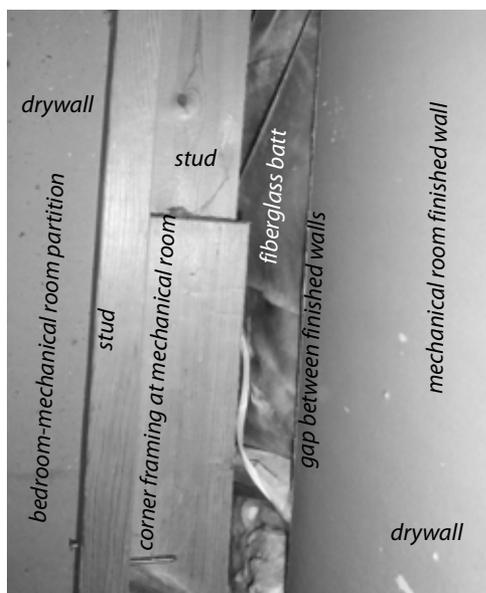


**Large air leak in finished basement walls:** Two finished basement walls meet inside a mechanical room and form a 2-inch gap from floor to ceiling connecting the finished basement with the space behind its finished walls.

## 6.2.4 Cantilevered Floors

Floors that hang over their lower story are called cantilevered floors. The underside of the overhanging floor can leak consid-

erably. Many balconies and bay windows have cantilevered floors that leak air into a building's floor cavity.

**Cantilevered floors under construction:** Cantilevered floors allow air leakage into floor cavities because of the lack of sealant and dense-packed insulation.

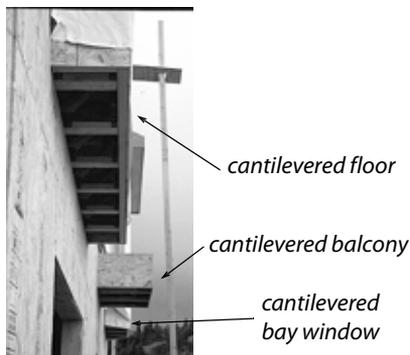

- ✓ Remove a piece of soffit under the overhanging floor to determine the condition of insulation and air barrier.
- ✓ Stuff the overhanging floor with fiberglass batts or blown fibrous insulation.
- ✓ Bed the sheeting underneath the overhanging floor in sealant where possible. Caulk joints and seams where the sheeting isn't bedded in sealant.
- ✓ Seal any ducts you find in the cantilevered floor sections.

*See also "Installing Floor Insulation" on page 210.*

## 6.3 PREPARING FOR FOUNDATION OR FLOOR INSULATION

*SWS Detail: 4.1402.2 Basement Wall Insulation—No Groundwater Leakage, 4.1402.3 Basement Wall Insulation—Groundwater Leakage*

Floor and foundation insulation can increase the likelihood of moisture problems. Installers should take all necessary steps to prevent moisture problems from ground moisture before installing insulation.


## 6.3.1 Rim-Joist Insulation and Air-Sealing

### *SWS Detail: 4.1401.1 Band/Rim Joists—Spray Polyurethane Foam (SPF) Installation*

The rim-joint spaces at the perimeter of the floor are a major weak point in the air barrier and insulation. Insulating and air sealing both the rim joist and longitudinal box joist are appropriate either as individual procedures or as part of floor or foundation insulation.

Air seal stud cavities in balloon-framed homes as a part of insulating the rim joist. Air seal other penetrations through the rim before insulating. Two-part spray foam is the most versatile air sealing and insulation system for the rim joist because spray foam air seals and insulates in one step. If you leave the spray foam exposed, it should have a flame spread of 25 or less and be no more than 3.25 inches thick according to the IRC.

Polystyrene or polyurethane rigid board insulation are also good for insulating and air sealing the rim joist area. When the rim joist runs parallel to the foundation wall, the cavity may be air sealed and insulated with methods similar to those as shown here.

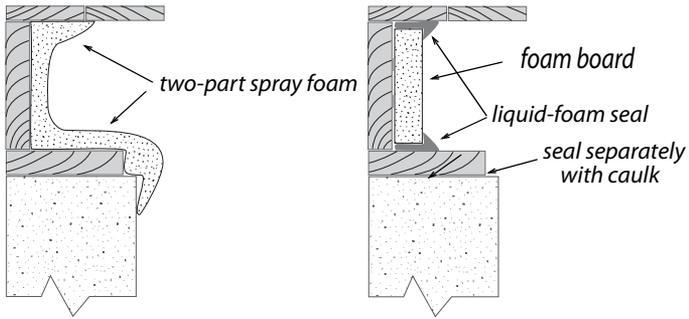

**Foam-insulated rim joists:** Installing foam insulation is the best way to insulate and air seal the rim joist.

**Foam-insulated rim joists:** Here 4 inches of EPS foam is sealed around its perimeter with one-part foam.



Don't use fiberglass batts to insulate between rim joists because air can move around the fiberglass, causing condensation and encouraging mold on the cold rim joist. If you use foam to insulate between the rim joists, use liquid foam sealant to seal around the edges of the rigid foam.

## 6.3.2 Installing Floor Insulation

*SWS Details: 4.1301.1 Standard Floor System—Batt Installation, 4.1301.2 Standard Floor System—Loose Fill with Netting, 4.1301.3 Standard Floor System—Loose Fill with Rigid Barrier, 4.1301.4 Dense Pack Floor System with Rigid Barrier, 4.1301.7 Pier Construction Subfloor Insulation—Loose Fill with Rigid Barrier, 4.1301.8 Pier Construction Subfloor Installation—Dense Pack with Rigid Barrier, 4.1301.9 Open Floors Over Unconditioned Space and Cantilevered Floors, Floors Over Garages, Floors Over Unconditioned Crawl Spaces—Spray Polyurethane*

The best way to insulate a floor cavity is to completely fill each joist cavity with fiberglass insulation. Blowing fiberglass insulation is the easiest way to achieve complete coverage because the blown fiberglass is able to surround obstructions and penetrations better than fiberglass batts. Avoid blown cellulose because of its weight, moisture absorption, and tendency to settle.

Before installing fiberglass floor insulation, make the following preparations.


- ✓ Seal air leaks in the floor from the living space or the crawl space or basement as opportunity allows.
- ✓ Seal and insulate ducts remaining in the crawl space or unconditioned basement.
- ✓ Identify electrical junction boxes, plumbing valves and drains before insulating and provide access to them.
- ✓ Insulate water lines in cold climates if they protrude below the insulation.

### Blowing Floor Insulation


Many installers prefer to blow fiberglass insulation into the floor, rather than installing batts, to insulate more easily and effectively around obstacles. Cellulose is not recommended for blowing floors because of concerns about settling and moisture. Observe these specifications for blown-in floor insulation.

- ✓ Cover the entire under-floor surface with a vapor permeable supporting material such as: dust-free fabric insulation restraint or equivalent vapor-permeable and drainable material.
- ✓ Use wood strips to support the flexible or semi-flexible support material unless that material with its fasteners can support the floor insulation without sagging.

**Blown floor insulation:** This method works particularly well with floor trusses.

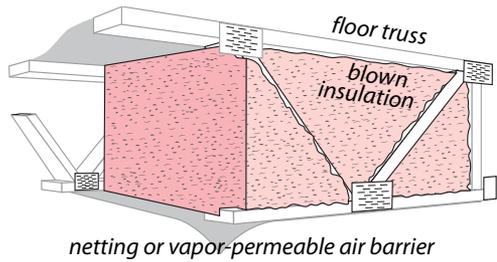

- ✓ Install rock wool or fiberglass blowing wool through V-shaped holes in the air barrier.
- ✓ Use a fill tube for installing the blown insulation. Insulation must travel no more than 12 inches from the end of the fill tube.
- ✓ Seal all penetrations in the air barrier with a tape, approved for sealing seams in the air-barrier material.

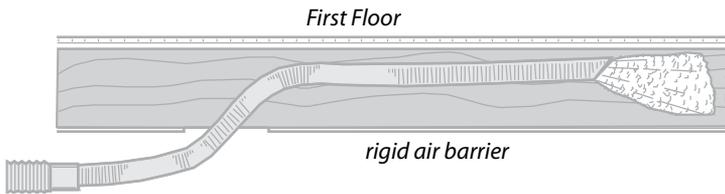

**Blowing floor cavity:** Uninsulated floor cavities can be blown with fiberglass or rock wool insulation, using a fill tube.

### 6.3.3 Installing Fiberglass Batt Floor Insulation

*SWS Detail: 4.1301.1 Standard Floor System—Batt Installation, 4.1301.5 Cantilevered Floor—Batt Installation, 4.1301.6 Pier Construction Subfloor Insulation—Batt Installation with Rigid Barrier*

Observe these material specifications for insulating under floors.

- ✓ Seal all significant air leaks through the floor before insulating the floor, using strong airtight materials.

- ✓ Choose unfaced batts for insulating floors.
- ✓ Install batts in continuous contact with the subfloor.
- ✓ Batt thickness must fill the complete depth of each cavity.
- ✓ Batt thickness must fill the complete depth of each cavity.
- ✓ Batts must be neatly installed, fitting tightly together at joints, fitting closely around obstructions, and filling all the space within the floor cavity.
- ✓ Crawl-space access doors, adjacent to a conditioned space, must be insulated to at least R-21 for horizontal openings and to at least R-15 for vertical openings.
- ✓ Crawl-space access doors must be effectively weather-stripped.

### Installation Specifications for Batts in Floor Cavities


Batt insulation, installed in floors, must be supported by twine, wire, wood lath or other suitable material that keeps the insulation touching the floor. Friction-fit fiberglass batts supported by self-supporting wire insulation supports aren't good practice. Fasteners for floor insulation must resist gravity, the weight of insulation, and moisture condensation.

Use one of the following restrainer materials to keep the fiberglass batts in the floor cavity.

- Install standard wood lath ( $1/4$  inch by 1 inch) or nominal one-inch lumber. Install the lath or lumber perpendicular to joists 12 inches apart for joists on 24-inch centers and 18 inches apart for joists on 16-inch centers.
- Install non-stretching polypropylene or polyester twine.
- Install copper or stainless steel wire with a minimum diameter of 0.04 inches or size 18 AWG.
- Install a rigid vapor-permeable air barrier, such as plywood.

Observe these requirements about installation and fasteners for the restrainers.

- Fasten lath or a rigid barrier with screws, nails, or power-driven staples. The fastener should penetrate the joist  $\frac{3}{4}$  inch or more.
- Install twine or wire in a zig-zag pattern.
- Install power-driven staples over the twine or wire 12 inches apart for joists on 24-inch centers and 18 inches apart for joists on 16-inch centers. The staples must penetrate the wood joists by at least  $\frac{5}{8}$  inch. Don't hand staple the restrainer.

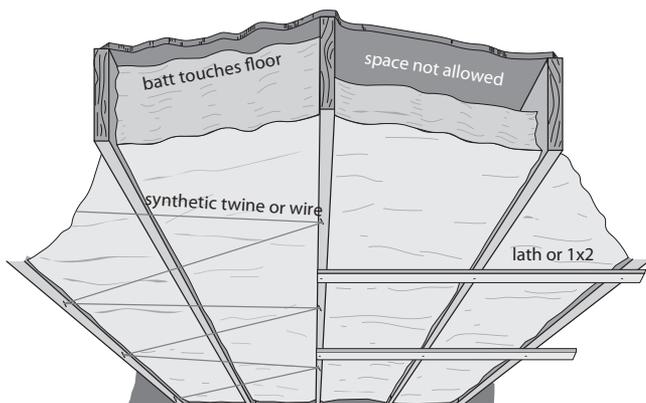

**Floor insulating with batts:** Use unfaced fiberglass batts, installed flush to the floor bottom, to insulate floors. The batt should fill the whole cavity if it is supported by lath or plastic twine underneath.

### 6.3.4 Crawl-Space Wall Insulation

*SWS Detail: 4.1402.2 Basement Wall Insulation—No Groundwater Leakage, 4.1402.3 Basement Wall Insulation—Groundwater Leakage, 4.1402.1 Closed Crawl Spaces —Wall Insulation, 3.1402.2 Closed Crawl Spaces —Air Sealing Foundation Vents*

Crawl-space foundation insulation is only worthwhile if you can seal the existing foundation vents. *See "Power-Ventilated Crawl Spaces" on page 397.*

## Materials for Crawl-Space Insulation

Retrofit foundation insulation is usually installed on the inside of the foundation walls. Exterior insulation is common in new construction because it is more effective than interior insulation at keeping the foundation warm and dry.

- Fiberglass blankets can be a good insulation choice for very dry crawl spaces. However, the fiberglass facing is a vapor barrier like vinyl or foil facing can trap moisture in the insulation.
- Extruded or expanded polystyrene insulations are the best insulation products for the interior of flat concrete or concrete-block walls. Foam sheets are good air barriers and have excellent moisture resistance.
- For rubble masonry walls, use two-part spray foam.

Consider the following issues when insulating foundation walls.


- ✓ If an open-combustion appliance is located in a crawl space, take precautions to assure that outdoor combustion air is available to the appliance.
- ✓ When insulating crawl-space walls, consult the local building inspector about ventilation options.
- ✓ Outside access hatches should be securely attached to foundation walls. If the foundation walls are insulated, also insulate any crawl-space access hatch with foam to the R-value of the foundation wall. Use treated wood for access doors that contact the ground.
- ✓ In regions affected by termites, carpenter ants, and similar insects, consult with experts to ensure that the insulation, air sealing materials, and moisture barrier don't provide a conduit for insects to infest the wood floor.

Insulating the foundation walls instead of the floor usually leaves a large uninsulated area of the home's thermal boundary — the ground in the crawl space.

## Crawl-Space-Wall Insulation Materials Compared

Crawl-space foundation insulation is rather complex from the perspective of materials. Foam insulation has special fire considerations. Faced fiberglass can trap moisture. Sprayed fiberglass can be damaged by moisture and mechanical abrasion. Any of the options can harbor termites. Consider the following suggestions about crawl-space foundation insulation materials.

**Foam-insulated foundation wall:** A 20-gauge galvanized-steel termite shield and a 10 mil ground moisture barrier protect the wood floor against termites and other pests.

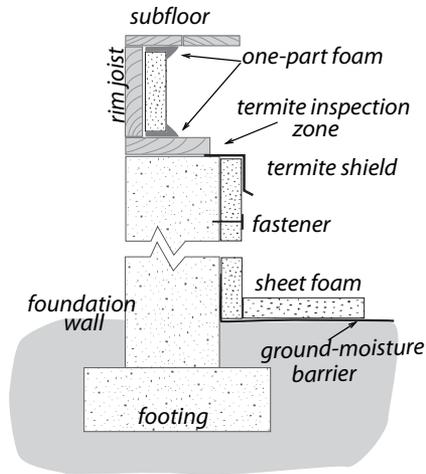

Attach insulation firmly to the foundation wall's surface with masonry fasteners and/or adhesive. Install insulation with no significant voids or edge gaps.

- Sprayed closed-cell polyurethane foam is available in at least two varieties according to flame spread: 25 and 75. Use the flame-spread-25 variety of foam if you want to avoid using an ignition barrier.
- Some building inspectors allow plastic foam insulation to be installed uncovered in crawl spaces, and some building inspectors require it to be covered by a ignition barrier.

**Spray-foam-insulated foundation wall:** Where termites aren't a threat, installers spray foam from the bottom of the foundation wall up to the top of the rim joist. If termites are a threat, leave a 2-inch inspection gap.



- When an ignition barrier is required, foam insulation must be protected by 1½ inch thick of fiberglass insulation or a sprayed latex ignition barrier.
- FSK (foil-scrim-kraft) or vinyl-faced fiberglass insulation is often used to insulate foundation walls on the interior surface. Both of these facings are vapor barriers and can trap moisture inside the insulation.
- Cover basement foundation insulation with a material that has an ASTM flame spread rating of 25 or less, such as half-inch drywall. FSK fiberglass usually requires no ignition barrier.

### 6.3.5 Basement Insulation

*SWS Detail: 4.1402.2 Basement Wall Insulation—No Groundwater Leakage, 4.1402.3 Basement Wall Insulation—Groundwater Leakage*

Basement wall is often installed poorly because of the installers' incomplete understanding about moisture problems.

**Frame-wall method:** This method can be acceptable with meticulous air sealing to prevent basement air from circulating behind the wall. Exterior water drainage must be effective to prevent moisture problems in the basement.



## Frame-Wall Insulation

The most common (although not the best) way to insulate basement walls, or any masonry wall, is to build a framed wall against the masonry wall and fill the wall with fiberglass batts. The frame wall is then covered with drywall.


Unfaced batts are the best choice of fiberglass insulation since they contain no vapor barrier to trap moisture. Moisture may escape from the wall in either direction: from outdoors in or indoors out.

With a framed wall, the installer often neglects to seal in areas where the wall is discontinuous, such as a mechanical room. Any area, such as an unfinished wall, open rim-joint area, or un-sheeted ceiling, constitutes a very large air leak around the insulated wall. Avoid this problem by doing these procedures.


- ✓ Insulate the rim joist and air seal it.
- ✓ Build the frame walls.
- ✓ Wall off the entire basement. If a mechanical room or other area will not be insulated, install an airtight block at

the wall's edge to prevent basement air from circulating behind the insulated wall.

- ✓ Don't install a vapor barrier on the interior face of the new basement wall. The wall must be able to dry toward indoors or to the outdoors.
- ✓ Install drywall in an airtight manner on the walls and ceiling by applying sealant to the back of each sheet around its perimeter.

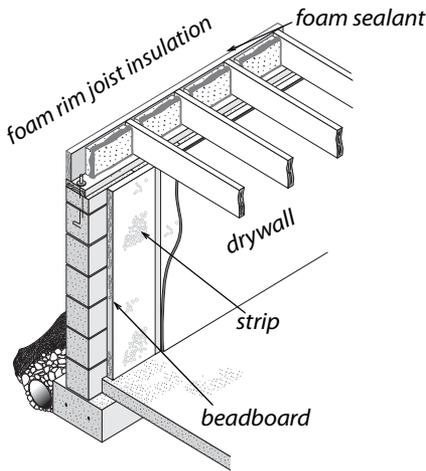

**2-inch foam board with plywood strips:** Installers fasten foam to the foundation wall using built-in strips. They then attach the drywall to the strips in the foam.

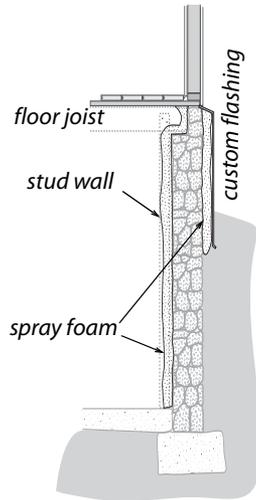

**2-part foam sprayed on rubble masonry:** Installers insulate rubble masonry walls on the interior or exterior with sprayed plastic foam. On the interior, they cover the foam with drywall.


## Stripped Foam Basement Insulation

Polystyrene foam is an excellent choice for insulating smooth basement walls.

You can order either expanded polystyrene or extruded polystyrene equipped with grooves for fastening strips, spaced apart on 16-inch or 24-inch centers. Stripped foam sheets may be the easiest and most satisfactory way to insulate below-grade basement

walls. Do these procedures to install 2-inch stripped foam on a foundation wall.

- ✓ Apply walnut-sized globs of adhesive to the back of the sheet on one-foot centers. Use a foam-compatible adhesive and follow the instructions on the container.
- ✓ Install at least two concrete screws or two powder-driven nails in each strip, 24 inches from the bottom and top.

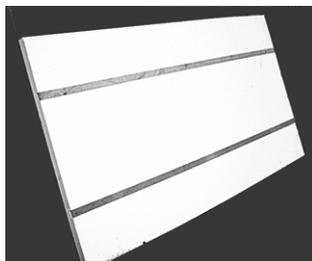

**Installing stripped foam:** Installers glue and screw the foam sheets to the masonry wall. Then they glue drywall to the foam and screw the drywall to the strips.

- ✓ Wherever an electrical box is needed, install it between two sheets if possible because it's easier to run the wire between sheets than toward the center of a sheet. Install an electrical box backed by a piece of wood that sets the box out from the foam a half inch. Use construction adhesive and a concrete screw to fasten the box in place.
- ✓ Leave a half-inch gap at the bottom of the polystyrene sheets to run wire. Run the wire along the floor and up into the boxes. If flooding is a possibility, run the wire at the ceiling and down into boxes on the wall.
- ✓ Seal the bottom gap and other gaps in the foam sheeting with one-part foam.

- ✓ Glue the drywall using the same adhesive and pattern. Screw the drywall to each wooden strip with one-inch drywall screws.

### Exterior Foam Foundation Insulation

If installed at the exterior, as during new construction, use durable water-resistant insulation such as blue or pink extruded polystyrene or high-density (2 pcf) expanded polystyrene. For portions that are exposed above ground level and six inches below ground, you'll need to provide mechanical and moisture protection such as sheet metal or fiberglass panels. For areas more than 6 inches below grade, there are asphalt-based sealants for the foam that are applied with a paint roller.

## 6.4 SWS ALIGNMENT

Field Guide Topic	SWS Detail
Thermal-Boundary Decisions: Floor or Foundation Pg. 201	
Air Sealing Foundations and Floors Pg. 203	
Plumbing Penetrations Pg. 203	3.1001.1 Penetrations and Chases, 3.1001.2 Chase Capping
Stairways to Unconditioned Areas Pg. 204	3.1002.1 Interior with Sloped Ceiling, 3.1002.2 Stairwell to Attic—Door at Bottom with No Ceiling Above, 3.1002.3 Stairwell to Attic—Door at Top with Finished Ceiling Above
Incomplete Finished Basements Pg. 207	

<b>Field Guide Topic</b>	<b>SWS Detail</b>
Cantilevered Floors Pg. 207	
Preparing for Foundation or Floor Insulation Pg. 208	4.1402.2 Basement Wall Insulation—No Groundwater Leakage, 4.1402.3 Basement Wall Insulation—Groundwater Leakage
Rim-Joist Insulation and Air-Sealing Pg. 209	4.1401.1 Band/Rim Joists—Spray Polyurethane Foam (SPF) Installation
Installing Floor Insulation Pg. 210	4.1301.1 Standard Floor System—Batt Installation, 4.1301.2 Standard Floor System—Loose Fill with Netting, 4.1301.3 Standard Floor System—Loose Fill with Rigid Barrier, 4.1301.4 Dense Pack Floor System with Rigid Barrier, 4.1301.7 Pier Construction Subfloor Insulation—Loose Fill with Rigid Barrier, 4.1301.8 Pier Construction Subfloor Installation—Dense Pack with Rigid Barrier, 4.1301.9 Open Floors Over Unconditioned Space and Cantilevered Floors, Floors Over Garages, Floors Over Unconditioned Crawl Spaces—Spray Polyurethane

Field Guide Topic	SWS Detail
Installing Fiberglass Batt Floor Insulation Pg. 212	4.1301.1 Standard Floor System—Batt Installation, 4.1301.5 Cantilevered Floor—Batt Installation, 4.1301.6 Pier Construction Subfloor Insulation—Batt Installation with Rigid Barrier
Crawl-Space Wall Insulation Pg. 214	4.1402.2 Basement Wall Insulation—No Groundwater Leakage, 4.1402.3 Basement Wall Insulation—Groundwater Leakage 4.1402.1 Closed Crawl Spaces — Wall Insulation, 3.1402.2 Closed Crawl Spaces — Air Sealing Foundation Vents
Basement Insulation Pg. 217	4.1402.2 Basement Wall Insulation—No Groundwater Leakage, 4.1402.3 Basement Wall Insulation—Groundwater Leakage



# CHAPTER 7: WINDOWS AND DOORS

This chapter presents specifications and procedures for improving the airtightness and thermal resistance of windows and doors.

Use lead-safe weatherization methods for all tasks relating to window and door weatherization, repair, and replacement. [See "EPA RRP Requirements" on page 39.](#)

## 7.1 STORM WINDOWS

A storm window is an additional window installed outside or inside the primary window.

### 7.1.1 Exterior Aluminum Storm Windows


Exterior storm windows can save energy and preserve old worn primary windows from destructive weathering. You can attach exterior operable storm windows to the blind stop or exterior window casing of a double-hung window. Or, attach a fixed storm to any flat surface of a window frame or sash if the window is fixed or if a movable sash can support the extra weight.

Metal exterior storm windows are the best choice if they are well designed and installed properly.

- Choose operable storm windows to install on operable windows. Choose fixed storm windows to install on fixed windows or on sashes that open along with the movable primary window.
- If operable, make sure that the storm window opens and closes to allow the maximum amount of ventilation and egress area.
- Measure the storm-window dimensions according to where you'll attach the storm: blind stop, window casing, or sash.

- Storm-window frames should have sturdy corners so they don't rack out-of-square during transport and installation.
- Sashes must fit tightly in their frames.
- The gasket sealing the glass should surround the glass's edge.
- Consider selecting a hard-coat low-e glass for the storm window, which should face the primary window to protect the low-e coating.
- The storm window should be sized accurately and should fit tightly in the opening.
- The storm window's sashes should be removable from indoors for cleaning.

**Aluminum exterior storm windows:** They protect the primary window and add about an R-1 to the window assembly.

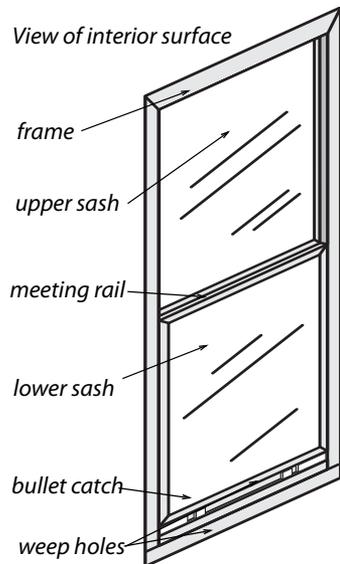

## Installation of Exterior Storm Windows

Follow these guidelines when installing storm windows.

- ✓ Seal storm windows around the frame at time of installation with sealant tape or caulk.

- ✓ Don't allow the tape or caulk to interfere with the weep holes at the bottom of the frame. If weep holes aren't manufactured into new storm window, drill weep holes or leave at least 2 two-inch spaces in sealant to allow water on the sill to escape.
- ✓ Don't allow storm windows to restrict emergency egress or ventilation through movable windows.

*See also "Mobile home double window" on page 462.*

## 7.1.2 Interior Storm Windows

### *SWS Details: 3.1201.6 Interior Storm Windows*

Interior storm windows are usually more airtight than exterior storm windows because they must be airtight to avoid condensation and icing on the primary window during winter. Interior storm windows are usually a metal or plastic frame enclosing some type of plastic glazing.

Consider these specifications when selecting interior storm windows.

- Interior storm windows should have an airtight edge seal to prevent warm moist air from passing by the interior storm window and condensing or icing the interior of the glass on the primary window.
- Interior storm windows should be easily removable for egress and storage.
- The home should have a safe place to store the storm windows seasonally.
- Consider using low-e glass or plastic for glazing to increase thermal resistance.

## 7.2 WINDOW REPAIR AND AIR LEAKAGE REDUCTION

With the exception of broken glass or missing window panes, windows aren't often the major source of air leakage in an existing home.

Window weatherstripping may solve comfort problems around windows, even though it may not be cost-effective. Avoid expensive or time-consuming window repair measures that are implemented to solve minor comfort complaints if the weatherization budget is limited.

### 7.2.1 Double-Hung Window Weatherization


*SWS Details: 3.1202.1 Fixed Frame with Wood Sash—Older House, 3.1201.2 Single-Unit Window and Fixed Frame with Wood Sash, 3.1201.1 Double-Hung Wood Windows*

Re-glazing window sashes in a quality manner is time consuming. This task is best accomplished as part of a comprehensive window rehabilitation project. Re-glazing wood windows may not be a durable repair without thorough scraping, priming, and painting. Use lead-safe work practices when working on windows. [See page 52.](#)

Repair measures may include the following.

- ✓ Replace missing or broken glass. Use glazing compound and glazier points when replacing glass in old windows.
- ✓ Caulk the window frame where appropriate to prevent air leakage, condensation, and rain leakage. Use sealants with adhesion and joint-movement characteristics appropriate for both the window frame and the building materials surrounding the window.
- ✓ Replace missing or severely deteriorated window frame components.

- ✓ Fill damaged wood with epoxy, before priming and painting.
- ✓ Adjust window stops if gaps exist between the stop and jamb. Ensure that the window operates smoothly following adjustment.
- ✓ Weatherstrip large gaps between the sash and the sill or stops. Weatherstrip the meeting rails if needed.
- ✓ Replace or repair missing or non-functional top and side sash locks, hinges, or other hardware if this significantly reduces air leakage.

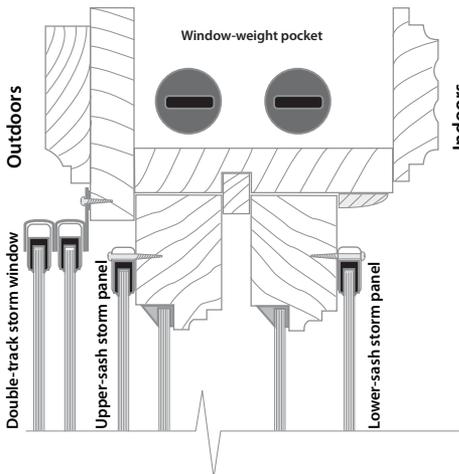

**Optimized double-hung window:** An exterior aluminum storm window plus storm window panels on the window sashes create triple glazing in this double-hung window.


## 7.2.2 Weatherstripping Double-Hung Windows

### *SWS Detail: 3.1201.1 Double-Hung Wood Windows*

Window weatherstripping is mainly a comfort retrofit and not a high weatherization priority.

Paint is the primary obstacle when weatherstripping double-hung windows. Often the upper sash has slipped down, and is locked in place by layers of paint, producing a leaking gap between the meeting rails of the upper and lower sashes.

- ✓ To make the meeting rails meet again, either break the paint seal and push the upper sash up, or cut the bottom of the lower sash off to bring it down.

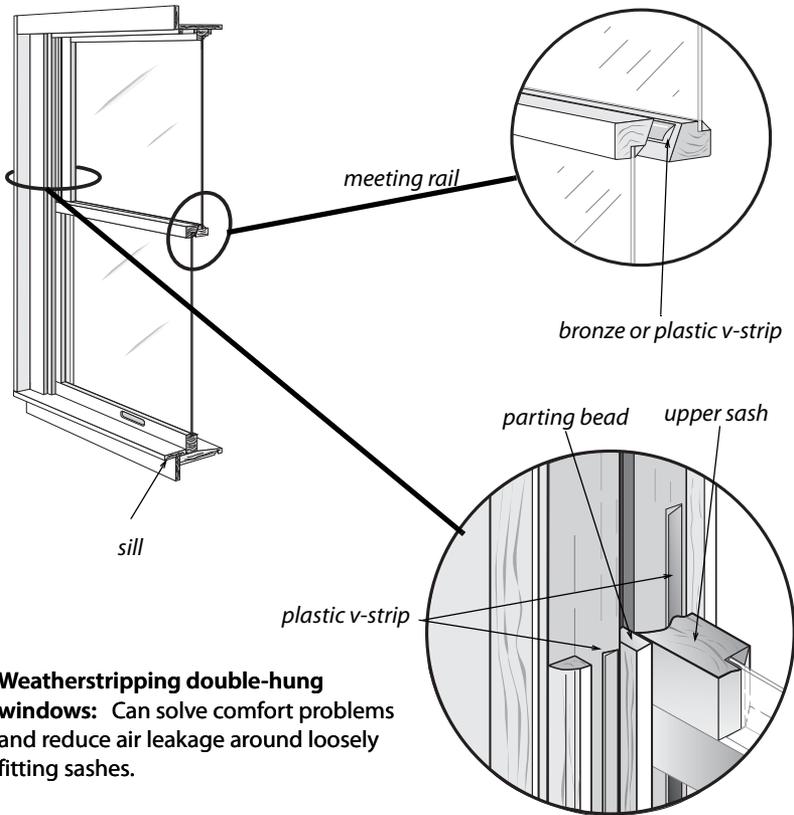


**Weatherstripping double-hung windows:** Can solve comfort problems and reduce air leakage around loosely fitting sashes.

- ✓ To lift the upper sash, cut the paint around its inside and outside perimeter. Use leverage or a small hydraulic jack to lift the sash. Jack only at the corners of the sash. Lifting in the middle can break the glass.
- ✓ Block, screw, or nail the repositioned upper sash into place.
- ✓ To weatherstrip the window, remove the lower sash. Cut the paint where the window stop meets the jamb so the paint doesn't pop off in large flakes as you pry the stop off.

Removing one stop is sufficient to remove the bottom sash.

- ✓ Scrape excess paint from the sashes and the window sill.
- ✓ Apply vinyl V-strip to the side jambs, and bronze V-strip to the meeting rail on the top sash. The point of the bronze V goes skyward. The weatherstrip is caulked on its back side and stapled in place, as shown in the illustration.

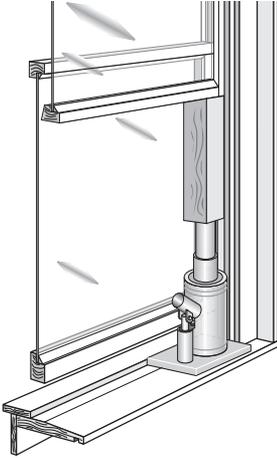

**Lifting an upper window sash:**  
First cut paint away from around the sash inside and outside. Then lift with leverage or a jack.

### 7.3 WINDOW REPLACEMENT SPECIFICATIONS

The purpose of these specifications is to guide the selection and installation of replacement windows. Improper window installation can cause water leakage, air leakage, and noise leakage.

Existing window openings may have moisture damage and air leakage. Repair these conditions before or during window replacement.

Included here are specifications for two special window safety considerations.

1. Windows in high risk areas, such as around doors and walkways, must have safety glass.

2. Some bedroom windows function as a fire escape (egress). Recognize and accommodate this egress function.

### 7.3.1 Window Energy Specifications

Installing new windows incurs a large labor expense so they should be as energy-efficient as budget allows.

1. Replacement windows must have a U-factor less than or equal to what is required by State standards. Lower is better, especially in cold climates.
2. Replacement windows facing east or west in air conditioned homes should have a solar heat-gain coefficient (SHGC) that is equal to or less than what is required by State standards. Lower is better in hot climates.

	<b>ACME Window Company</b> EnerSaver 2010 Vinyl Frame Double Glazing - Argon Fill - Low E Horizontal Sliding Window	
	<b>Energy Performance Ratings</b>	
U-Factor (US/I-P) <b>0.32</b>	Solar Heat Gain Coefficient <b>0.40</b>	
<b>Additional Performance Ratings</b>		
Visible Transmittance <b>0.54</b>	Air Leakage (US/I-P) <b>0.3</b>	
Condensation <b>0.51</b>		
<small>Manufacturer stipulates that these ratings conform to applicable NFRC procedures for determining whole product energy performance. NFRC ratings are determined for a fixed set of environmental conditions and specific product sizes. NFRC does not recommend any product and does not warrant the suitability of any product size. Contact the manufacturer for other performance information.  <a href="http://www.nfrc.org">www.nfrc.org</a></small>		

Example NFRC label: The key selection criteria for window shopping is displayed on the NFRC label.

## 7.3.2 Removing Old Windows

Remove existing windows without damaging the home's interior finish, siding, exterior trim, or the water-resistant barrier (WRB) if possible.

1. Protect the interior of the home from construction debris. *See "EPA RRP Requirements" on page 39.*
2. Remove window sashes, jambs, or siding, depending on the window-replacement method chosen.
3. Repair moisture damage to the rough opening before installing the new window.

## 7.3.3 Installing Replacement Windows

*SWS Details: 3.1203.2 Single-Unit Window, Mounted on Rough Opening—Newer House, 3.1203.1 Fixed Frame with Wood Sash—Older House, 3.1203.1 Replacement Window in Existing Window Frame*

The most important considerations for installing new windows is that the window installation is watertight and airtight.

Water leakage deteriorates building components around the window. To prevent water leakage in frame buildings, the window must be integrated, if possible into the home's water resistant barrier (WRB).



Nail Fin



Flush Fin



Block Frame

**Window-frame types:** It's important to order the right window-frame type for the method of window installation you plan to use.


## 7.3.4 Replacing Nailing-Fin Windows

*SWS Detail: 3.1203.2 Single-Unit Window, Mounted on Rough Opening—Newer House, 3.1203.1 Fixed Frame with Wood Sash—Older House*

Install replacement windows with nailing fins in the rough opening after removing the existing window frame and exterior trim. Fasten the nailing fins directly to the house's sheathing or framing, but support the window's weight on the sill with or without shims before fastening the window to the building.

**Water-Resistive Barrier (WRB):** Designers and builders assume that some rain water penetrates through the siding. The WRB is the building's last defense against water. House wrap and asphalt felt are the most common WRBs. Window replacements that expose the home's WRB must incorporate the WRB in the window installation. Install a sill pan below the window and flashing on the side fins. Use flashing to connect the window opening to the WRB so water that penetrates the siding, trim, or window exits the building by way of the WRB.

Windows are exposed to wind and rain. Install replacement windows so water that penetrates the siding or trim drains to the outdoors. If water leaks underneath the existing WRB or the new flashing, the water eventually damages the building. With proper flashing, the fins and flashing create a drainage system that drains water to the outdoors rather than relying on caulked siding and trim to prevent rain water from penetrating the building's surface.

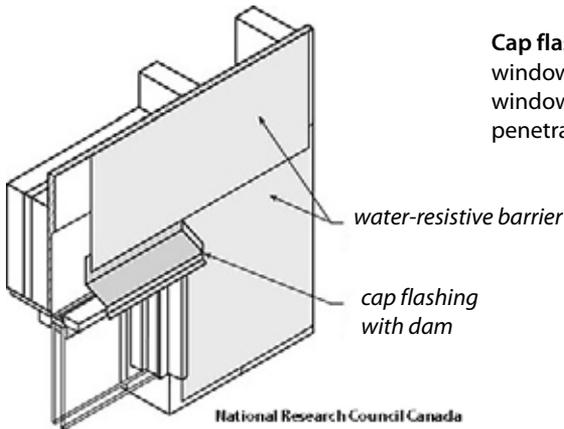


**Cap flashing:** Cap flashing at the window's head protects the window from rain water penetration.

Follow these steps to install a nailing-fin window in the rough opening.

1. At the sill, insert the flashing underneath the existing siding, over top of existing building paper, and under the bottom nailing fin of the window.
2. Use flat shims to provide a level surface and support under the vertical structural members of the new window frame. Don't allow the fins to support the window's weight.
3. Use fasteners with heads wide enough in diameter to span the holes or slots in the window fin.
4. Avoid over-driving the fasteners or otherwise deforming the window fin.
5. Flash the window around its perimeter with 15-pound felt, house wrap, or a peel-and-stick membrane.
  - a. Flashing procedures may vary. However, always install flashing materials to overlap like shingles.
  - b. Insert the new building paper or flashing underneath the existing siding and underneath existing building paper on the sides and top of the window opening.

6. Windows that are exposed to wind-driven rain or without overhangs above them or without WRB integration should have a rigid cap flashing (also called head flashing) to prevent rainwater from draining onto the window. The cap flashing should divert water away from vertical joints bordering the window with an overhang or dam.
7. Tuck the cap flashing up behind the WRB or exterior siding. Metal cap flashing must have downward bending lip of at least  $\frac{1}{4}$  inch on the front and ends.
8. Thoroughly caulk all filler and trim pieces surrounding the replacement window.

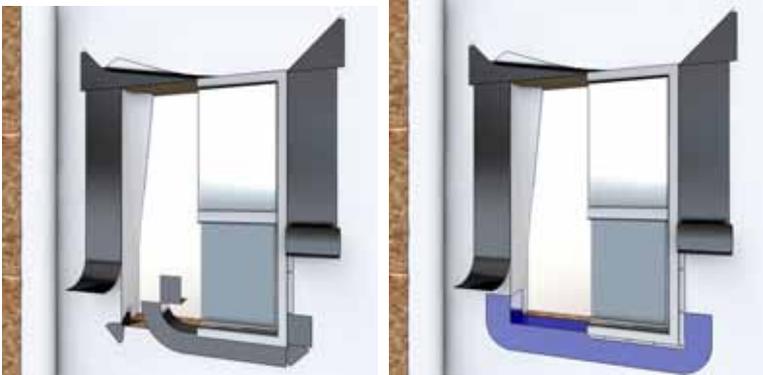

**Flashing nail-fin windows:** Installers place the window on and over the sill flashing. The side and top flashing cover the fastening fin. The two methods shown here are: using a flexible membrane (right) and using a bowtie-shaped flashing to underlay the corners when using a standard membrane

### 7.3.5 Block-Frame or Finless Windows

*SWS Detail: 3.1203.1 Fixed Frame with Wood Sash—Older House*

Contractors install windows using a block-frame or finless installation when they can't remove the existing window frame

or in a masonry window opening. Block-frame windows rely on caulk or rigid flashing to create a weatherproof seal around the window perimeter. Take care when installing caulk so that it is durable and effective for as long as possible.

Comply with the following requirements when installing block-frame or finless windows.

1. Block-frame or finless windows may require a sufficiently wide gap between the new window and the existing window frame or masonry opening to allow for the following.
  - a. Allowing for a slightly out-of-square opening.
  - b. Leveling the window.
  - c. Insulating the gap with foam.
2. Access the window-weight cavities, remove the weights, and fill the cavities with insulation, and seal the cavities.
3. Protect the existing sill with a metal or plastic sill pan or rigid sill flashing if necessary for drainage and to protect the existing sill that protrudes from the exterior wall. Or, install a new sill as part of the window replacement.
4. Support block-frame or finless windows under their main vertical supports with shims that level the window.
  - a. Use flat shims for support if the sill surface is flat.
  - b. Use tapered shims or a sill angle for support if the sill surface is sloping.
5. Windows without fins must be secured to the rough opening within 4 inches of each side corner and a minimum 12 inches on center along the remainder of the frame with one of these fastening methods.

- a. Screws fastened through the window frame. Use screws that are designed for fastening block-frame windows if available.
  - b. Jamb clips or plates that are fastened first to the window and then to the opening in separate steps.
6. Fill any gaps over  $\frac{3}{8}$  inch that are between the exterior siding and the block-frame window. Install backer rod in all exterior or interior voids over  $\frac{3}{8}$  inch in depth or width before caulking.
  7. If possible, flash block-frame windows between the opening and the replacement-window frame and extend the flashing out far enough to slip under or into the siding.
    - a. Tuck the flashing up behind the exterior siding at least 1 inch.
    - b. Sill and cap flashing should have a downward bending lip of at least  $\frac{1}{4}$  inch on the front that sheds water away from the building.



**Block frame window installation:** Block-frame windows don't have a fin. Installers use plates or screws to fasten the window to its opening.

### 7.3.6 Flush-Fin Window Replacement

Flush-frame windows are replacement windows that fasten to the window opening and mount directly over the flat siding surrounding the window opening. Replace windows in stucco walls using windows with flush fins, also called stucco fins, that have no nail holes. Flush-fin windows work well for any window opening with a flat water-resistant finished surface surrounding the window opening.

This flush-fin window-replacement technique is similar to block-frame window installation.

1. Support the replacement window on the existing sill with one of the following materials.
  - a. A flat or tapered continuous wood support.
  - b. Flat shims under the window's main vertical supports.
  - c. Tapered shims under the window's main vertical supports if the sill is sloping.
2. Apply a sealant that remains flexible to the back of the flush fin of the replacement window in order to seal it to the surface of the exterior wall. Interrupt the caulking at the bottom fin for one inch on each side of the window's weep holes.
3. Fasten the flush-fin window to the window opening by driving screws through the replacement window's frame.



**Flush frame window:** Flush frame windows have the fin at the exterior surface of the window and seal to a flat exterior surface like stucco.

## 7.4 WINDOW SAFETY SPECIFICATIONS

Windows have special requirements for breakage-resistance in areas that are prone to glass breakage, and for fire escape in bedrooms.

### 7.4.1 Windows Requiring Safety Glass


Safety glass is required in locations that the IRC 2012 considers hazardous to the building's occupants. Safety glass must be either laminated glass, tempered glass, organic coated glass, or annealed glass bearing a permanent label identifying it as safety glass, manufactured in compliance with CPSC 16 CFR 1201 or ANSI Z97.1.

Instead of safety glazing, glazed panels may have a protective bar installed on the accessible sides of the glazing 34 to 38 inches above the floor. The bar must be capable of withstanding a horizontal load of 50 pounds per linear foot without contacting the glass and be a minimum of 1<sup>1</sup>/<sub>2</sub> inches in diameter.

Safety glass or a protective bar is required in the following hazardous locations.

- ✓ Glazing wider than 3 inches in entrance doors.
- ✓ Glazing in fixed and sliding panels of sliding doors and panels in swinging doors.

**Safety glass around doors:** A window near a door must be glazed with safety glass when the window is less than 24 inches from the door and less than 60 inches from the floor.

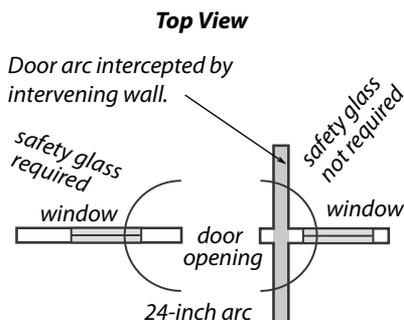

- ✓ Glazing in fixed or operable panels adjacent to a door where the nearest exposed edge of the glazing is within a 24-inch arc of the vertical edge of the door in a closed position and where the bottom edge of the glazing is less than 60-inches above the floor or walking surface. Exception: If there is an intervening wall or permanent barrier between the door and the glazing, safety glass isn't required.
- ✓ Glazing adjacent to the landing of the bottom of a stairway where the glazing is less than 36 inches above the landing and within 60 inches horizontally of the bottom tread.
- ✓ Glazing with a bottom exposed edge that is less than 36 inches above the walkway surface of stairways, landings, and ramps.
- ✓ Glazing in any portion of a building wall enclosing showers, hot tubs, whirlpools, saunas, steam rooms, and bathtubs where the bottom exposed edge is less than 5 feet above a standing surface or drain inlet.


Glazing in an individual fixed or operable panel that meets all of the following conditions must also have safety glass:

1. An exposed area of an individual pane greater than 9 square feet, and
2. An exposed bottom edge less than 18 inches above the floor.
3. An exposed top edge greater than 36 inches above the floor.
4. One or more walkways within 36 inches horizontally of the glazing.

## 7.4.2 Fire Egress Windows

Windows are the designated fire escape for bedrooms and should offer a minimum opening for a person's escape. If the window installation requires a code-approved egress window, observe these specifications.

1. Each bedroom must have one egress window.
2. Egress windows must provide an opening that is at least 20 inches wide and at least 24 inches high.
3. Egress windows must provide an opening with a clear area of at least 5.7 square feet except for below-grade windows, which must have at least 5.0 square feet of opening.
4. The finished sill of the egress window must be no higher off the floor than 44 inches.
5. You may install security bars, screens, or covers over egress windows as long as these security devices are easily removable from indoors.

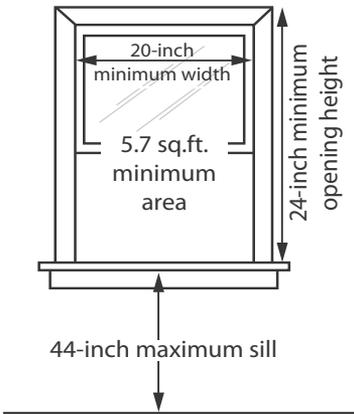

**Egress windows:** Windows for fire escape must be large enough and a convenient distance from the floor.

## 7.5 DOOR REPLACEMENT AND IMPROVEMENT

Exterior doors suffer a lot of wear because they function as entrances to buildings. Doors need adjustment or repair when they're malfunctioning or damaged.

Install flashing around doorways according to the specifications in *"Installing Replacement Windows"* on page 233.

### 7.5.1 Door Replacement

Door replacement may be completed as an efficiency measure if the cost is justified. Use RRP & LSW methods to ensure occupants and workers are not placed at risk during door repair measures. See *"EPA RRP Requirements"* on page 39.


Observe the following standards when replacing exterior doors.

- ✓ Replace the door using an exterior-grade insulated door-blank or a pre-hung steel insulated door, unless the door opening isn't standard width or height.
- ✓ Don't replace an exterior panel door with another panel door.
- ✓ All exterior replacement doors must have three hinges.

### 7.5.2 Door Adjustment and Repair

#### *SWS Detail: 3.1201.3 Exterior Doors*

Door operation affects building energy-efficiency, security and durability, so doors are sometimes an important weatherization priority. A leaky door may be an important comfort problem, and weatherstripping it can be a high-value energy conservation measure. Perform all door adjustment and repair in a lead-safe manner. See *"EPA RRP Requirements"* on page 39.

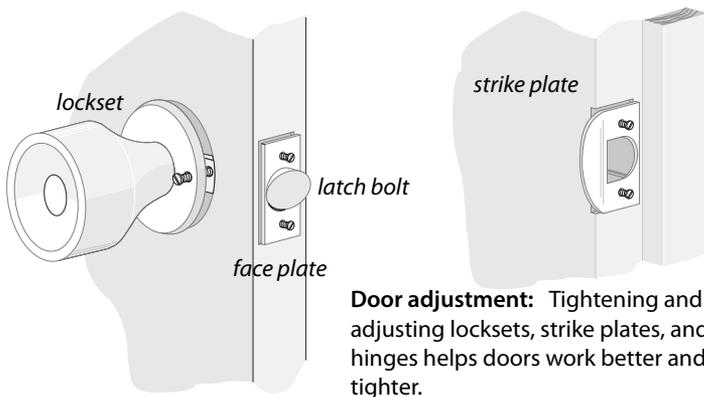

## Evaluating Exterior Doors

Before weatherstripping a door, evaluate the door's operation.

- Does the door bind or scrape against its jambs, indicating a need for hinge adjustment?
- Does the door close tightly and evenly against its stops or is there an uneven space between the door and stop when the door is latched?
- Can you move the latched door back and forth against its stops, indicating a need for latch adjustment?
- Can you move the open door up and down, indicating loose hinges?

## Fixing Binding Doors

You can adjust binding doors by moving the door within its opening. Moving the top and middle hinges in, or moving the bottom and middle hinges out moves the door's top latch-side corner upward and back toward the top hinge. Moving the top and middle hinges out drops the door down and moves the door away from the top hinge.

- If the hinges are loose, tighten the hinges and add longer screws if necessary. Longer screws can even move the door

jamb a little, when necessary, if the screws penetrate the stud next to the door.

- If the gaps at the top latch-side corner are uneven, rotate the door in its opening by adjusting the hinges. Chisel the hinge mortises a little deeper or install cardboard shims between the hinges and door or jamb to move the door to create an even space around the door.
- If the house has settled and the opening is out-of-square, plane or power-sand the door so it closes without rubbing or binding against its jambs.
- If paint has built up and reduced the door's operating gap, plane or sand off the excess paint. Planing and sanding are a last resort, so try the previous suggestions first.

### Adjusting Latches and Stops


If a door won't latch, inspect the door stops and weatherstripping to see if they're binding. If there's no obvious problem with the weatherstrip or stops, move the strike plate out slightly or use a file to remove a little metal from the strike plate to allow the latch to seat itself. The strike plate is mortised into the door frame that receives the latch.

- ✓ Tighten loose door knobs, face plates, and strike plates.
- ✓ If the door is warped and doesn't fit well against its stops, adjust the stops by moving them against the door or planing them so door closes snugly against its stops.
- ✓ Move the strike plate to hold the door evenly against its stops if necessary. Use toothpicks to fill widened screw holes. Use longer screws if you have to move the strike plate.


### Weatherstripping Doors

Consider these suggestions when weatherstripping doors.

- ✓ Use a durable stop-mounted or jamb-mounted weatherstrip to seal the door's side jambs and head jamb.
- ✓ Seal the back of the weatherstrip to prevent air from leaking behind the weatherstrip.
- ✓ Install thresholds and door sweeps if needed to prevent air leakage at the door bottom. These air seals should not bind the door. Thresholds should be caulked underneath and on both sides of the door sill.
- ✓ Install corner seals to close the gaps at the bottom corners of the door jambs.



*Vinyl flap weatherstrip is particularly flexible, allowing the door to remain sealed with seasonal movements of the door*

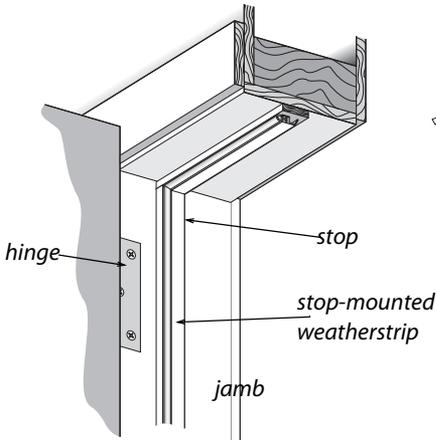


*Silicone bulb weatherstrip is much more flexible than vinyl bulb and therefore seals better.*



*Bronze v-strip mounts on the door jamb and is very durable.*

**Weatherstripping doors:** The three weatherstrips shown should be flexible enough to move with the door seasonally and maintain their seal as the door moves seasonally.

- ✓ Seal gaps between the stop and jamb with caulk.
- ✓ Install a door sweep if you don't install a door bottom.
- ✓ The door must operate smoothly after you weatherstrip it.

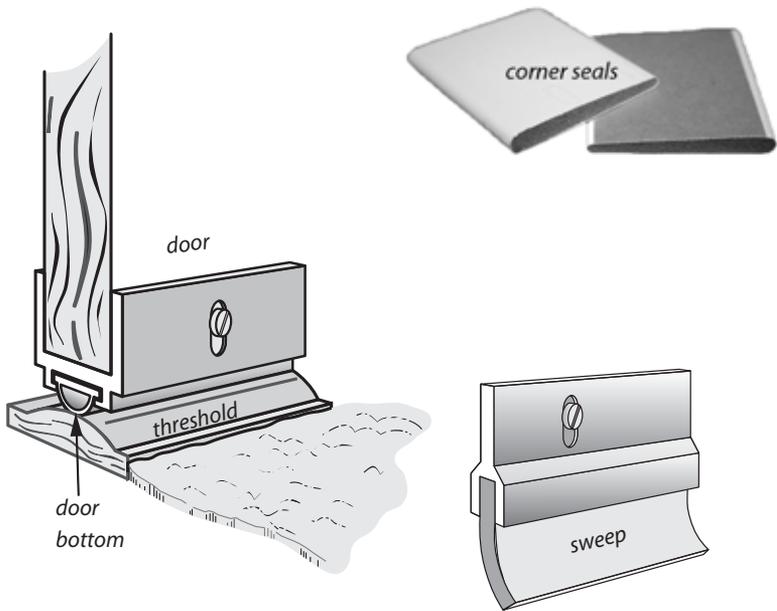

**Weatherstripping at the door bottom:** A threshold and door bottom are the ideal bottom seal for a door. The threshold and door bottom must be adjusted to seal but not bind. Corner seals in the bottom complete a quality door-weatherstripping job.

## 7.6 SWS ALIGNMENT

Field Guide Topic	SWS Detail
Storm Windows Pg. 225	
Exterior Aluminum Storm Windows Pg. 225	
Interior Storm Windows Pg. 227	3.1201.6 Interior Storm Windows

<b>Field Guide Topic</b>	<b>SWS Detail</b>
Window Repair and Air Leakage Reduction Pg. 228	
Double-Hung Window Weatherization Pg. 228	3.1202.1 Fixed Frame with Wood Sash—Older House, 3.1201.2 Single-Unit Window and Fixed Frame with Wood Sash, 3.1201.1 Double-Hung Wood Windows
Weatherstripping Double-Hung Windows Pg. 229	3.1201.1 Double-Hung Wood Windows
Window Replacement Specifications Pg. 231	
Window Energy Specifications Pg. 232	
Removing Old Windows Pg. 233	
Installing Replacement Windows Pg. 233	3.1203.2 Single-Unit Window, Mounted on Rough Opening—Newer House, 3.1203.1 Fixed Frame with Wood Sash—Older House 3.1203.1 Replacement Window in Existing Window Frame
Replacing Nailing-Fin Windows Pg. 234	3.1203.2 Single-Unit Window, Mounted on Rough Opening—Newer House, 3.1203.1 Fixed Frame with Wood Sash—Older House
Block-Frame or Finless Windows Pg. 236	3.1203.1 Fixed Frame with Wood Sash—Older House
Flush-Fin Window Replacement Pg. 239	

<b>Field Guide Topic</b>	<b>SWS Detail</b>
Window Safety Specifications Pg. 240	
Windows Requiring Safety Glass Pg. 240	
Fire Egress Windows Pg. 243	
Door Replacement and Improvement Pg. 244	
Door Replacement Pg. 244	
Door Adjustment and Repair Pg. 244	SWS Detail: 3.1201.3 Exterior Doors

# **CHAPTER 8: HEATING AND COOLING SYSTEMS**

This chapter discusses safety and energy-efficiency improvements to heating and cooling systems. It is divided into these main sections.

1. Essential combustion-safety testing
2. Heating-system replacement:
3. Servicing gas and oil heating systems
4. Combustion venting
5. Heating distribution systems
6. Air-conditioning systems

The SWS requires that weatherization agencies perform a combustion-safety evaluation as part of each weatherization work scope. This evaluation is the chapter's first topic. The chapters other topics are procedures and requirements related to cost-effective ECMs, such as tune-ups and equipment replacement.

## **8.1 COMBUSTION-SAFETY EVALUATION**

*SWS Detail: 2.0105.1 Combustion Worker Safety, 5.3003.14 Combustion Analysis of Gas-Fired Appliances (LP and Natural Gas), 5.3003.2 Combustion Analysis of Oil-Fired Appliances*


Evaluate and address all combustion safety issues prior to weatherization.

### **8.1.1 Combustion Safety Tests**

The Department of Energy (DOE) requires that essential combustion safety tests be performed as part of all energy conserva-

tion jobs. Perform gas leak-testing and CO testing on all combustion appliances. For naturally drafting appliances, a worst-case CAZ depressurization test is also necessary.

- ✓ Recognize soot near the draft diverter, barometric damper, or burner of a combustion appliance as a sign that the appliance has produced CO and spilled combustion gases.
- ✓ Recognize that rust in a chimney or vent connector may also indicate spillage.
- ✓ Look for irregularities and flaws in the venting system.
- ✓ Specify that workers seal all accessible return-duct leaks attached to combustion furnaces.
- ✓ Verify that the home has a working CO alarm. If the home has no working smoke alarm in addition to no CO alarm, install a combination CO-smoke alarm, or separate CO and smoke alarms.

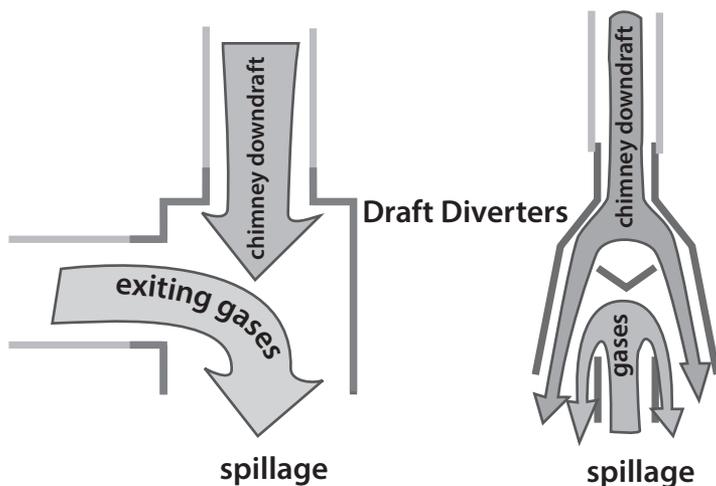


**Draft-diverter spillage:** Look for soot or corrosion near the draft diverter and also near the burner caused by spillage.

## 8.1.2 Leak-Testing Gas Piping

Natural gas and propane piping systems may leak at their joints and fittings. Find gas leaks with an electronic combustible-gas detector, also called a gas sniffer. A gas sniffer finds significant gas leaks if used correctly, moving the sensor no more than one inch per second. Remember that natural gas rises from a leak and propane falls, so position the sensor accordingly.

- ✓ Check for correct gas-pipe sizing.
- ✓ Check for sediment trap.
- ✓ Check for a gas shut-off valve at the meter and in the CAZ.
- ✓ Sweep all gas lines, valves and joints with the electronic combustible gas detector.
- ✓ Accurately locate leaks using a noncorrosive bubbling liquid, designed for finding gas leaks.
- ✓ Repair all gas leaks.
- ✓ Replace kinked or corroded flexible gas connectors.
- ✓ Replace flexible gas lines manufactured before 1973. The line's manufacture date is stamped on a date ring attached to the flexible gas line. If a date ring isn't present, and you believe the gas line predates 1973, then replace the flexible gas line.

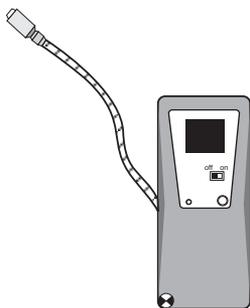

**Gas sniffer:** Use this device to detect the presence of combustible gases around fittings.

## 8.1.3 Carbon Monoxide (CO) Testing

*SWS Detail: 2.0105.1 Combustion Worker Safety, 2.0301.2 Carbon Monoxide Alarm or Monitor, 5.3003.14 Combustion Analysis of Gas-Fired Appliances (LP and Natural Gas)*

CO testing is essential for evaluating the safety of combustion and venting. Measure CO in the heat-exchanger port or vent of every combustion appliance you inspect and service. Measure CO in ambient air in both the home and CAZ as part of inspection and testing of combustion appliances.

### Vent Testing for CO

Testing for CO in the appliance's heat-exchanger port or vent is a part of combustion testing that happens under worst-case conditions. If CO is present in undiluted combustion byproducts more than 100 parts per million (ppm) air free, the appliance fails the CO test under current widely accepted standards.

### Ambient Air Monitoring for CO

The DOE SWS require contractors to monitor CO during combustion testing to ensure that CO in the combustion appliance zone (CAZ) doesn't exceed 35 ppm as measured. If ambient CO levels in the combustion zone exceed 35 ppm, stop testing for your own safety. Ventilate the CAZ thoroughly before resuming combustion testing. Investigate indoor CO levels of greater than 0 ppm to find their cause. The ASHRAE 24-hour CO exposure limit is 9 ppm as measured. *See "Causes of Carbon Monoxide (CO)" on page 22.*

## 8.1.4 Worst-Case CAZ Depressurization Testing


*SWS Detail: 2.0105.1 Combustion Worker Safety, 2.0201.1 Combustion Appliance Zone (CAZ) Testing, 2.0201.2 Combustion Safety*

CAZ depressurization is the leading cause of backdrafting and flame roll-out in furnaces and water heaters that vent into naturally drafting chimneys.

Worst-case vent testing uses the home's exhaust fans, air handler, and chimneys to create worst-case depressurization in the combustion-appliance zone (CAZ). The CAZ is an area containing one or more combustion appliances. During this worst-case testing, you can measure the CAZ pressure difference with reference (WRT) to outdoors and test for spillage.

Worst-case conditions do occur, and venting systems must exhaust combustion byproducts even under these extreme conditions. Worst-case vent testing exposes whether or not the venting system exhausts the combustion gases when the combustion-zone pressure is as negative as you can make it. A digital manometer is the best tool for accurate and reliable readings of both combustion-zone depressurization and chimney draft.

**Flame roll-out:** A serious fire hazard can occur when the chimney is blocked, when the combustion zone is depressurized, or during extremely cold weather.

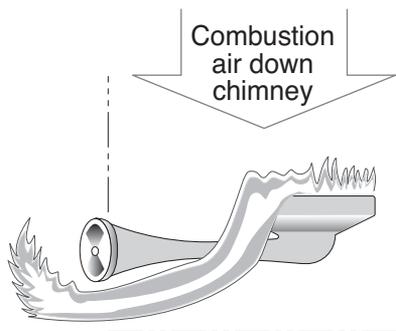

Take all necessary steps to reduce CAZ depressurization and minimize combustion spillage, based on your tests.

### Worst-Case CAZ Depressurization Test


*SWS Detail: 2.0201.1 Combustion Appliance Zone (CAZ) Testing, 2.0299.1 Combustion Appliance Depressurization Limits Table*

Follow the steps below to find the worst-case depressurization level in the combustion appliance zone (CAZ).

1. Close all exterior doors, windows, and fireplace damper(s). Open all interior doors, including closet doors.
2. Set all combustion appliances to the pilot setting or turn them off at the service disconnect. Don't fire the burner of the combustion appliance yet.
3. Remove furnace filter, or replace with a new filter. Be sure the filter slot is covered.
4. Record the base pressure of the CAZ with reference to outdoors.
5. Turn on all clothes dryers and exhaust fans. (Clean clothes dryer filter trap)
6. Open or close interior doors including the CAZ door, to maximize the negative pressure. Record this pressure.
7. Turn on the furnace air handler.
8. Open or close interior doors including the CAZ door, to maximize the negative pressure. Record this pressure.

**Worst-case depressurization:**

Worst-case depressurization tests identify problems that weaken draft and restrict combustion air. The testing described here is intended to reveal the cause of the CAZ depressurization and spillage.

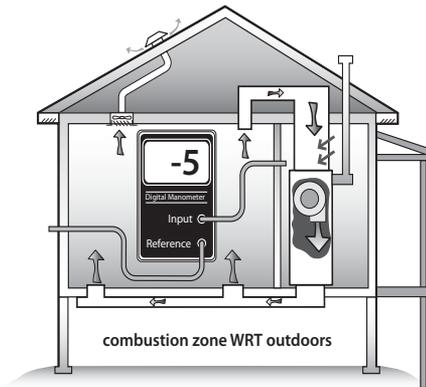

9. Calculate the net difference between the worst depressurization found from #6 or #8 and the baseline pressure. This is the worst-case depressurization.

10. Refer to the [SWS 2.0299.1 Combustion Appliance Depressurization Limits Table](#) or “[Maximum CAZ Depressurization](#)” on page 495.
11. Specify improvement if the measured worst-case depressurization limit is exceeded. See “[Mitigating CAZ Depressurization and Spillage](#)” on page 258.

**Troubleshooting depressurization sources:** When depressurization resists simple diagnosis or persists after mitigation attempts, you can test depressurization caused by exhaust appliances and the air handler separately to determine which is the larger depressurizer. Observe the effect of opening and closing interior doors and the CAZ door to determine which house zones are causing depressurization in the CAZ.

### Spillage and CO Testing

Next, verify that the appliance venting systems don’t spill or produce excessive CO at worst-case depressurization. Test each appliance in turn for spillage and CO as described below.

1. Detect spillage at the draft diverter of each combustion appliance in one of these ways.
  - a. Smoke from a smoke generator being repelled by spillage at the draft diverter.
  - b. A mirror fogging at the draft diverter
2. If spillage in one or more appliances continues at worst-case depressurization for 60 seconds or more, take action to correct the problem.
3. Measure CO in the undiluted flue gases of each appliance after 5 minutes of operation at worst-case depressurization. If CO in undiluted flue gases is more than 100 ppm air-free measurement, order a service call to reduce CO level.

**Spillage and draft:** Spillage and draft are two indications of whether the combustion gases are exiting the building as they

should. In this guide, we focus on spillage because it's spillage we're trying to avoid, and we can detect it easily.

Draft, if you measure it, should be between 0 pascals (0.000 IWC) and -10 pascals (-0.040 IWC) for atmospheric burners. Positive draft indicates spillage, but not reliably. Draft is complicated and requires training to understand what it is. Look for spillage, unless you understand draft and know how to measure it.



**Spill switch:** If you don't trust an appliance to be spill-proof, install a spill switch that extinguishes the burner if the chimney spills.

### 8.1.5 Mitigating CAZ Depressurization and Spillage

If you find problems with CAZ depressurization or spillage, consider the improvements discussed next to solve the problems.

If the appliance spills or shows inadequate draft, open a window, exterior door, or interior door to observe whether the additional combustion airflow through that opening stops the spillage.

1. If this additional air improves draft, the problem is usually depressurization.
2. If this additional air doesn't stop the spillage, inspect the chimney. The chimney may be obstructed, undersized, oversized, or leaky.

## Improvements to Mitigate CAZ Depressurization

This list of duct improvements may solve spillage problems detected during the previous tests on a forced air heating system.

- Seal all return-duct leaks near the furnace.
- Isolate the CAZ from return registers and exhaust fans by air-sealing the CAZ from the depressurizing zones and providing combustion air to the sealed CAZ.
- Reduce depressurization from the exhaust appliances.

These two suggestions may reduce depressurization caused by the home's exhaust appliances.

1. Isolate combustion appliances from exhaust fans and clothes dryers by air sealing between the CAZ and zones containing these exhaust devices as described on [page 261](#).
2. Provide make-up air for dryers and exhaust fans and/or provide combustion air inlet(s) to the CAZ. [See page 310](#).

**Table 8-1: Spillage and Draft Problems and Solutions**

<b>Problem</b>	<b>Possible Solutions</b>
Spills immediately and continuously	Remove chimney blockage, seal chimney air leaks, or provide additional combustion air as necessary.
Exhaust fans cause spillage	Provide make-up or combustion air if opening a door or window to outdoors improves draft during testing.
Blower activation causes spillage	Seal leaks in the furnace and in nearby return ducts. Isolate the furnace from nearby return registers.

## Chimney Improvements to Mitigate Spillage Problems

Suggest the following chimney improvements to mitigate spillage problems detected during the previous testing.

- Remove chimney obstructions.
- Repair disconnections or leaks at joints and where the vent connector joins a masonry chimney.
- Measure the size of the vent connector and chimney and compare to vent-sizing information listed in Chapter 13 of the *National Fuel Gas Code (NFPA 54)*. A vent connector or chimney liner that is either too large or too small can reduce draft.
- If wind interferes with draft, install a wind-dampening chimney cap.
- If the masonry chimney is corroded, install a new chimney liner.
- Increase the pitch of horizontal sections of vent.


**Table 8-2: Combustion Problems and Possible Solutions**

<b>Problem</b>	<b>Possible causes and solutions</b>
Spillage with CAZ depressurization	Return duct leaks, clothes dryer, exhaust fans, other combustion vents. Seal return leaks. Isolate CAZ. Provide make-up air.
Spillage with no CAZ depressurization	Chimney or vent connector is blocked, leaky, incorrectly sized, or has inadequate slope. Or else CAZ is too airtight.
Excessive CO	Mixture too rich or too lean. Adjust gas pressure. Check chimney and combustion air for code compliance.
Stack temperature or temperature rise too high or low	Adjust fan speed or gas pressure. Improve ducts to increase airflow.
Oxygen too high or low	Adjust gas pressure, but don't increase CO level.

## 8.1.6 Zone Isolation for Atmospherically Vented Appliances

An isolated CAZ improves the safety of atmospherically vented appliances. The CAZ is isolated if it receives combustion air only from outdoors. An isolated CAZ doesn't require worst-case depressurization and spillage tests. However you should inspect the CAZ for connections with the home's main zone and make sure it is isolated.

1. Look for connections between the isolated CAZ and the home. Examples include joist spaces, transfer grills, leaky doors, and holes for ducts or pipes.
2. Measure a base pressure from the CAZ to outdoors.
3. Perform 50-pascal blower door depressurization test with the combustion appliances disabled. The CAZ-to-outdoors pressure should not change more than 5 pascals during the blower door test.
4. If the CAZ-to-outdoors pressure changed more than 5 pascals, air-seal the zone, and retest as described in steps 2 and 3.
5. If you can't air-seal the CAZ adequately to isolate the zone, solve worst-case depressurization and spillage problems as described in *"Mitigating CAZ Depressurization and Spillage"* on page 258.

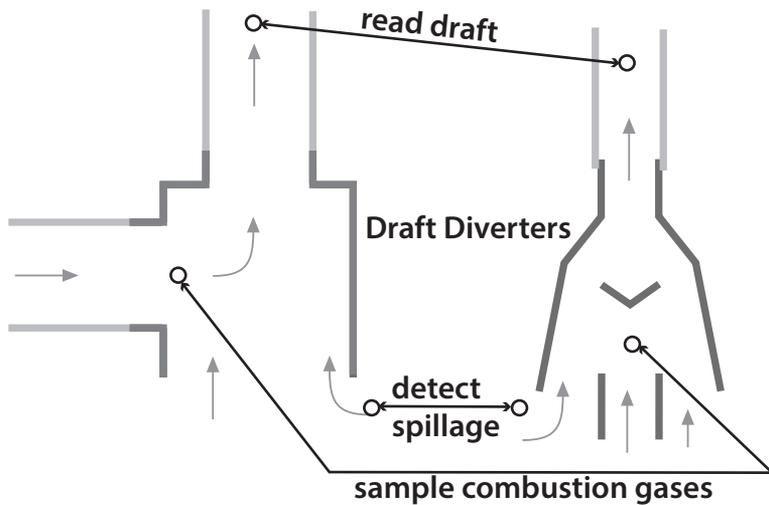


**Testing locations:** This illustration shows two draft diverters and the locations (circles) for draft testing, spillage detection, and sampling of combustion gases.


## 8.2 ELECTRONIC COMBUSTION ANALYSIS

*SWS Detail: 5.3003.2 Combustion Analysis of Oil-Fired Appliances, 5.3003.14 Combustion Analysis of Gas-Fired Appliances (LP and Natural Gas), 2.0201.2 Combustion Safety*

The goal of a combustion analysis is to quickly analyze combustion safety and efficiency. When the combustion heater reaches steady-state efficiency (SSE), you can measure its most critical combustion parameters. This information saves time and informs both service and installation adjustments.

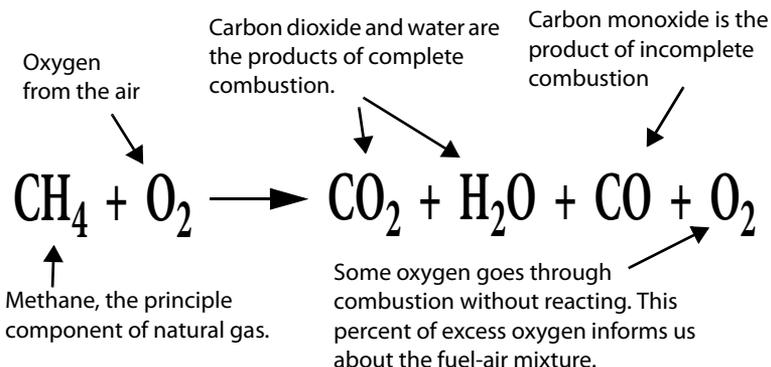

Modern flue-gas analyzers measure O<sub>2</sub>, CO, and flue-gas temperature. Some models also measure draft. Flue-gas analyzers also calculate combustion efficiency or steady-state efficiency (SSE), which are synonymous.

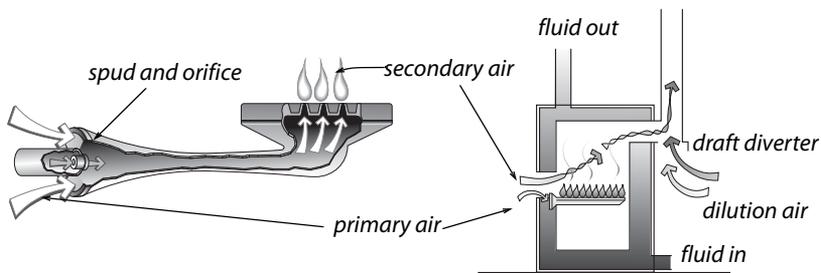

**Atmospheric, open combustion gas burners:** Combustion air comes from the indoors in open combustion appliances. These burners use the heat of the flame to pull combustion air into the burner. Dilution air, entering at the draft diverter, prevents overfire draft from becoming excessive.



**70+ Furnace:** Sample flue gases within the draft diverter inside each exhaust port.



**80+ Furnace:** Measure draft and sample flue gases in the vent connector above the furnace.

## 8.2.1 Critical Combustion-Testing Parameters

These furnace-testing parameters tell you how efficient and safe the furnace currently is and how much you might be able to improve efficiency. Use these measurements to analyze the combustion process.

*Carbon monoxide (CO) (ppm):* Poisonous gas indicates incomplete combustion. Modern combustion analyzers let you choose between a normal flue gas and air measurement (as measured) or a corrected measurement that calculates the concentration in theoretical **air-free** flue gases. Adjusting combustion to produce less than 100 ppm air-free is almost always possible with fuel-pressure adjustments, air adjustments, or burner maintenance.

*Oxygen (percent):* Indicates the percent of excess air and whether fuel-air mixture is within a safe and efficient range. Efficiency increases as oxygen decreases because excess air, indicated by the  $O_2$  carries heat up the chimney. Percent  $O_2$  may also indicate the cause of CO as either too little or too much

combustion air. Technicians used to measure CO<sub>2</sub>, but O<sub>2</sub> is easier to measure, and you only need to measure one of these two gases.

*Flue-gas temperature:* Flue-gas temperature is directly related to furnace efficiency. Too high flue-gas temperature wastes energy and too-low flue-gas temperature causes corrosive condensation in the venting system.

*Smoke number:* For oil only, this measurement compares the stain made by flue gases with a numbered stain-darkness rating called smoke number. Smoke number should be 1 or lighter on a 1-to-10 smoke scale.

*Draft:* The pressure in the chimney or vent connector (chimney draft or breech draft). Also the pressure in the combustion chamber (over-fire draft), used primarily with oil power burners.

**Table 8-3: Combustion Standards for Gas Furnaces and Boilers**

<b>Performance Indicator</b>	<b>SSE 70+</b>	<b>SSE 80+</b>	<b>SSE 90+</b>
Carbon monoxide (CO) parts per million (ppm air-free)	<100 ppm	<100 ppm	<100 ppm
Stack temperature (°F)	350°–475°	325°–450°	<120°
Oxygen (%O <sub>2</sub> )	5–10%	4–9%	4–9%
Natural gas pressure inches water column (IWC)	3.2–4.2 IWC*	3.2–4.2 IWC*	3.2–4.2 IWC*
LP gas pressure	10–12 IWC	10–12 IWC	10–12 IWC
Steady-state efficiency (SSE) (%)	72–78%	78–82%	92–97%
Chimney draft (IWC, Pa)	–0.020 IWC –5 Pa	–0.020 IWC –5 Pa	0.100– 0.250 IWC +25–60 Pa

\* pmi = per manufacturer's instructions

Use these standards also for boilers except for temperature rise.

[See "Minimum Oil Burner Combustion Standards" on page 288.](#)

**Table 8-4: Carbon Monoxide Causes and Solutions**

<b>Cause</b>	<b>Analysis &amp; Solution</b>
Flame smothered by combustion gases.	Chimney backdrafting from CAZ depressurization or chimney blockage.
Burner or pilot flame impinges.	Align burner or pilot burner. Reduce gas pressure if excessive.
Inadequate combustion air with too rich fuel-air mixture.	O <sub>2</sub> is <6%. Gas input is excessive or combustion air is lacking. Reduce gas or add combustion air.
Blower interferes with flame.	Inspect heat exchanger. Replace furnace or heat exchanger.
Primary air shutter closed.	Open primary air shutter.
Dirt and debris on burner.	Clean burners.
Excessive combustion air cooling flame.	O <sub>2</sub> is >11%. Increase gas pressure.

## 8.3 HEATING SYSTEM REPLACEMENT

This section discusses replacing combustion furnaces and boilers. We'll also discuss gas heating-replacement and oil-heating-replacement specifications.

### 8.3.1 Combustion Furnace Replacement

*SWS Detail: 5.3001.1 Load Calculation and Equipment Selection, 5.3001.2 Ductwork and Termination Design, 5.3002.1 Preparation for New Equipment, 5.3003.1 Data Plate Verification*

This section discusses air handlers of combustion furnaces and also heat pumps. Successful air-handler replacement requires selecting the right heat (and cooling) input, blower model, and blower speed. The installation must include making repairs to ducts and other remaining components, and testing to verify that the new air handler operates correctly.

## Preparation

- ✓ Recover refrigeration in the existing heating-cooling unit according to EPA regulations.
- ✓ Disconnect and remove the furnace or heat pump, attached air-conditioning equipment, and other materials that won't be reused.
- ✓ Transport these materials off the customer's property to a recycling facility.
- ✓ Verify that all accessible ducts were sealed as part of the furnace's installation, including the air handler, the plenums, and the branch ducts.


## Equipment Selection

- ✓ Evaluate the building to determine the correct size of the furnace, using ACCA Manual J or equivalent method.
- ✓ Select the air handler using ACCA Manual S or equivalent method along with manufacturers' air-handler specifications.
- ✓ Select the supply and return registers using ACCA Manual T or equivalent method.


## Air-Handler Installation

- ✓ Install MERV 6 or higher filter in the new furnace.
- ✓ The filter retainer must hold the filter firmly in place.
- ✓ The filter must be easy to replace.
- ✓ The filter must provide complete coverage of blower intake or return register. Filter compartment must not permit air to bypass the filter.
- ✓ If flue-gas temperature or supply air temperature are unusually high, check static pressure and fuel input. *See "Ducted Air Distribution" on page 315.*


- ✓ Attach the manufacturer's literature including, operating manual and service manual, to the furnace.

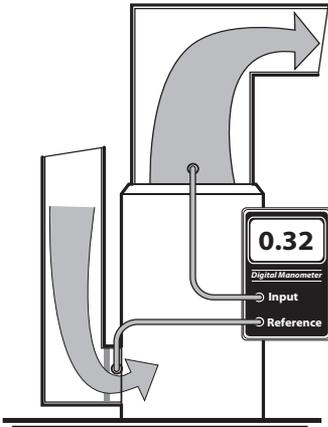

**Static pressure and temperature rise:** Measure static pressure and temperature rise across the new furnace to verify that the duct system isn't restricted. The correct airflow, specified by the manufacturer, is necessary for high efficiency.

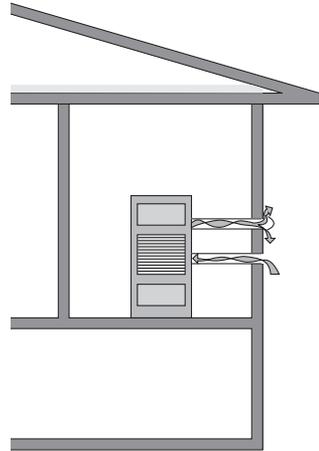

**Sealed combustion heaters:** Sealed-combustion furnaces prevent the air pollution and house depressurization caused by some open-combustion furnaces.

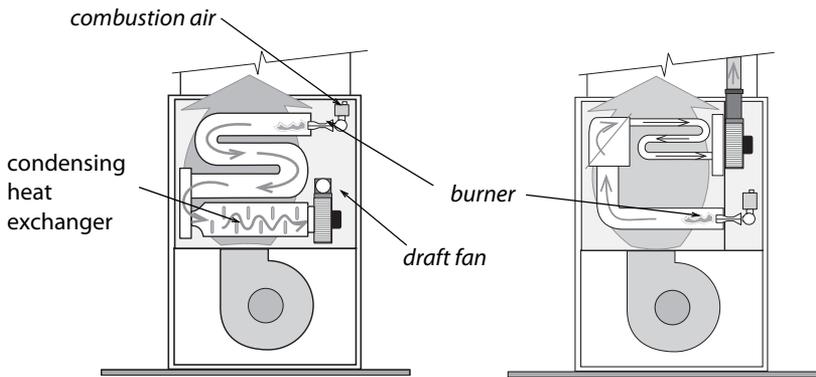

**90+ Gas furnace:** A 90+ furnace has a condensing heat exchanger and a stronger draft fan for pulling combustion gases through its more restrictive heat exchanger and establishing a strong positive draft.

**80+ Gas furnace:** An 80+ furnace has a restrictive heat exchanger and draft fan, but has no draft diverter and no standing pilot light.

## Supporting Air Handlers

Support the new air handlers using these specifications.

- Support horizontal air handlers from below with a non-combustible, water-proof, and non-wicking material. Or support the horizontal air handler with angle iron and threaded rod from above.
- Support upflow air handlers with a non-combustible material from below when necessary to hold it above a damp basement floor.
- Support downflow air handlers with a strong, airtight supply plenum. Insulate this supply plenum on the exterior of the plenum.


## 8.3.2 Gas-Fired Heating Installation

*SWS Detail: 2.0201.2 Combustion Safety, 5.3003.14 Combustion Analysis of Gas-Fired Appliances (LP and Natural Gas)*

The goals of gas-appliance replacement are to save energy and improve heating safety. The heating replacement project should produce a gas-fired heating system in virtually new condition, even though existing components like the gas lines, chimney, pipes, or wiring may remain.

Include maintenance or repair of existing components as part of the installation. Analyze design defects in the original system, and correct the defects during the heating system's replacement.

- If possible, install a condensing sealed-combustion (direct vent) furnace or boiler with a 90+ AFUE.
- Install non-condensing furnaces and boilers with a minimum AFUE of 80% if the 90% replacement unit isn't cost-effective or practical.
- Install new gas-fired unit with adequate clearances to allow maintenance.
- Follow manufacturer's venting instructions along with the National Fuel Gas Code (NFPA 54) to install a proper venting system. *See "Inspecting Venting Systems" on page 297.*
- Check clearances of the heating unit and its vent connector to nearby combustibles, according to NFPA 54. *See page 297.*
- Measure the new unit's gas input and adjust the gas input if necessary.

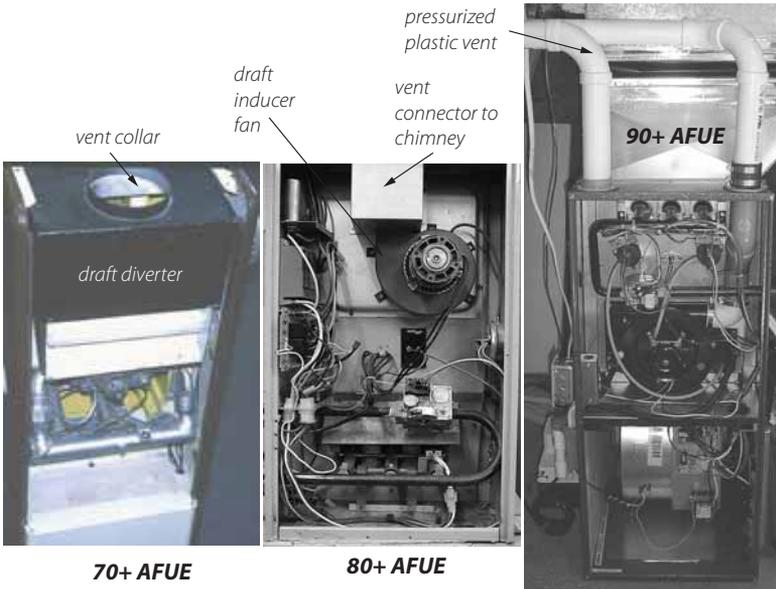

**Gas furnace evolution:** Energy auditors should be able to identify the 3 types of gas and propane furnaces. Only the 90+ AFUE furnace has a pressurized vent. The two earlier models vent into traditional atmospheric chimneys.

## Testing New Gas-Fired Heating Systems

- ✓ If needed, have a properly licensed HVAC technician do a combustion test, and adjust fuel-air mixture to minimize  $O_2$ . However don't increase CO with this adjustment. [See pages 254 and 282.](#)
- ✓ Measure CO in the new venting system.
- ✓ Verify that the gas water heater vents properly after installation of a sealed-combustion or horizontally vented furnace or boiler. Install a chimney liner if necessary to provide right-sized venting for the water heater.

## 8.3.3 Combustion Boiler Replacement

*SWS Details: 2.0105.1 Combustion Worker Safety, 5.3001.1 Load Calculation and Equipment Selection, 5.3101.2 Space Load Calculation—Heat Emitter Sizing*

Technicians replace boilers as an energy-conservation measure or for health and safety reasons.


Boiler piping and controls present many options for zoning, boiler staging, and energy-saving features. Dividing homes into zones, with separate thermostats, can significantly improve energy efficiency compared to operating a single zone.

Follow these specifications when recommending a replacement boiler.

### Design

A boiler's seasonal efficiency is more sensitive to correct sizing than is a furnace's efficiency.

- ✓ Determine the correct size of the boiler, using ACCA Manual J and considering the installed radiation surface connected to the boiler.
- ✓ Consider weatherization work that reduced the heating load serviced by the previous boiler when sizing the new boiler.
- ✓ Size new radiators according to room heat loss and design water temperature.
- ✓ Specify radiator temperature controls (RTCs) for areas with a history of overheating.
- ✓ A functioning pressure-relief valve, expansion tank, air-excluding device, back-flow preventer, and an automatic fill valve must be part of the new hydronic system.

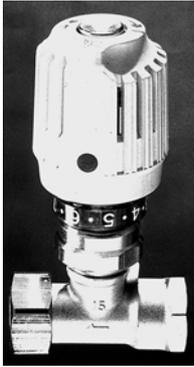


**Radiator temperature control:**  
RTCs work well for controlling room temperature, especially in overheated rooms.

## Pump and Piping

- ✓ Verify that all supply piping is insulated with foam or fiberglass pipe insulation.
- ✓ Suggest that the pump be installed near the downstream side of the expansion tank to prevent the suction side of the pump from depressurizing the piping, which can pull air into the piping system.
- ✓ Replace the expansion tank, unless it's the proper size for the new system. Adjust the expansion tank for the correct pressure during boiler installation. [See page 344.](#)
- ✓ Extend new piping and radiators to conditioned areas, like additions and finished basements, which are currently heated by space heaters.

## Controls

- ✓ Maintaining a low-limit boiler-water temperature is wasteful. Boilers should be controlled for a cold start, unless the boiler is used for domestic water heating.
- ✓ For large boilers, install reset controllers that adjust supply water temperature according to outdoor temperature and prevent the boiler from firing when the outdoor temperature is above a setpoint where heat isn't needed.

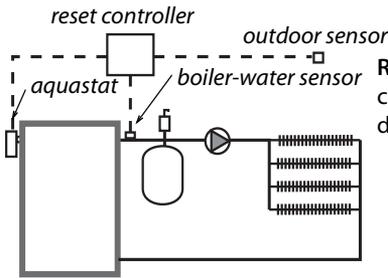


**Reset controller:** This control adjusts circulating-water temperature depending on the outdoor temperature.

- ✓ Verify that return-water temperature is above 130° F for gas and above 150° F for oil, to prevent acidic condensation within the boiler, unless the boiler is designed for condensation. Install piping bypasses, mixing valves, primary-secondary piping, or other strategies, as necessary, to prevent condensation within a non-condensing boiler.

### Combustion Testing

- ✓ Inspect the chimney and upgrade it if necessary.
- ✓ Verify that flue-gas oxygen and temperature are within the ranges specified in these two tables.
  - a. *“Combustion Standards for Gas Furnaces and Boilers” on page 265*
  - b. *“Minimum Oil Burner Combustion Standards” on page 288*

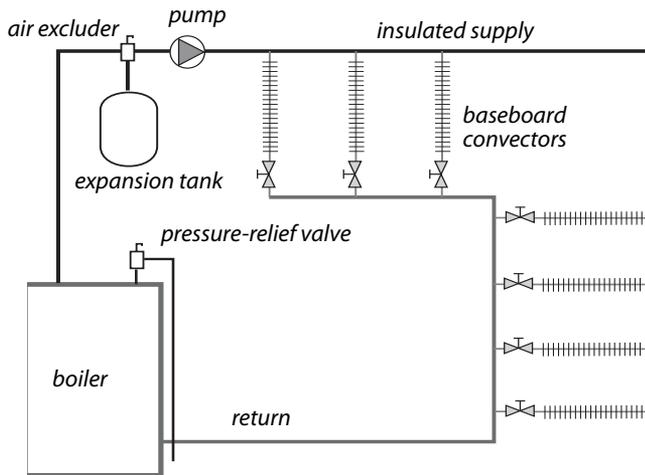

**Simple reverse-return hot-water system:** The reverse-return method of piping is the simplest way of balancing flow among the heat emitters.

## Steam Boilers

Steam-boiler performance is heavily dependent on the performance of the existing steam distribution system. The boiler installer should know how the distribution system performed when it was connected to the old boiler.

The new boiler's water line should be at the same height as the old boiler's water line, or the installers should know how to compensate for the difference in water-line levels. [See "Steam Heating and Distribution" on page 347.](#)

### 8.3.4 Oil-Fired Heating Installation

*SWS Detail: 2.0201.2 Combustion Safety, 2.0203.3 Draft Regulation—Category I Appliance, 5.3003.9 Heating and Cooling Controls, 5.3003.4 Evaluating Electrical Service, 5.3003.2 Combustion Analysis of Oil-Fired Appliances*


Oil-heating replacement should provide an oil-fired heating system in virtually new condition, even though components like the oil tank, chimney, piping, and wiring may remain in place.

Any maintenance or repair for these remaining components should be part of the replacement job. Analyze design defects of the original system, and correct them during the heating-system replacement.

- ✓ New oil-fired furnaces and boilers should have an AFUE of 83%.
- ✓ Install new oil-fired furnaces and boilers with adequate clearances to facilitate maintenance.
- ✓ Inspect the existing chimney and the vent connector. Replace the vent connector with Type L double-wall vent pipe.
- ✓ Install a stainless steel chimney liner if necessary. See *"Special Venting Considerations for Gas"* on page 307.

**Oil heating system:**

Components of an oil heating system may need replacement, repair, or cleaning during replacement of the furnace or boiler.

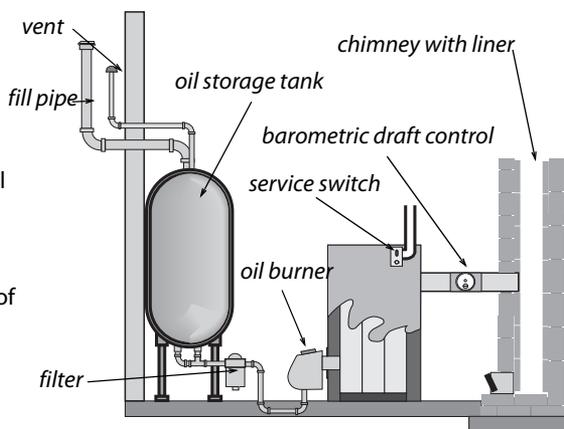


- ✓ Verify that the clearances between the vent connector and nearby combustibles are adequate. See *"Clearances to Combustibles for Vent Connectors"* on page 299.
- ✓ Install a new fuel filter, and purge the fuel lines as part of the new installation.

## Controls

- ✓ Verify that a working emergency shut-off is installed in the living space.
- ✓ Look for a control that interrupts power to the burner in the event of a fire.
- ✓ Measure the transformer voltage to verify that it complies with the manufacturer's specifications.
- ✓ Measure the control circuit amperage, and adjust the thermostat's heat anticipator to match the amperage. Or, follow the thermostat manufacturer's instructions for adjusting cycle length.

## Testing New Oil-Fired Heating Systems

- ✓ Measure the oil pressure.
- ✓ Look for the oil nozzle's gallon-per-minute (gpm) rating.
- ✓ Adjust oil pressure or replace nozzle as necessary to produce the correct input and to limit the flue-gas temperature.

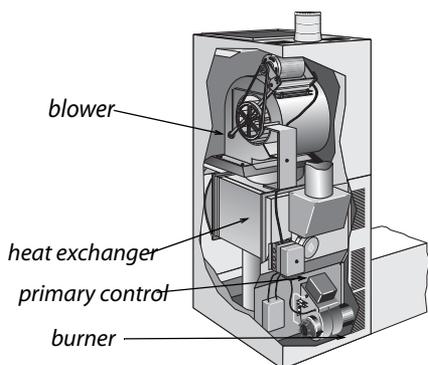

### **Oil-fired downflow furnaces:**

Their design hasn't changed much in recent years except for the flame-retention burner.

- ✓ Verify that the spray angle and spray pattern fit the size and shape of the combustion chamber.

- ✓ Adjust oxygen, flue-gas temperature, and smoke number to match manufacturer's specifications or specifications given here. Smoke number should be zero on all modern oil-fired equipment.

### 8.3.5 Evaluating Oil Tanks

Inspect the oil tank, and remove dirt and moisture at bottom of the tank. Verify that the oil tank and oil lines comply with NFPA 31.

Oil tanks are now almost always installed above ground. But many old oil tanks are still buried. Inspect above-ground tanks to find leaks.

Below-ground tanks and above-ground tanks can both be evaluated by tests for water in the fuel system.

1. Start by inspecting the oil filter for corrosion. Corrosion in the oil filter indicates a high probability of water and corrosion in the tank.
2. Next use water-finding paste, applied to the end of a probe, to detect water at the bottom of the oil tank. For indoor tanks, you'll need a flexible probe because of the ceiling-height limitations.

*See also NFPA 31 Chapter 7 Fuel Oil Tanks.*

#### Inspecting Above-Ground Oil Tanks

Indoor oil leaks are usually accompanied by petroleum smells. Inspect the oil tank as well as all the oil piping between the oil tank and the oil-fired furnace.

- ✓ Look for different colors on the tank from condensation, corrosion, or fuel leaks.
- ✓ Look at the bottom of the oil tank and see if oil is dripping from a leak.
- ✓ Look for patches from previous leaks.

- ✓ If the oil tank is new, don't mistake previous oil-tank leaks for leaks in the new tank.
- ✓ Use the water test described previously.

If you smell oil but you can't see the leak, consider the following tests.

- ✓ Use the water test described previously.
- ✓ For hidden leaks, consider ultrasound leak detection by a oil-tank specialist.

### Advice for Below-Ground Oil Tanks


Leaky below-ground oil tanks are a financial problem and a major environmental problem. Local, state, or federal authorities may require homeowners to remove the tank, abandon it in place, or have it leak-tested by one of the following methods.

- ✓ Use the water testing described previously.
- ✓ A tank specialist collects multiple soil samples from around the tank and analyzes them for petroleum contamination by an approved method.

## 8.4 COMBUSTION SPACE HEATER REPLACEMENT

### *SWS Detail: 2.0201.2 Combustion Safety*

Space heaters are inherently more efficient than central heaters, because they have no ducts or distribution pipes.

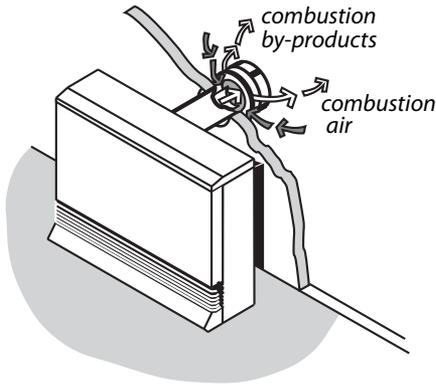

**Sealed-combustion space heater:** Sealed-combustion space heaters draw combustion air in, using a draft fan.



**Space heater controls:** Many modern energy-efficient space heaters have programmable thermostats as a standard feature.

Weatherization agencies replace space heaters as an energy-conservation measure or for health and safety reasons. Choose a sealed-combustion space heater. Inspect existing space heaters for health and safety problems.

- ✓ If power outages are common, select a space heater that will work without electricity.
- ✓ Follow manufacturer's venting instructions carefully. Don't vent sealed-combustion or induced-draft space heaters into naturally drafting chimneys.
- ✓ Verify that flue-gas oxygen and temperature are within the ranges specified in [Table 8-3 on page 265](#).
- ✓ If the space heater sits on a carpeted floor, install a fire-rated floor protector.
- ✓ Install the space heater away from traffic, draperies, and furniture.
- ✓ Provide the space heater with a correctly grounded duplex receptacle for its electrical service.

### 8.4.1 Space Heater Operation

Inform the customer of the following operating instructions.

- ✓ Don't store any objects near the space heater that would restrict airflow around it.
- ✓ Don't use the space heater to dry clothes or for any purpose other than heating the home.
- ✓ Don't allow anyone to lean or sit on the space heater.
- ✓ Don't spray aerosols near the space heater. Many aerosols are flammable or can cause corrosion to the space heater's heat exchanger.

## 8.4.2 Unvented Space Heaters

*SWS Detail: 2.0202.1 Unvented Space Heaters: Propane, Natural Gas, and Kerosene Heaters, 2.0401.1 Air Sealing Moisture Precautions*

Unvented space heaters include ventless gas fireplaces and gas logs installed in fireplaces previously designed for wood-burning or coal-burning. These unvented space heaters create indoor air pollution because they deliver all their combustion byproducts to the indoors. Unvented space heaters aren't safe. Replace them with vented space heaters or electric space heaters.

DOE forbids unvented space heaters as primary heating units in weatherized homes and mobile homes. However, unvented space heaters may be used as secondary heaters, under these four requirements.

1. The heater must have an input rating less than 40,000 BTUH.
2. If located in a bedroom, the heater must have an input rating of less than 10,000 BTUH.
3. The heater must be equipped with an oxygen-depletion sensor.
4. The room containing the heater must have adequate combustion air.

5. Home must have adequate ventilation: See *“Whole-Building Ventilation”* on page 374.

## 8.5 GAS BURNER SAFETY & EFFICIENCY SERVICE

Gas burners should be inspected and maintained during a service call. These following specifications apply to gas furnaces, boilers, water heaters, and space heaters.

### 8.5.1 Combustion Efficiency Test for Furnaces

Perform the following procedures at steady-state efficiency (SSE) to verify a furnace’s correct operation.

- Perform a combustion test using a electronic flue-gas analyzer. Recommended flue-gas temperature depends on the type of furnace and is listed in the table titled, *“Combustion Standards for Gas Furnaces and Boilers”* on page 265.
- Measure temperature rise (supply minus return temperatures). Temperature rise should be within the manufacturer’s specifications for a furnace or boiler: between 30° and 70°.
- If O<sub>2</sub> is high, or the estimated output from the table is low, increase gas pressure to 6% O<sub>2</sub> if possible as long as you don’t create CO.
- Increase gas pressure if needed to increase temperature rise and flue-gas temperature.

If you know the airflow through the furnace from measurements described in *“Ducted Air Distribution”* on page 315, you can use the table, *“Gas Furnace Output Table”* on page 496, to check whether output is approximately what the manufacturer intended. Dividing this output by measured input as described above gives you another check on the steady-state efficiency.

## 8.5.2 Inspecting Gas Combustion Equipment

Perform the following inspection procedures on all gas-fired furnaces, boilers, water heaters, and space heaters, as necessary.


- ✓ Look for soot, melted wire insulation, and rust in the burner and manifold inside and outside the burner compartment. These signs indicate flame roll-out, combustion gas spillage, CO, and incomplete combustion.
- ✓ Inspect the burners for dust, debris, misalignment, flame-impingement, and other flame-interference problems. Clean, vacuum, and adjust as needed.
- ✓ Inspect the heat exchanger for cracks, holes, or leaks.
- ✓ Verify that furnaces and boilers have dedicated circuits with fused safety shutoffs near the appliance. Verify that all 120-volt wiring connections are enclosed in covered electrical boxes.
- ✓ Verify that pilot is burning (if equipped) and that main burner ignition is satisfactory.
- ✓ Check venting system for proper diameter and pitch. [See page 297.](#)
- ✓ Check venting system for obstructions, blockages, or leaks.
- ✓ Observe flame characteristics. Flames should be blue and well shaped. If flames are white or yellow, the burner may suffer from faulty combustion.

## 8.5.3 Testing and Adjustment

The goal of these measures is to reduce carbon monoxide (CO), stabilize flame, and verify the operation of safety controls.

- ✓ Do an electronic combustion analysis and note the oxygen, CO, and flue-gas temperature.
- ✓ Test for spillage or measure draft. Take action to improve the draft if it is inadequate because of improper venting,

obstructed chimney, leaky chimney, or depressurization.  
*See page 258.*

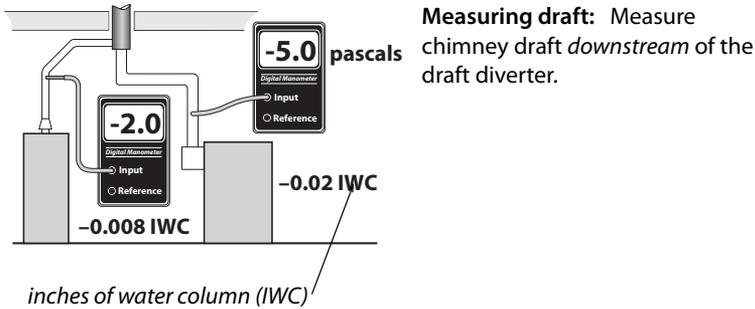

- ✓ If you measure CO and the measured oxygen level is low, open a window while observing CO level on the meter to see if CO is reduced by increasing the available combustion air through the open window. *See page 310.*
- ✓ Adjust gas input if combustion testing indicates over-firing or under-firing.
- ✓ For programmable thermostats, read the manufacturer's instructions about how to control cycle length. These instructions may be printed inside the thermostat.

## Burner Cleaning

Clean and adjust the burner if any of these conditions exists.

- CO is greater than 100 ppm air-free measurement.
- Visual indicators of soot or flame roll-out exist.
- Burners are visibly dirty.
- Measured draft is inadequate. *See page 297.*
- The appliance has not been serviced for two years or more.


## Maintenance and Cleaning

Gas-burner and gas-venting maintenance should include the following measures.

- ✓ Remove causes of CO and soot, such as over-firing, closed primary air intake, flame impingement, and lack of combustion air.
- ✓ Remove dirt, rust, and other debris that may be interfering with the burners. Clean the heat exchanger if there are signs of soot around the burner compartment.
- ✓ Seal leaks in vent connectors and chimneys.

## 8.6 OIL BURNER SAFETY AND EFFICIENCY SERVICE

Oil burners require annual maintenance to maintain acceptable safety and combustion efficiency. Use combustion analysis to evaluate the oil burner and to guide adjustment and maintenance. These procedures apply to oil-fired furnaces, boilers, and water heaters. Use other test equipment as discussed to measure other essential operating parameters and to make adjustments as necessary.

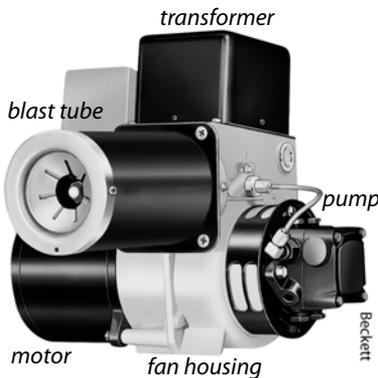

**Oil Burners:** Oil burners are power burners that atomize the oil by pumping it through a nozzle. A blower forces combustion air into the oil mist. Electrodes powered by a transformer light the mixture.

### 8.6.1 Oil Burner Testing and Adjustment

*SWS Detail: 5.3003.2 Combustion Analysis of Oil-Fired Appliances*


Unless the oil-fired heating unit is very dirty or disabled, technicians should do combustion testing and adjust the burner for safe and efficient operation.

## Combustion Testing and Adjustment

Combustion testing is essential to understanding the current oil burner performance and potential for improvement.

- ✓ Sample the undiluted flue gases with a smoke tester, after reading the smoke tester instructions. Compare the smoke smudge left by the gases on the filter paper with the manufacturer's smoke-spot scale to find the smoke number.
- ✓ If the smoke number is higher than 3, take steps to reduce smoke before sampling the gases with a combustion analyzer to prevent the smoke from fouling the analyzer.
- ✓ Sample undiluted flue gases between the barometric draft control and the appliance. Analyze the flue gas for O<sub>2</sub>, flue-gas temperature, CO, and steady-state efficiency (SSE).
- ✓ Measure the overfire draft over the fire inside the firebox through a plug in the heating unit.
- ✓ A flue gas temperature more than 450° F is a sign that a clean heating unit is oversized. Exceptions: steam boilers and boilers with tankless coils. If the nozzle is oversized, replace the burner nozzle after selecting the correct nozzle size, spray angle, and spray pattern.
- ✓ Adjust the barometric damper for a negative overfire draft of -0.020 IWC or -5 pascals at a test plug in the heating unit.
- ✓ Adjust the air shutter to achieve the oxygen and smoke values, specified in [Table 8-5 on page 288](#).
- ✓ Adjust oxygen, flue-gas temperature, CO, and smoke number to match manufacturer's specifications or speci-

cations given here. Smoke number should be near zero on all modern oil-fired equipment.

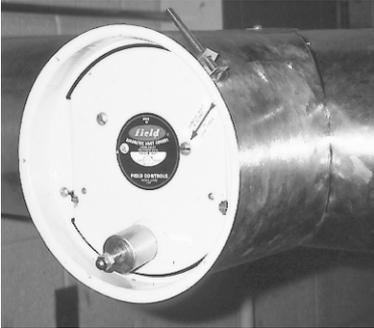

**Barometric draft control:** This control provides a stable overfire draft and controlled flow of combustion gases through the heat exchanger.

Table 8-5: Minimum Oil Burner Combustion Standards

<b>Oil Combustion Performance Indicator</b>	<b>Non Flame Retention</b>	<b>Flame Retention</b>
Oxygen (% O <sub>2</sub> )	4–9%	4–7%
Stack temperature (°F)	350°–600°	325°–500°
Carbon monoxide (CO) parts per million (ppm air-free)	≤100 ppm	≤ 100 ppm
Steady-state efficiency (SSE) (%)	≥ 75%	≥ 80%
Smoke number (1–9)	≤ 2	≤ 1
Excess air (%)	≤ 100%	≤ 25%
Oil pressure pounds per square inch (psi)	≥ 100 psi	≥ 100–150 psi (pmi)*
Atmospheric venting: Overfire draft (negative)	–.020 IWC or –5 Pa.	> –.020 IWC or > –5 Pa.
Positive-pressure burner with atmospheric chimney and barometric control: Over-fire draft (positive)	n/a	or 0.020 to 0.120 IWC 5 to 30 Pa. (pmi)*
Positive-pressure burner with horizontal vent and without a barometric control: Over-fire draft (positive)	n/a	or 0.20 to 0.60 IWC 50 to 150 Pa. (pmi)*
* pmi = per manufacturer’s specifications		

### Other Efficiency Testing and Adjustment

- ✓ Adjust the gap between electrodes and their angle for proper alignment.
- ✓ Measure the control-circuit amperage. Adjust the thermostat’s heat anticipator to match the amperage, or read the thermostat manufacturer’s instructions for adjusting cycle length.

- ✓ Measure the oil-pump pressure, and adjust it to manufacturer's specifications if necessary.
- ✓ Measure the transformer voltage, and adjust it to manufacturer's specifications if necessary.
- ✓ Adjust the airflow or the water flow to reduce high flue-gas temperature if possible, but don't reduce flue-gas temperature below 350°F.

## 8.6.2 Oil Burner Inspection and Maintenance

### *SWS Detail: 5.3003.4 Evaluating Electrical Service*

Use visual inspection and combustion testing to evaluate oil burner operation. An oil burner that passes visual inspection and complies with the specifications on [page 288](#) may need no maintenance. Persistent unsatisfactory test results may indicate the need to replace the burner or the entire oil-fired heating unit.

#### Safety Inspection, Testing, and Adjustment

- ✓ Verify that each oil furnace or boiler has a dedicated electrical circuit. Assure that all 120-volt wiring connections are enclosed in covered electrical boxes.
- ✓ Inspect burner and appliance for signs of soot, overheating, fire hazards, corrosion, or wiring problems.
- ✓ Inspect heat exchanger and combustion chamber for cracks, corrosion, or soot buildup.
- ✓ If the unit smells excessively of oil, test for oil leaks and repair the leaks.
- ✓ Time the flame sensor control or stack control to verify that the burner shuts off, within either 45 seconds or a time specified by the manufacturer, when the cad cell is blocked from seeing the flame.

- ✓ Measure the high limit shut-off temperature and adjust or replace the high limit control if the shut-off temperature is more than 200° F for furnaces, or 220° F for hot-water boilers.


## Oil Burner Maintenance

After evaluating the oil burner's operation, specify some or all of these maintenance tasks as necessary, to optimize safety and efficiency.

- ✓ Clean the burner's blower wheel.
- ✓ Clean dust, dirt, and grease from the burner assembly.
- ✓ Replace oil filter(s) and nozzle.
- ✓ Clean or replace air filter.
- ✓ Remove soot from combustion chamber.
- ✓ Remove soot from heat exchange surfaces.
- ✓ Adjust gap between electrodes to manufacturer's specs.
- ✓ Check if the nozzle and the fire ring of the flame-retention burner is appropriate for the size of the combustion chamber.
- ✓ Repair the ceramic combustion chamber, or replace it if necessary.
- ✓ Verify correct flame sensor operation.

After these maintenance procedures, the technician carries out the diagnostic tests described previously to evaluate improvement made by the maintenance procedures and to

determine whether more adjustment or maintenance is required.

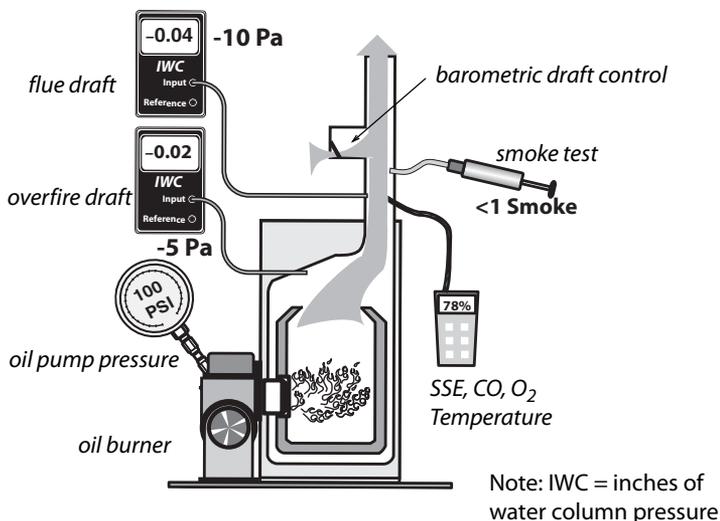


**Measuring oil-burner performance:** Measuring oil-burning performance requires, a manometer, flue-gas analyzer, smoke tester, and pressure gauge.

## 8.7 INSPECTING FURNACE HEAT EXCHANGERS

Leaks in heat exchangers are a common problem, causing the flue gases to mix with house air. Ask customers about respiratory problems, flue-like symptoms, and smells in the house when the heat is on. Also, check around supply registers for signs of soot, especially with oil heating. All furnace heat exchangers should be inspected as part of weatherization. Consider using one or more of these six options for evaluating heat exchangers.

1. Look for rust at exhaust ports and vent connectors.
2. Look for flame-impingement on the heat exchanger during firing and flame-damaged areas near the burner flame.

3. Observe flame movement, change in chimney draft, or change in CO measurement when blower is activated and deactivated.
4. Measure the flue-gas oxygen concentration before the blower starts and then again just after the blower starts. There should be no more than a 1% change in the oxygen concentration.
5. Examine the heat exchanger by shining a bright light on one side and looking for light on the other side using a mirror to look into tight locations.
6. Employ chemical detection techniques, according to the manufacturer's instructions.

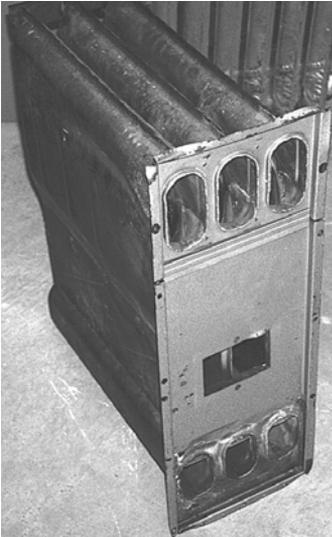

**Furnace heat exchangers:** Although no heat exchanger is completely airtight, it should not leak enough to display the warning signs described here.

## 8.8 WOOD STOVES

Wood heating is a popular and effective auxiliary heating source for homes. However, wood stoves and fireplaces can cause indoor air pollution and fire hazards. Inspect wood stoves to evaluate potential hazards.

## 8.8.1 Wood Stove Clearances

Stoves that are listed by a testing agency like Underwriters Laboratory have installation instructions stating their clearance from combustibles. Unlisted stoves must adhere to clearances specified in NFPA 211.

## 8.8.2 Stove Clearances

Look for metal tags on the wood stove that list minimum clearances. Listed wood stoves may be installed to as little as 6 inches away from combustibles, if they incorporate heat shields and combustion design that directs heat away from the stove's back and sides.

Unlisted stoves must be at least 36 inches away from combustibles. Ventilated or insulated wall protectors may decrease unlisted clearance from one-third to two thirds, according to NFPA 211. Always follow the stove manufacturer's or heat-shield manufacturer's installation instructions.

## Floor Construction and Clearances

The floor of a listed wood stove must comply with the specifications on the listing (metal tag). Modern listed stoves usually sit on a 1-inch thick non-combustible floor protector that extends 18 inches beyond the stove in front.

The floor requirements for underneath a unlisted wood stove depends on the clearance between the stove and the floor, which depends on the length of its legs. Unlisted wood stoves must have floor protection underneath them unless they rest on a floor of non-combustible construction. An example of a non-combustible floor is one composed of only masonry material sitting on sand or gravel.

An approved floor protector is either one or two courses of hollow masonry material (4 inches thick) with a non-combustible quarter-inch surface of steel or other non-combustible material on top of the masonry. This floor for a non-listed wood stove

must extend no less than 18 inches beyond the stove in all directions.

## Vent-Connector and Chimney Clearance

Interior masonry chimneys require a 2-inch clearance from combustibles and exterior masonry chimneys require a 1-inch clearance from combustibles. All-fuel metal chimneys (insulated double-wall or triple wall) usually require a 2-inch clearance from combustibles.

Double-wall stove-pipe vent connectors require a 9-inch clearance from combustibles or a clearance listed on the product. Single wall vent connectors must be at least 18 inches from combustibles. Wall protectors may reduce this clearance up to two-thirds.


See also *“Wood Stove Clearances” on page 293* and *“Stove Clearances” on page 293*.

## 8.8.3 Wood Stove Inspection

All components of wood stove venting systems should be approved for use with wood stoves. Chimney sections penetrating floor, ceiling, or roof should have approved thimbles, support packages, and ventilated shields to protect nearby combustible materials from high temperatures. Perform or specify the following inspection tasks.

- ✓ Inspect stove, vent connector, and chimney for correct clearances from combustible materials as listed on stoves and vent assemblies or as specified in NFPA 211.
- ✓ Each wood stove must have its own dedicated flue pipe. Two wood stoves may not share a single flue.
- ✓ If the home is tight (<0.35 ACH), the wood stove should be equipped with a dedicated outdoor combustion-air duct.

- ✓ Inspect vent connector and chimney for leaks. Leaks should be sealed with a high temperature sealant designed for sealing wood stove vents.
- ✓ Galvanized-steel pipe must not be used to vent wood stoves.
- ✓ Inspect chimney and vent connector for creosote build-up, and suggest chimney cleaning if creosote build-up exists.
- ✓ Inspect the house for soot on seldom-cleaned horizontal surfaces. If soot is present, inspect the wood stove door gasket. Seal stove air leaks or chimney air leaks with stove cement. Improve draft by extending the chimney to reduce indoor smoke emissions.
- ✓ Inspect stack damper and/or combustion air intake damper.
- ✓ Check catalytic converter for repair or replacement if the wood stove has one.
- ✓ Assure that heat exchange surfaces and flue passages within the wood stove are free of accumulations of soot or debris.
- ✓ Wood stoves installed in manufactured homes must be approved for use in manufactured homes.

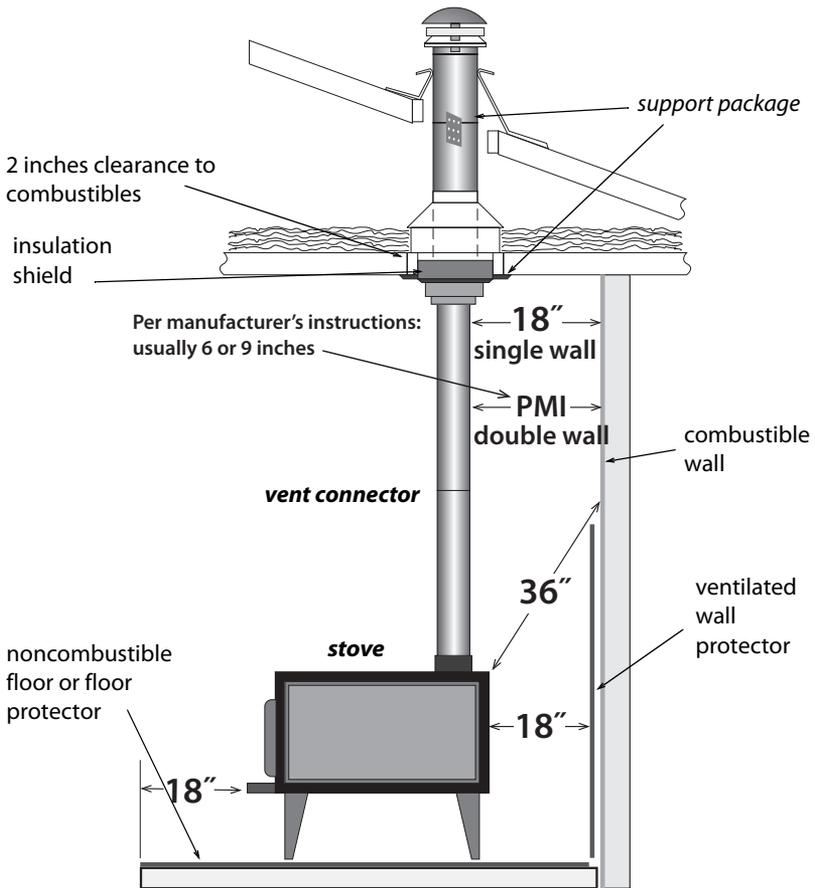

**Wood-stove installation:** Wood-stove venting and clearances are vitally important for wood-burning safety. Read manufacturer's instructions for the stove and its venting components.

## 8.9 INSPECTING VENTING SYSTEMS

Combustion gases are vented through vertical chimneys or other types of approved horizontal or vertical vent piping. Identifying the type of existing venting material, verifying the correct size of vent piping, and making sure the venting conforms to the applicable codes are important tasks in inspecting and repairing venting systems. Too large a vent often leads to condensation and corrosion. Too small a vent can result in spillage. The wrong vent materials can corrode or deteriorate from heat.

### NFPA Codes

The National Fire Protection Association (NFPA) publishes authoritative information on material-choice, sizing, and clearances for chimneys and vent connectors, as well as for combustion air. The information in this venting section is based on the following NFPA documents.

- NFPA 54: *The National Fuel Gas Code 2009*
- NFPA 31: *Standard for the Installation of Oil-Burning Equipment 2006*
- NFPA 211: *Standard for Chimneys, Fireplaces, Vents, and Solid-Fuel-Burning Appliances 2006*

### 8.9.1 Vent Connectors

A vent connector connects the appliance's venting outlet collar with the chimney. Approved vent connectors for gas-fired units are made from the following materials.

- Type-B vent, consisting of a galvanized steel outer pipe and aluminum inner pipe for gas-fired units.
- Type-L vent connector with a stainless-steel inner pipe and a galvanized-steel outer pipe for oil-fired units.

- Double-wall stove-pipe vent connector with a stainless-steel inner pipe and a black-steel outer pipe for solid-fuel units.
- Galvanized steel pipe for gas or oil-fired units only: See table.

**Table 8-6: Single-Wall Galvanized Vent Connector Thickness**

<b>Diameter of Vent Connector (inches)</b>	<b>Inches (gauge)</b>
5 and smaller	0.022 (26 gauge)
6 to 10	0.028 (24 gauge)
11 to 16	0.034 (22 gauge)
Larger than 16	0.064 (16 gauge)

From *International Mechanical Code 2009*

Double-wall vent connectors are the best option, especially for appliances with some non-vertical vent piping. A double-wall vent connector maintains flue gas temperature and prevents condensation. Gas appliances with draft hoods, installed in attics or crawl spaces must use a Type-B vent connector. Use Type-L double-wall vent pipe for oil vent connectors in attics and crawl spaces.

### Vent-Connector Requirements

Verify that vent connectors comply with these specifications.

- Vent connectors must be as large as the vent collar on the appliances they vent.
- Single wall vent-pipe sections must be fastened together with 3 screws or rivets.
- Vent connectors must be sealed tightly where they enter masonry chimneys.
- Vent connectors must be free of rust, corrosion, and holes.

- Maintain minimum clearances between vent connectors and combustibles.

**Table 8-7: Clearances to Combustibles for Vent Connectors**

Vent Connector Type	Clearance
Single wall galvanized steel vent pipe	6" (gas), 18" (oil)
Type-B double wall vent pipe (gas)	1" (gas)
Type L double wall vent pipe	3" or as listed (oil)
Single-wall stove pipe	18" (wood)
Double-wall stove pipe	9" or as listed (wood)

- The chimney combining two vent connectors must have a cross-sectional area equal to the area of the larger vent connector plus half the area of the smaller vent connector. This common vent must be no larger than 7 times the area of the smallest vent. For specific vent sizes, see the NFPA codes listed on [page 297](#).

**Table 8-8: Areas of Round Vents**

Vent diameter	4"	5"	6"	7"	8"
Vent area (square inches)	12.6	19.6	28.3	38.5	50.2


- The horizontal length of vent connectors shouldn't be more than 75% of the chimney's vertical height or have more than 18 inches horizontal run per inch of vent diameter.
- Vent connectors must have upward slope to their connection with the chimney. NFPA 54 requires a slope of at least  $\frac{1}{4}$ -inch of rise per foot of horizontal run so that combustion gases rise through the vent. The slope also prevents condensation from collecting in the vent and corroding it.

**Table 8-9: Connector Diameter vs. Maximum Horizontal Length**

Diam (in)	3"	4"	5"	6"	7"	8"	9"	10"	12"	14"
Length (ft)	4.5'	6'	7.5'	9'	10.5'	12'	13.5'	15'	18'	21'

From *International Fuel Gas Code 2000*

- When two vent connectors connect to a single chimney, the vent connector servicing the smaller appliance should enter the chimney above the vent for the larger appliance.

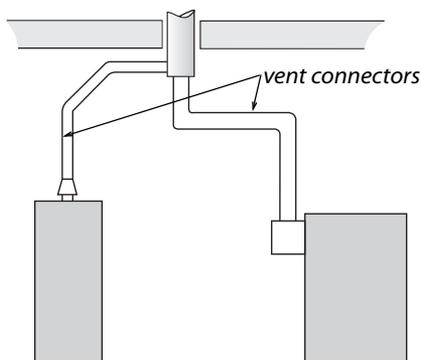

**Two vent connectors joining chimney:** The water heater's vent connector enters the chimney above the furnace because the water heater has a smaller input.

## 8.10 CHIMNEYS


There are two common types of vertical chimneys for venting combustion fuels that satisfy NFPA and ICC codes. First there are masonry chimneys lined with fire-clay tile, and second there are manufactured metal chimneys, including all-fuel metal chimneys, Type-B vent chimneys for gas appliances, and Type L chimneys for oil appliances.

### 8.10.1 Masonry Chimneys

#### *SWS Detail: 2.0203.2 Combustion Flue Gas—Orphaned Water Heaters*

Verify the following general specifications for building, inspecting, and repairing masonry chimneys.

- A masonry chimney should support every masonry chimney.
- Existing masonry chimneys should be lined with a fireclay flue liner. There should be a  $\frac{1}{2}$ -inch to 1-inch air gap between the clay liner and the chimney's masonry to insulate the liner. The liner shouldn't be bonded structurally to the outer masonry because the liner needs to expand and contract independently of the chimney's masonry structure. The clay liner can be sealed to the chimney cap with a flexible high-temperature sealant.

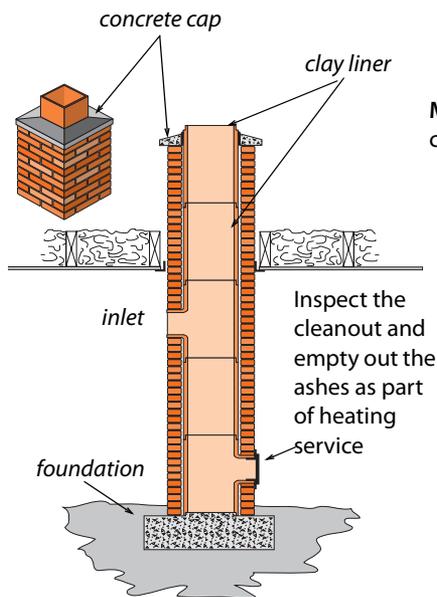


**Masonry chimneys:** Remain a very common vent for all fuels.

- Masonry chimneys should have a cleanout 12 inches or more below the lowest inlet. Clean mortar and brick dust out of the bottom of the chimney through the clean-out door, so that this debris won't eventually interfere with venting.
- Seal the chimney's penetrations through floors and ceilings with sheet metal and high-temperature sealant as a fire-stop and air barrier.

- Re-build deteriorated or unlined masonry chimneys as specified above or reline them as part of a heating-system replacement or a venting-safety upgrade. Or, install a new metal chimney instead of repairing the existing masonry chimney.

## Metal Liners for Masonry Chimneys

Install or replace liners in unlined masonry chimneys or chimneys with deteriorated liners as part of heating system replacement. Orphaned water heaters may also need a chimney liner because the existing chimney may be too large. Use a correctly sized Type-B vent, a flexible or rigid stainless-steel liner, or a flexible aluminum liner.

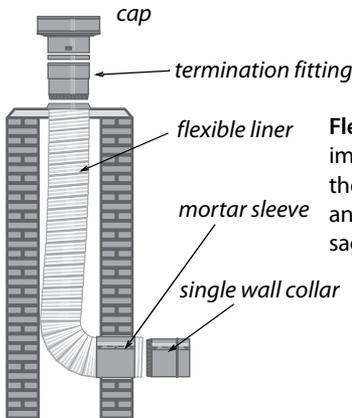

**Flexible metal chimney liners:** The most important installation issues are sizing the liner correctly along with fastening and supporting the ends to prevent sagging.

Flexible liners require careful installation to avoid a low spot at the bottom, where the liner turns a right angle to pass through the wall of the chimney. Comply with the manufacturer's instructions, which usually require stretching the liner and fastening it securely at both ends, to prevent the liner from sagging and creating a low spot.

Flexible liners are easily damaged by falling masonry debris inside a deteriorating chimney. Use B-vent, L-vent, or single-

wall stainless steel pipe instead of a flexible liner when the chimney is significantly deteriorated.

To minimize condensation, insulate the flexible liner — especially when installed in exterior chimneys. Consider fiberglass-insulation jackets or perlite, if the manufacturer's instructions allow. Wood-stove chimney liners must be stainless steel and insulated.

Sizing flexible chimney liners correctly is very important. Oversizing is common and can lead to condensation and corrosion. The manufacturers of the liners include vent-sizing tables in their specifications. Liners should display a label from a testing lab like Underwriters Laboratories (UL).

**Masonry chimneys as structural hazards:** A building owner may want to consider reinforcing a deteriorated chimney by re-pointing masonry joints or parging the surface with reinforced plaster. Other options include demolishing the chimney or filling it with concrete to prevent it from collapsing during an earthquake and damaging the building.

### Solutions for Failed Chimneys

Sometimes a chimney is too deteriorated to be re-lined or repaired. In this case, abandon the old chimney and install one of the following.

- A double-wall horizontal sidewall vent, equipped with a barometric draft control and a power venter mounted on the exterior wall. Maintain a 4-foot clearance between the ground and the vent's termination if you live where it snows.
- A new heating unit, equipped with a power burner or draft inducer, that is designed for horizontal or vertical venting.

**Table 8-10: Clearances to Combustibles for Common Chimneys**

<b>Chimney Type</b>	<b>Clearance</b>
Interior chimney masonry w/ fireclay liner	2"
Exterior masonry chimney w/ fireclay liner	1"
All-fuel metal vent: insulated double-wall or triple-wall pipe	2"
Type B double-wall vent (gas only)	1"
Type L double-wall vent (oil)	3"
Manufactured chimneys and vents list their clearances.	

### 8.10.2 Manufactured Chimneys

Manufactured metal chimneys have engineered parts that fit together in a prescribed way. Parts include: metal pipe, weight-supporting hardware, insulation shields, roof jacks, and chimney caps. One manufacturer's chimney may not be compatible with another's connecting fittings.

All-fuel chimneys (also called Class A chimneys) are used primarily for the solid fuels: wood and coal. All-fuel metal chimneys come in two types: insulated double-wall metal pipe and triple-wall metal pipe. Comply with the manufacturer's specifications when you install these chimneys.



**All-fuel metal chimney:** These chimney systems include transition fittings, support brackets, roof jacks, and chimney caps. The pipe is double-wall insulated or triple-wall construction.




Type-B vent double-wall pipe is permitted as a chimney for gas appliances. Type BW pipe is manufactured for gas space heaters in an oval shape to fit inside wall cavities.

Type L double-wall pipe is used for oil chimneys.

### 8.10.3 Chimney Terminations

Masonry chimneys and all-fuel metal chimneys should terminate at least three feet above the roof penetration and two feet above any obstacle within ten feet of the chimney outlet.

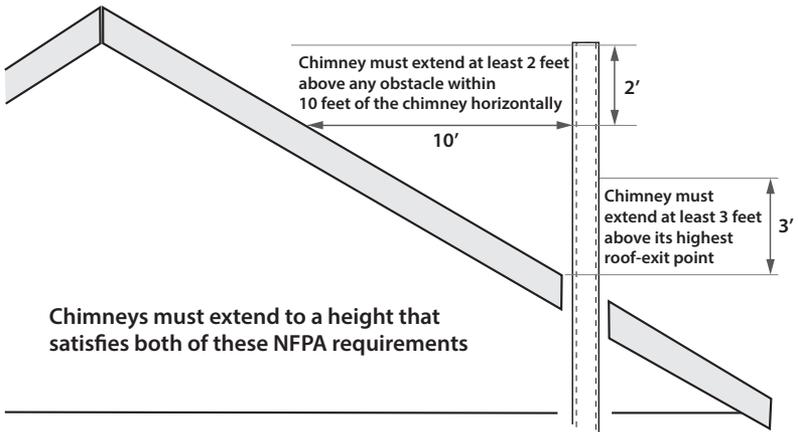

**Chimney terminations:** Should have vent caps and be given adequate clearance height from nearby building parts. These requirements are for both masonry chimneys and manufactured all-fuel chimneys.

B-vent chimneys can terminate as close as one foot above flat roofs and above pitched roofs up to a  $\frac{6}{12}$  roof pitch. As the pitch rises, the minimum required termination height, as measured from the high part of the roof slope, rises as shown in this table.

**Table 8-11: Roof Slope and B-Vent Chimney Height (ft)**

flat- 6/12	6/12- 7/12	7/12- 8/12	8/12- 9/12	9/12- 10/12	10/12- 11/12	11/12- 12/12	12/12- 14/12	14/12- 16/12	16/12- 18/12
1'	1' 3"	1' 6"	2'	2' 6"	3' 3"	4'	5'	6'	7'


From *National Fuel Gas Code 2009*

## 8.10.4 Air Leakage through Masonry Chimneys

### *SWS Detail: 4.1001.3 Fireplace Chimney and Combustion Flue Vents*

The existing fireplace damper or “airtight” doors seldom provide a good air seal. Help the customer decide whether the fireplace will be used in the future or whether it can be taken out of service. Consider these solutions for chimneys with ineffective or missing dampers.

- Install an inflatable chimney seal along with a notice of its installation to alert anyone wanting to start a fire to remove the seal first.
- Install an operable chimney-top damper and leave instructions on how to open and close it. Also notify users of which position is open and which is closed.
- Air seal the chimney top from the roof with a watertight, airtight seal. Also seal the chimney from the living space with foam board and drywall. If you install a permanent chimney seal such as this, post a notice at the fireplace saying that it is permanently disabled.

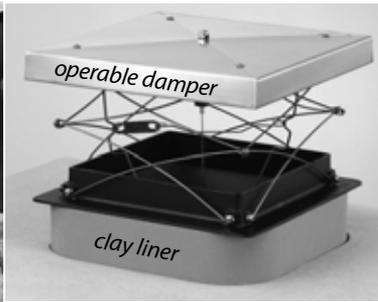

**Reducing air leakage through masonry chimneys:** You can seal a chimney off permanently, install an inflatable seal inside, or install a chimney-top damper from the outside to reduce air leakage through the chimney.

## 8.11 SPECIAL VENTING CONSIDERATIONS FOR GAS

The American Gas Association (AGA) publishes a classification system for venting systems attached to natural-gas and propane appliances. This classification system assigns Roman numerals to four categories of venting based on whether there is positive or negative pressure in the vent and whether condensation is likely to occur in the vent.

**AGA venting categories:**  
The AGA classifies venting by whether there is positive or negative pressure in the vent and whether condensation is likely.

	Negative-pressure Venting	Positive-pressure
Non-condensing	<p>I</p> <p>Combustion Efficiency <b>83% or less</b></p> <p>Use standard venting: masonry or Type B vent</p>	<p>III</p> <p>Combustion Efficiency <b>83% or less</b></p> <p>Use only pressurizable vent as specified by manufacturer</p>
Condensing	<p>II</p> <p>Combustion Efficiency <b>over 83%</b></p> <p>Use only special condensing-service vent as specified by manufacturer</p>	<p>IV</p> <p>Combustion Efficiency <b>over 83%</b></p> <p>Use only pressurizable condensing-service vent as specified by manufacturer</p>
American Gas Association Vent Categories		

A majority of gas appliances found in homes and multifamily buildings are Category I, which have negative pressure in their vertical chimneys. We expect no condensation in the vent connector or chimney.


Condensing furnaces are usually Category IV, have positive pressure in their vent, and condensation occurring in both the appliance and vent. Category III vents are rare, however a few fan-assisted furnaces and boilers vent their flue gases through airtight non-condensing vents. Category II vents are very rare and beyond the scope of this discussion.

### 8.11.1 Venting Fan-Assisted Furnaces and Boilers

Newer gas-fired fan-assisted central furnaces and boilers eliminate dilution air and may have slightly cooler flue gases compared to their predecessors. The chimney may experience more condensation than in the past. Inspect the existing chimney to verify that it's in good condition when considering replacing an old atmospheric unit. Reline the chimney when you see any of these conditions.

- When the existing masonry chimney is unlined.
- When the old clay or metal chimney liner is deteriorated.
- When the new furnace has a smaller input (BTUH) than the old one, the liner should be sized to the new furnace and the existing water heater.

**B-vent chimney liner:** Double wall Type-B vent is the most commonly available chimney liner and is recommended over flexible liners. Rigid stainless-steel single wall liners are also a permanent solution to deteriorated chimneys.

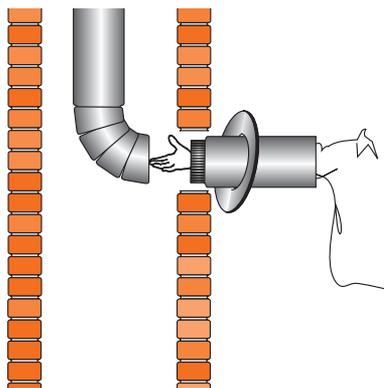

### Liner Materials for 80+ Furnaces

For gas-fired 80+ AFUE furnaces, a chimney liner should consist of one of these four materials.

1. A type-B vent
2. A rigid or flexible stainless steel liner (preferably insulated)
3. A poured masonry liner
4. An insulated flexible aluminum liner

Chimney relining is expensive. Therefore consider a power-vented sealed-combustion unit when an existing chimney is inadequate for a new fan-assisted appliance.

**Table 8-12: Characteristics of Gas Furnaces and Boilers**

<b>Annual Fuel Utilization Efficiency (AFUE)</b>	<b>Operating characteristics</b>
70+	Category I, draft diverter, no draft fan, standing pilot, non-condensing, indoor combustion and dilution air.
80+	Category I, no draft diverter, fan-assisted draft, electronic ignition, indoor combustion air, no dilution air.
80+	Category III, horizontal fan-pressurized non-condensing vent, indoor combustion air, no dilution air.
90+	Category IV, no draft diverter, fan-assisted draft, low-temperature plastic venting, positive draft, electronic ignition, condensing heat exchanger, outdoor combustion air is strongly recommended.

## 8.12 COMBUSTION AIR

### *SWS Detail: 2.0203.1 Combustion Air for Natural Draft Appliances*

A combustion appliance zone (CAZ) is classified as either an un-confined space or confined space. An un-confined space is a CAZ having the NFPA-required amount of room volume that is assumed to provide enough combustion air. A confined space is a CAZ with less than the NFPA-required amount of volume.

A confined space is defined by NFPA 54 as a room containing one or more combustion appliances that has less than 50 cubic feet of volume for every 1000 BTUH of appliance input.

For confined spaces, the NFPA 54 requires additional combustion air from outside the CAZ. Combustion air is supplied to the combustion appliance in four ways.

1. To an un-confined space through leaks in the building.
2. To a confined space through an intentional opening or openings between the CAZ and other indoor areas where air leaks replenish combustion air.
3. To a confined space through an intentional opening or openings between the CAZ and outdoors or ventilated intermediate zones like attics and crawl spaces.
4. Directly from the outdoors to the appliance. Appliances with direct combustion air supply are called sealed-combustion or direct vent appliances.

**Important Note:** The National Fuel Gas Code (NFPA 54 – 2009) presents two methods for calculating combustion air. The simplest of the two methods is discussed in this section. We discuss this method because mechanical inspectors often refer to it. However, neither method really predicts the amount of available combustion air.

### 8.12.1 Un-Confined-Space Combustion Air

Combustion appliances located in most basements, attics, and crawl spaces get adequate combustion air from leaks in the building shell. Even when a combustion appliance is located within the home's living space, it gets adequate combustion air from air leaks, unless the house is airtight or the combustion zone is depressurized.


### 8.12.2 Confined-Space Combustion Air

A confined space is defined by NFPA 54 as a room containing one or more combustion appliances that has less than 50 cubic feet of volume for every 1000 BTUH of appliance input.

However, if a small mechanical room is connected to adjacent spaces through large air passages like floor-joist spaces, the CAZ may not need additional combustion air despite sheeted walls and a door separating the CAZ from other indoor spaces. You

can measure the connection between the CAZ and other spaces by worst-case draft testing or blower door pressure testing.

When the home is relatively airtight ( $<0.40$  ACHn), the CAZ may not have adequate combustion air, even when the combustion zone is larger than the minimum confined-space room volume.

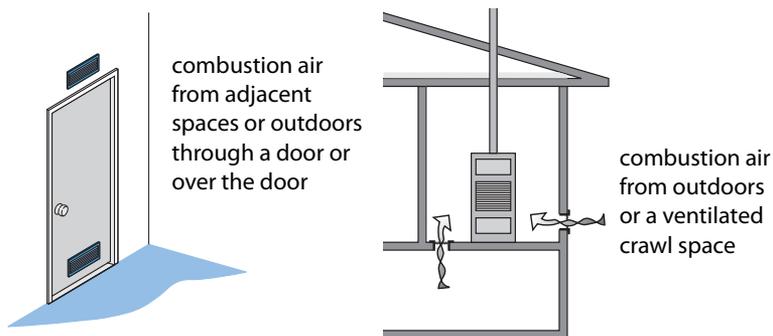

**Passive combustion air options:** Combustion air can be supplied from adjacent indoor spaces or from outdoors. Beware of passive combustion air vents into the attic that could depressurize the combustion zone or allow moist indoor air to travel into the attic. Also beware of taking combustion air from wet crawl spaces.

## Combustion Air from Outdoors

In confined spaces or airtight homes where combustion appliances need outdoor combustion air, NFPA 54 prefers a single vent opening installed as low in the CAZ as practical. A combustion air vent into an attic may depressurize the CAZ and deliver warm moist air from the CAZ into a cold attic. Instead, connect the combustion zone to a ventilated crawl space (if it's dry) or directly to the outdoors through a single low vent if possible.

For the intake, choose an outdoor location that is sheltered from prevailing winds, but not in an inside corner. Don't choose an exterior wall that is parallel to prevailing winds. Wind blowing

parallel to the exterior wall or at a right angle to the vent opening de-pressurizes both the vent and the CAZ connected to it.

**Table 8-13: Combustion Air Openings: Location and Size**

Location	Dimensions
Two direct openings to adjacent indoor space	Minimum area each: 100 in <sup>2</sup> 1 in <sup>2</sup> per 1000 BTUH each Combined room volumes must be ≥ 50 ft <sup>3</sup> /1000 BTUH
Two direct openings or vertical ducts to outdoors	Each vent should have 1 in <sup>2</sup> for each 4000 BTUH
Two horizontal ducts to outdoors	Each vent should have 1 in <sup>2</sup> for each 2000 BTUH
Single direct or ducted vent to outdoors	Single vent should have 1 in <sup>2</sup> for each 3000 BTUH

From the *National Fuel Gas Code 2009 (NFPA 54)*

Net free area is smaller than actual vent area and takes the blocking effect of louvers and grilles into account. Metal grilles and louvers provide 60% to 80% of their area as net-free area while wood louvers provide only 20% to 25%. Combustion-air vents should be no less than 3 inches in their smallest dimension.

### Example Combustion Air Calculation

Here is an example of one indoor space providing combustion air to another indoor space. The furnace and water heater are located in a confined space. The furnace has an input rating of 100,000 BTUH. The water heater has an input rating of 40,000 BTUH. Therefore, there should be 140 in<sup>2</sup> of net free area of vent between the mechanical room and other rooms in the home.

$$((100,000 + 40,000) \div 1,000) = 140 \times 1 \text{ IN}^2 = 140 \text{ IN}^2$$

Each vent should therefore have a minimum of 140 in<sup>2</sup> net free area. If a metal grill covers 60% of the opening's area, divide the 140 in<sup>2</sup> by 0.60.

$$140 \text{ IN}^2 / 0.6 = 233 \text{ IN}^2$$

## 8.13 DUCTED AIR DISTRIBUTION

The forced-air system consists of an air handler (furnace, heat pump, air conditioner) with its heat exchanger along with attached ducts. The annual system efficiency of forced-air heating and air-conditioning systems depends on the following issues.

- Duct leakage
- System airflow
- Blower operation
- Balance between supply and return air
- Duct insulation levels

### 8.13.1 Sequence of Operations

The evaluation and improvement of ducts has a logical sequence of steps.

- ✓ Solve the airflow problems because a contractor might have to replace ducts or install additional ducts.
- ✓ Determine whether the ducts are located inside the thermal boundary or outside it.
- ✓ Evaluate the ducts' air leakage and decide whether duct-sealing is important and if so, find and seal the duct leaks.
- ✓ If supply ducts are outside the thermal boundary or if condensation is an air-conditioning problem, insulate the ducts.

### 8.13.2 Solving Airflow Problems

*SWS Detail: 5.3003.3 Evaluating Air Flow*

You don't need test instruments to discover dirty blowers or disconnected branch ducts. Find these problems before measuring


duct airflow, troubleshooting the ducts, or sealing the ducts. These steps precede airflow measurements.

1. Ask the customer about comfort problems and temperature differences in different rooms of the home.
2. Based on the customer's comments, look for disconnected ducts, restricted ducts, and other obvious problems.
3. Inspect the filter(s), blower, and indoor coil for dirt. Clean them if necessary. If the indoor coil isn't easily visible, a dirty blower means that the coil is probably also dirty.
4. Look for dirty or damaged supply and return grilles that restrict airflow. Clean and repair them.
5. Look for closed registers or closed balancing dampers that could be restricting airflow to uncomfortable rooms.
6. Notice moisture problems like mold and mildew. Moisture sources, like a wet crawl space, can overpower air conditioners by introducing more moisture into the air than the air conditioner can remove.

### Measuring Total External Static Pressure (TESP)


The blower creates the duct pressure, which is measured in inches of water column (IWC) or pascals. The return static pressure is negative and the supply static pressure is positive. Total external static pressure (TESP) is the sum of the absolute values of the supply and return static pressures. Absolute value means that you ignore the positive or negative signs when adding supply static pressure and return static pressure to get TESP. This addition represents the distance on a number line as shown in the illustration here.

**TESP number line:** the TESP represents the distance on a number line between the return and supply ducts.

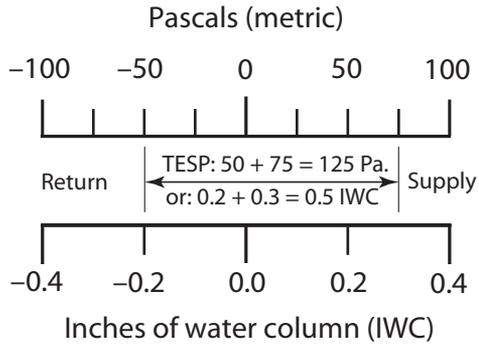

TESP gives a rough indicator of whether airflow is adequate. The greater the TESP, the less the airflow. The supply and return static pressures by themselves can indicate whether the supply or the return or both sides are restricted. For example, if the supply static pressure is 0.10 IWC (25 pascals) and the return static pressure is -0.5 IWC (-125 pascals), you can assume that most of the airflow problems are due to a restricted or under-sized return. The TESP give a rough estimate of airflow if the manufacturer’s graph or table for static pressure versus airflow is available.

1. Attach two static pressure probes to tubes leading to the two ports of the manometer. Attach the high-side port to the probe inserted downstream of the air handler in the supply duct. The other tube goes upstream of the air handler in the return duct. The manometer adds the supply and return static pressures to measure TESP.
2. Consult manufacturer’s literature for a table of TESP versus airflow for the blower or the air handler. Find airflow for the TESP measured in Step 1.
3. Measure pressure on each side of the air handler to obtain both supply and return static pressures separately. This test helps to locate the main problems as related to either the supply or the return.

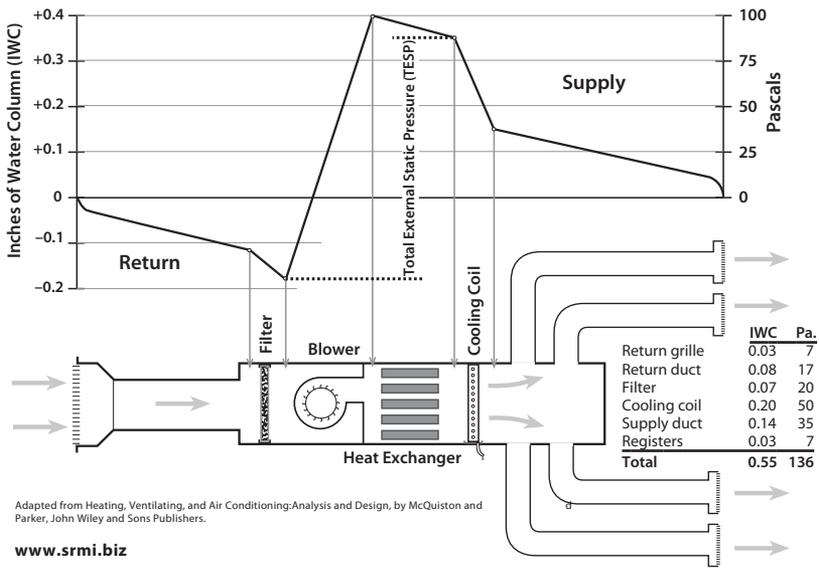

Adapted from Heating, Ventilating, and Air Conditioning: Analysis and Design, by McQuiston and Parker, John Wiley and Sons Publishers.


www.srmi.biz

**Visualizing TESP:** The blower creates a suction at its inlet and a positive pressure at its outlet. As the distance between the measurement and blower increase, pressure decreases because of the system's lower resistance.


### Static Pressure Guidelines

Air handlers deliver their airflow at TESP's ranging from 0.30 IWC (75 Pascals) to 1.0 IWC (250 Pascals) as found in the field. Manufacturers maximum recommended static pressure is usually a maximum 0.50 IWC (125 pascals) for standard air handlers. TESP's greater than 0.50 IWC indicate inadequate airflow in standard residential forced-air systems.

The popularity of pleated filters, electrostatic filters, and high-static high-efficiency evaporator coils, prompted manufacturers to introduce premium air handlers that can deliver adequate airflow at a TESP's of greater than 0.50 IWC (125 pascals). Premium residential air handlers can provide adequate airflow with TESP's of up to 0.90 IWC (225 pascals) because of their more powerful blowers and variable-speed blowers. TESP's greater than 0.90 IWC indicate the possibility of inadequate airflow in these premium residential forced-air systems.

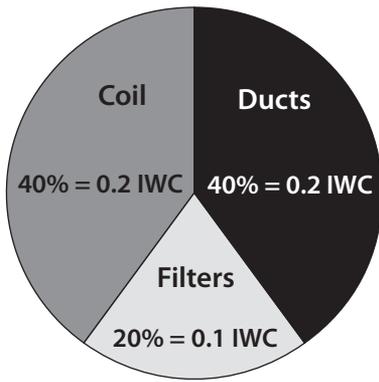

**Static pressure budget:** Typical static pressures in IWC and % for a marginally effective duct system.

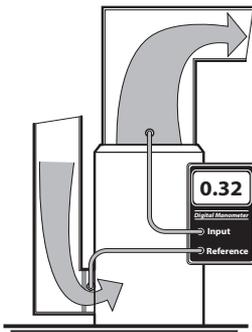

**Total external static pressure (TESP):** The positive and negative pressures created by the resistance of the supply and return ducts produces TESP. The measurement shown here simply adds the two static pressures without regard for their signs. As TESP increases, airflow decreases. Numbers shown below are for example only.

**Table 8-14: Total External Static Pressure Versus System Airflow for a Particular System**

<b>TESP (IWC)</b>	0.30	0.40	0.50	0.60	0.70	0.80
<b>CFM</b>	995	945	895	840	760	670

*Example only*

### 8.13.3 Unbalanced Supply-Return Airflow Test

Closing interior doors often separates supply registers from return registers in homes with central returns. A bedroom door with no return register and a closed door restricts the bedroom air from returning to the air handler. This restriction pressurizes bedrooms and depressurizes the central areas near return registers. These pressures can drive air leakage through the building

shell, create moisture problems, and bring pollutants in from the crawl space, garage, or CAZ.

The following test uses only the air handler and a digital manometer to evaluate whether the supply air can flow back to the return registers relatively unobstructed. Activate the air handler and close interior doors.



1. Measure the pressure difference between the home's central living area and the outdoors with a digital manometer.
2. Measure the bedrooms' pressure difference with reference to outdoors.

If the sum of these two measurements is more than 3.0 pascals with the air handler operating, pressure relief is desirable. Like TESP, disregard the positive or negative signs, and add the absolute values.

- Or, you can measure the pressure difference between the central zone and the bedroom as shown in the next illustration.


To estimate the amount of pressure relief needed, slowly open the bedroom door until the pressure difference drops below 1 pascal.

Estimate the surface area of that door opening. This is the area of the permanent opening required to provide pressure relief. Pressure relief may include undercutting the door or installing transfer grilles or jumper ducts.

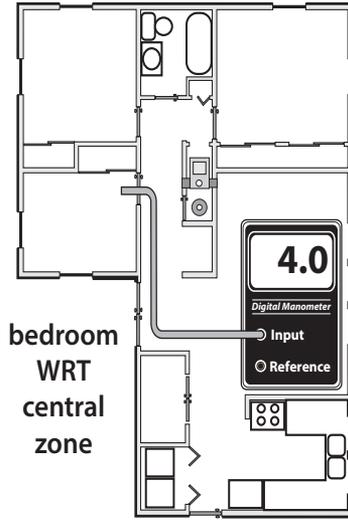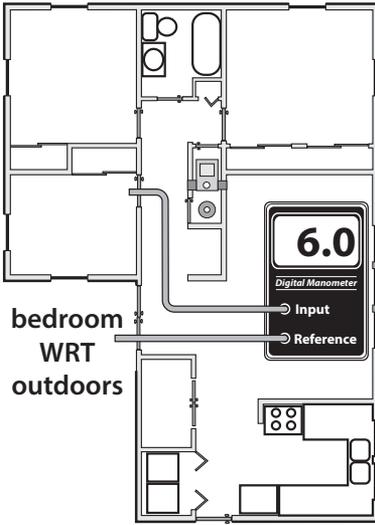

**Pressurized bedrooms:** Bedrooms with supply registers but no return register are pressurized when the air handler is on and the doors are closed. Pressures this high can double or triple air leakage through the building shell.

**Pressure difference bedroom to central zone:** The air handler depressurizes the central zone and pressurizes the bedroom, when the bedroom doors are closed. This test measures the pressure difference.

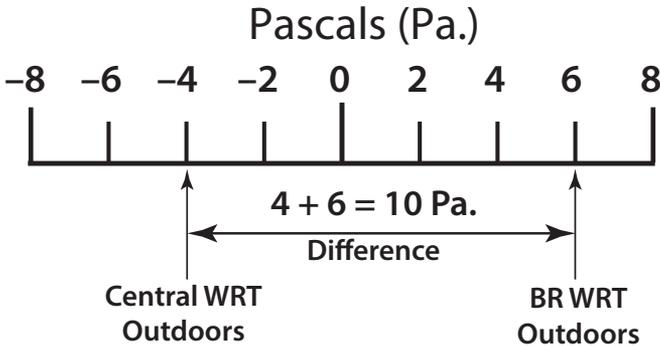

**Measuring unbalanced airflow:** The distance on a number line represents the difference in pressure between the central zone and the bedroom.

### 8.13.4 Evaluating Furnace Performance

The effectiveness of a furnace depends on its temperature rise, fan-control temperatures, and flue-gas temperature. For efficiency, you want a low temperature rise. However, you must maintain a minimum flue-gas temperature to prevent corrosion in the venting of 70+ and 80+ AFUE furnaces. Apply the following furnace-operation standards to maximize the heating system's seasonal efficiency and safety.

- ✓ Perform a combustion analysis as described in *“Gas Burner Safety & Efficiency Service” on page 282*.
- ✓ Check temperature rise after 5 minutes of operation. Refer to manufacturer's nameplate for acceptable temperature rise (supply temperature minus return temperature). The temperature rise should be between 40°F and 70°F with the lower end of this scale being preferable for energy efficiency.
- ✓ Verify that the fan-off temperature is between 95° and 105° F. The lower end of this scale is preferable for maximum efficiency.
- ✓ Verify that the fan-on temperature is 120–140° F. The lower the better.

**Table 8-14: Furnace Operating Parameters**

Inadequate temperature rise: condensation and corrosion possible.	Temperature rise OK for both efficiency and avoidance of condensation.	Temperature is excessive: Check fan speed, heat exchanger and ducts.
<b>20°</b>	<b>45°</b>	<b>70°</b>
<b>Temperature Rise = Supply Temperature – Return Temperature</b>		


Excellent fan-off temperature if comfort is acceptable.	Borderline acceptable: Consider replacing fan control.	Unacceptable range: Significant savings possible by adjusting or replacing fan control.
<b>85°</b>	<b>100°</b>	<b>115°</b>
<b>Fan-off Temperature</b>		

Excellent fan-on temperature range: No change needed.	Fair: Consider fan-control replacement if fan-off temperature is also borderline.	Poor: Adjust or replace fan control.
<b>100°</b>	<b>120°</b>	<b>140°</b>
<b>Fan-on Temperature</b>		

- ✓ With time-activated fan controls, verify that the fan is switched on within two minutes of burner ignition and is switched off within 2.5 minutes of the end of the combustion cycle.
- ✓ Verify that the high limit controller shuts the burner off before the furnace temperature reaches 200°F or PMI.
- ✓ Verify that there is a strong noticeable airflow from all supply registers.
- ✓ Adjust fan control to conform to these standards, or replace the fan control if adjustment fails. Some fan controls aren't adjustable.
- ✓ Adjust the high limit control to conform to the above standards, or replace the high limit control.
- ✓ All forced-air heating systems must deliver supply air and collect return air only from inside the intentionally heated

portion of the house. Taking return air from an un-heated area of the house such as an unconditioned basement or a crawl space isn't acceptable.

### Troubleshooting Temperature Rise

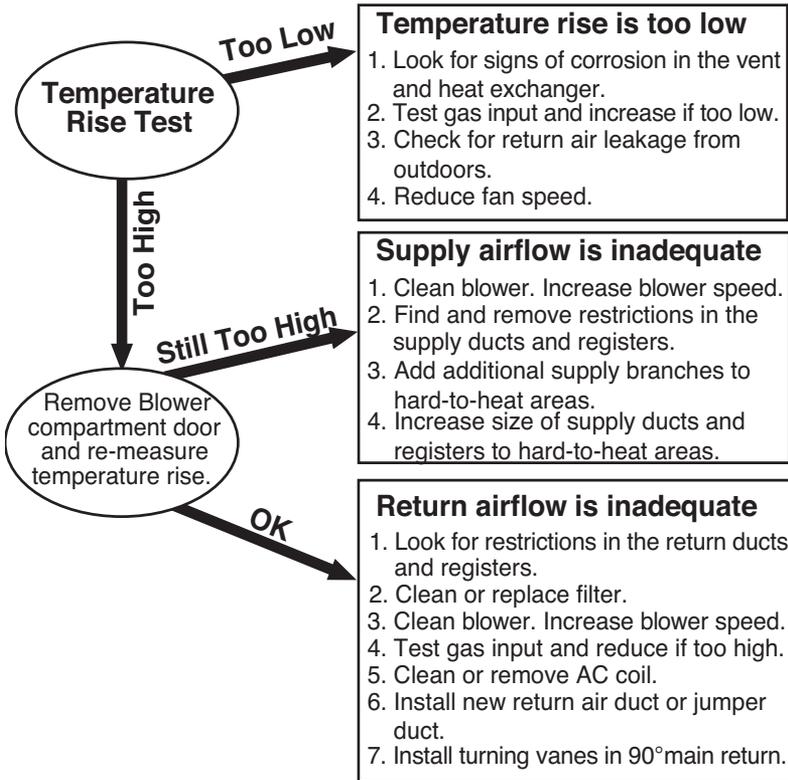


### 8.13.5 Improving Forced-Air System Airflow

Inadequate airflow is a common cause of comfort complaints. When the air handler is on there should be a strong flow of air out of each supply register. Low register airflow may mean that a branch duct is blocked or separated, or that return air from the room to the air handler isn't sufficient. When low airflow is a

problem, consider specifying the following improvements as appropriate from your inspection.

- ✓ Clean or change filter. Select a less restrictive filter if you need to reduce static pressure substantially.
- ✓ Clean air handler's blower.
- ✓ Clean air-conditioning or heat pump coil.
- ✓ Clean the air-conditioning coil. If the blower is dirty, the coil is probably also dirty.
- ✓ Increase blower speed.
- ✓ Make sure that balancing dampers to rooms that need more airflow are wide open.
- ✓ Lubricate blower motor, and check tension on drive belt.

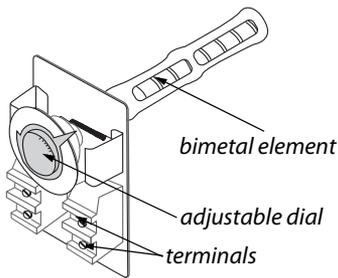

**Fan/limit control:** Turns the furnace blower on and off, according to temperature. Also turns the burner off if the heat exchanger gets too hot.


## Duct Improvements to Increase Airflow

Consider specifying the following duct changes to increase system airflow and reduce the imbalance between supply and return.


- ✓ Modify the filter installation to allow easier filter changing, if filter changing is currently difficult.
- ✓ Install a slanted filter bracket assembly or a enlarged filter fitting to accommodate a larger filter with more surface area and less static-pressure drop than the existing filter.



Panel filter installed in filter slot in return plenum



Washable filter installed on a rack inside the blower compartment.

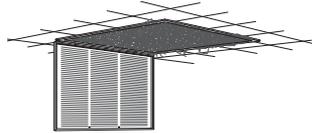

Panel filter installed in return register

**Air-handler filter location:** Filters are installed on the return-air side of forced air systems. Look for them in one or more of the above locations.

- ✓ Remove obstructions to registers and ducts such as rugs, furniture, and objects placed inside ducts, such as children's toys and water pans for humidification.
- ✓ Remove kinks from flex duct, and replace collapsed flex duct and fiberglass duct board.
- ✓ Remove excessive lengths of slacking flex duct, and stretch the duct to enhance airflow.
- ✓ Perform a Manual D sizing evaluation to evaluate whether to replace branch ducts that are too small.
- ✓ Install additional supply ducts and return ducts as needed to provide heated air throughout the building, especially in additions to the building.
- ✓ Undercut bedroom doors, especially in homes without return registers in bedrooms.
- ✓ Repair or replace bent, damaged, or restricted registers. Install low-resistance registers and grilles.

## 8.14 EVALUATING DUCT AIR LEAKAGE

Duct leakage is a major energy-waster in homes where the ducts are located outside the home's thermal boundary in a crawl space, attic, attached garage, or leaky unconditioned basement. When these intermediate zones remain outside the thermal boundary, duct sealing is usually cost-effective.

Duct leakage within the thermal boundary isn't usually a significant energy problem.


### 8.14.1 Troubleshooting Duct Leakage

There are several simple procedures for finding the locations of the duct leaks and evaluating their severity.

#### Finding Duct Leaks Using Touch and Sight

One of the simplest ways of finding duct leaks is feeling with your hand for air leaking out of supply ducts, while the ducts are pressurized by the air handler's blower. Duct leaks can also be located using light. Use one of these 4 tests to locate air leaks.

**Finding duct air leaks:** Finding the exact location of duct leaks precedes duct air sealing.

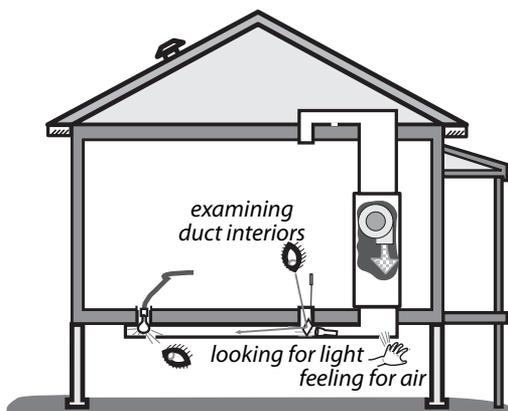

1. Use the air handler blower to pressurize supply ducts. Closing the dampers on supply registers temporarily or partially blocking the register with pieces of carpet, magazines, or any object that won't be blown off by the

register's airflow increases the duct pressure and make duct leaks easier to find. Dampening your hand makes your hand more sensitive to airflow, helping you to find duct air leaks.


2. Place a trouble light, with a 100-watt bulb, inside the duct through a register. Look for light emanating from the exterior of duct joints and seams.
3. Determine which duct joints were difficult to fasten and seal during installation. These joints are likely duct-leakage locations.
4. Use a trouble light, flashlight, and mirror or a digital camera to help you to visually examine duct interiors.

Feeling air leaks establishes their exact location. Ducts must be pressurized in order to feel leaks. You can feel air leaking out of pressurized ducts, but you can't feel air leaking into depressurized return ducts. Pressurizing the home with a blower door forces air through duct leaks, located in intermediate zones, where you can feel the leakage coming out of both supply and return ducts.

### Pressure Pan Testing

Pressure pan tests can identify leaky or disconnected ducts located in intermediate zones. With the house depressurized by the blower door to either  $-50$  pascals, make pressure pan readings at each supply and return register.

**A pressure pan:** Blocks a single register and measures the air pressure behind it, during a blower door test. The magnitude of that pressure is an indicator of duct leakage.

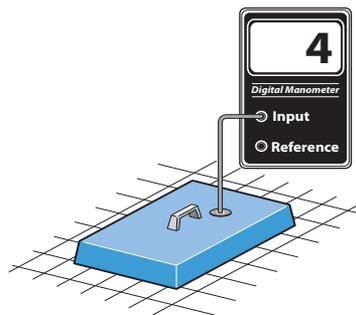

If the ducts are in a basement and the basement is conditioned, pressure pan testing isn't necessary, although air sealing the return ducts for safety is still important.

If instead, the basement is unconditioned, open a window or door between the basement and outdoors. Close any door or hatch between conditioned spaces and basement during pressure pan testing.

1. Install blower door and set-up house for winter conditions. Open all interior doors.
2. If the basement is conditioned living space, open the door between the basement and upstairs living spaces. If the basement isn't conditioned living space, close the door between basement and upstairs, and open a basement window.
3. Turn furnace off at the thermostat or main switch. Remove furnace filter, and tape filter slot if one exists. Be sure that all grilles, registers, and dampers are fully open.
4. Temporarily seal any outside fresh-air intakes to the duct system.
5. Seal supply registers in unoccupied zones that aren't intended to be heated — an unconditioned basement or crawl space, for example.
6. Open attics, crawl spaces, and garages as much as possible to the outdoors so they don't create a secondary air barrier.
7. Connect hose between pressure pan and the input tap on the digital manometer. Leave the reference tap open.
8. With the blower door's manometer reading  $-25$  or  $-50$  pascals, place the pressure pan completely over each grille or register one by one to form a tight seal. Leave all other grilles and registers open when making a test.

Record each reading, which should give a positive pressure.


9. If a grille is too large or a supply register is difficult to cover with the pressure pan (under a kitchen cabinet, for example), seal the grille or register with masking tape. Insert a pressure probe through the masking tape and record the reading. Remove the tape after the test.
10. Use either the pressure pan or tape to test each register and grille in a systematic way.

### Pressure Pan Duct Standards


If the ducts are perfectly sealed with no leakage to the outdoors, you won't measure any pressure difference (0.0 pascals) during a pressure-pan test. The higher the measured pressure reading, the more connected the duct is to the outdoors.

The reduction you achieve depends on your ability to find the leaks and whether you can access the leaky ducts. The best weatherization agencies use 1 pascal or less as a general goal for all registers.

Examine the registers connected to ducts that are located in areas outside the conditioned living space. Unconditioned spaces containing ducts include attics, crawl spaces, garages, and unoccupied basements. Also evaluate registers attached to stud cavities or panned joists used as return ducts. Leaky ducts, located outside the conditioned living space, may lead to pressure-pan measurements more than 30 pascals if the ducts have large holes.

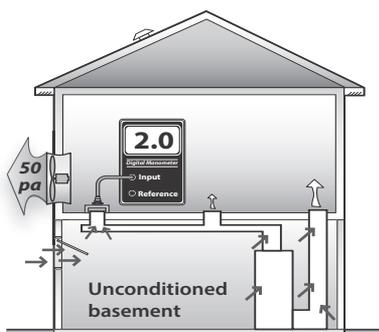

**Pressure pan test:** A pressure pan reading of 2 indicates moderate duct air leakage in the supply ducts.

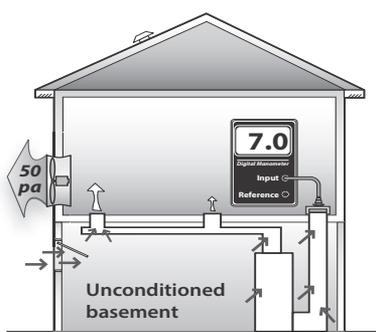

**Problem return register:** A pressure reading of 7 pascals indicates major air leakage near the tested register.

## 8.14.2 Measuring Duct Air Leakage with a Duct Blower

Pressurizing the ducts with a duct blower measures total duct leakage. The duct blower is the most accurate common measuring device for duct air leakage. It consists of a fan, a digital manometer or set of analog manometers, and a set of reducer plates for measuring different leakage levels. Using a blower door with a duct blower measures leakage to outdoors.

### Measuring Total Duct Leakage


The total duct leakage test measures leakage to both indoors and outdoors. The house and intermediate zones should be open to the outdoors by way of windows, doors, or vents. Opening the intermediate zones to outdoors insures that the duct blower is measuring only the ducts' airtightness — not the airtightness of ducts combined with other air barriers like roofs, foundation walls, or garages.

Supply and return ducts can be tested separately, either before the air handler is installed in a new home or when an air handler is removed during replacement.

Follow these steps when performing a duct airtightness test.

1. Install the duct blower in the air handler or to a large return register, either using its connector duct or simply attaching the duct blower itself to the air handler or return register with cardboard and tape.
2. Remove the air filter(s) from the duct system.
3. Seal all supply and return registers with masking tape or other non-destructive sealant.
4. Open the house, basement or crawl space, containing ducts, to outdoors.
5. Drill a  $\frac{1}{4}$  or  $\frac{5}{16}$ -inch hole into a supply duct a short distance away from the air handler and insert a manometer hose. Connect a manometer to this hose to measure *duct with reference to (WRT) outdoors*. (Indoors, outdoors, and intermediate zones should ideally be opened to each other in this test).
6. Connect an airflow manometer to measure *fan WRT the area near the fan*.

Check manometer(s) for proper settings. Digital manometers require your choosing the correct mode, range, and fan-type settings.

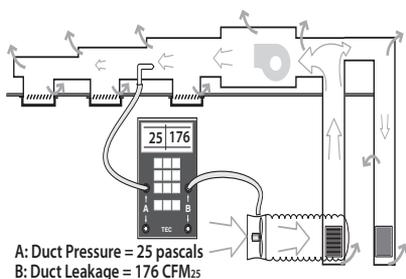

**Total duct air leakage measured by the duct blower:** All registers are sealed except the one connecting the duct blower to the system. Pressurize the ducts to 25 pascals and measure airflow.


1. Turn on the duct blower and pressurize the ducts to 25 pascals.
2. Record duct-blower airflow.

3. While the ducts are pressurized, start at the air handler and move outward feeling for leaks in the air handler, main ducts, and branches.
4. After testing and associated air-sealing are complete, restore filter(s), remove seals from registers, and check air handler.

## Measuring Duct Leakage to Outdoors

Measuring duct leakage to outdoors gives you a duct-air-leakage value that is directly related to energy waste and the potential for energy savings.

1. Set up the home in its typical heating and cooling mode with windows and outside doors closed. Open all indoor conditioned areas to one another.
2. Install a blower door, configured to pressurize the home.
3. Connect the duct blower to the air handler or to a main return duct.
4. Pressurize the ducts to +25 pascals by increasing the duct blower's speed until this value is reached.
5. Pressurize the house until the pressure difference between the house and duct is 0 pascals (*house WRT ducts*). See "[Blower-Door Test Procedures](#)" on page 475.
6. Read the airflow through the duct blower. This value is duct leakage to outdoors.

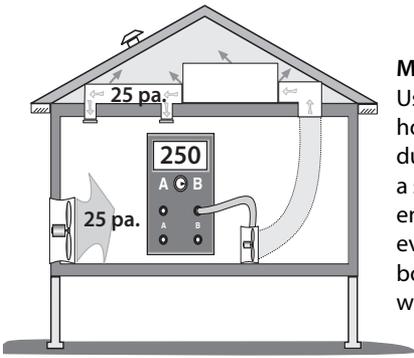


#### **Measuring duct leakage to outdoors:**

Using a blower door to pressurize the house with a duct blower to pressurize the ducts measures leakage to the outdoors — a smaller number and a better predictor of energy savings. This test is preferred for evaluating duct leakage for specialists in both shell air leakage and duct air leakage whenever a blower door is available.


### 8.14.3 Measuring House Pressure Caused by Duct Leakage

The following test measures pressure differences between the house and outdoors, caused by duct leakage. Try to correct pressure differences greater than +2.0 pascals or more negative than -2.0 pascals because of the shell air leakage that the pressure differences create.

1. Close all windows and exterior doors. Turn-off all exhaust fans.
2. Open all interior doors, including door to basement.
3. Measure the baseline house-to-outdoors pressure difference and zero it out using the baseline procedures described in *“Blower-Door Test Procedures” on page 475.*
4. Turn on air handler.
5. Measure the house-to-outdoors pressure difference. This test indicates dominant duct leakage as shown here.

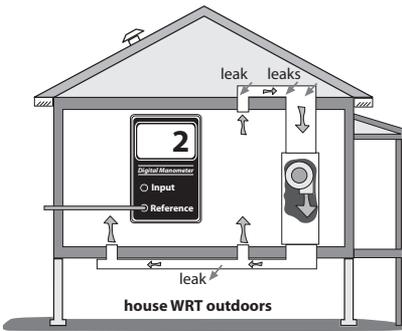

**Dominant return leaks:** When return leaks are larger than supply leaks, the house shows a positive pressure with reference to the outdoors.

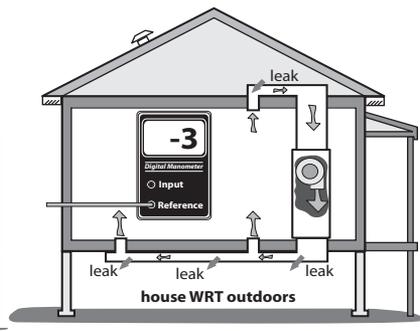

**Dominant supply leaks:** When supply leaks are larger than return leaks, the house shows a negative pressure with reference to the outdoors.

A positive pressure indicates that the return ducts (which pull air from leaky intermediate zones) are leakier than the supply ducts. A negative pressure indicates that the supply ducts (which push air into intermediate zones through their leaks) are leakier than return ducts. A pressure at or near zero indicates equal supply and return leakage or else little duct leakage.

## 8.15 SEALING DUCT LEAKS


Ducts located outside the thermal boundary or in an intermediate zone like a ventilated attic or crawl space should be sealed. The following is a list of duct leak locations in order of their relative importance. Leaks nearer to the air handler are exposed to higher pressure and are more important than leaks further away.

### 8.15.1 Sealing Return Ducts


*SWS Detail: 3.1602.1 Air Sealing Duct System, 3.1602.5 Return—Framed Platform, 3.1602.4 Air Sealing System Components, 3.1602.7 Return and Supply Plenums in Basements and Crawl Spaces*

Return leaks are important for combustion safety and for efficiency. Use the following techniques to seal return ducts.

- ✓ First, seal all return leaks within the combustion zone to prevent this leakage from depressurizing the combustion zone and causing backdrafting.
- ✓ Seal panned return ducts using mastic to seal all cracks and gaps within the return duct and register.
- ✓ Seal leaky joints between building materials composing cavity return ducts, like panned floor cavities and furnace return platforms. Remove the panning to seal cavities containing joints in building materials.
- ✓ Carefully examine and seal leaks at transitions between panned floor joists and metal trunks that change the direction of the return ducts. You may need a mirror to find some of the biggest return duct leaks in these areas.
- ✓ Seal filter slots with duct tape to allow removal for easy changing of filters.
- ✓ Seal the joint between the furnace and return plenum with silicone caulking or foil tape.

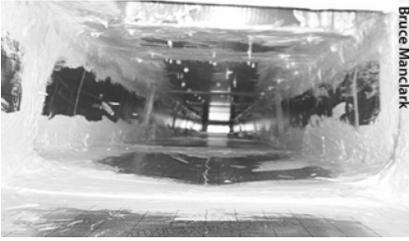

**Lining a panned cavity:** Foil-faced foam board, designed for lining cavities is sealed with duct mastic to provide an airtight return.

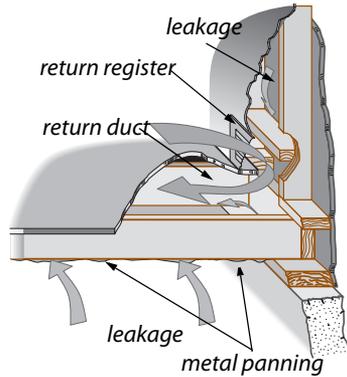

**Panned floor joists:** These return ducts are often very leaky and may require removing the panning to seal the cavity.



**Panned floor joists:** These return ducts are often very leaky and may require removing the panning to seal the cavity.


## 8.15.2 Sealing Supply Ducts

*SWS Detail: 3.1602.1 Air Sealing Duct System, 3.1602.5 Return—Framed Platform, 3.1602.4 Air Sealing System Components, 3.1602.7 Return and Supply Plenums in Basements and Crawl Spaces, 3.1601.3 Support*

Inspect these places in the duct system and seal them as needed.

- ✓ *Plenum joint at air handler:* Technicians might have had problems sealing these joints because of a lack of space. Seal these plenum connections thoroughly even if you

must cut an access hole in the plenum. Use silicone caulking or foil tape instead of mastic and fabric mesh here for future access — furnace replacement, for example.

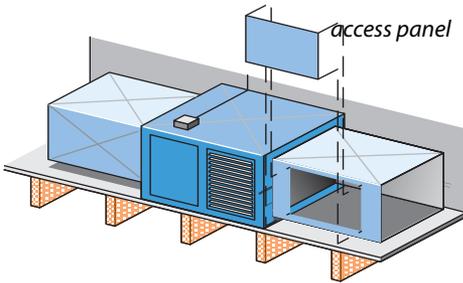


**Plenums, poorly sealed to air handler:** When air handlers are installed in tight spaces, plenums may be poorly fastened and sealed. Cutting a hole in the duct may be the only way to seal this important joint.

**Sectioned elbows:** Joints in sectioned elbows, known as gores, are usually leaky and require sealing with duct mastic.

- ✓ *Joints at branch takeoffs:* Seal these important joints with a thick layer of mastic. Fabric mesh tape should cover gaps and reinforce the seal at gaps.
- ✓ *Joints in sectioned elbows:* Known as gores, these are usually leaky and require sealing with duct mastic.
- ✓ *Tabbed sleeves:* Attach the sleeve to the main duct with 3-to-5 screws and apply mastic plentifully. Or better, remove the tabbed sleeve and replace it with a manufactured take-off.
- ✓ *Flexduct-to-metal joints:* Apply a 2-inch band of mastic to the end of the metal connector. Attach the flexduct's inner liner with a plastic strap, tightening it with a strap tensioner. Attach the insulation and outer liner with another strap.
- ✓ *Damaged flex duct:* Replace flex duct when it is punctured, deteriorated, or otherwise damaged.

- ✓ *Deteriorating ductboard facing:* Replace ductboard, preferably with metal ducting, when the facing deteriorates because this deterioration leads to a lot of air leakage.

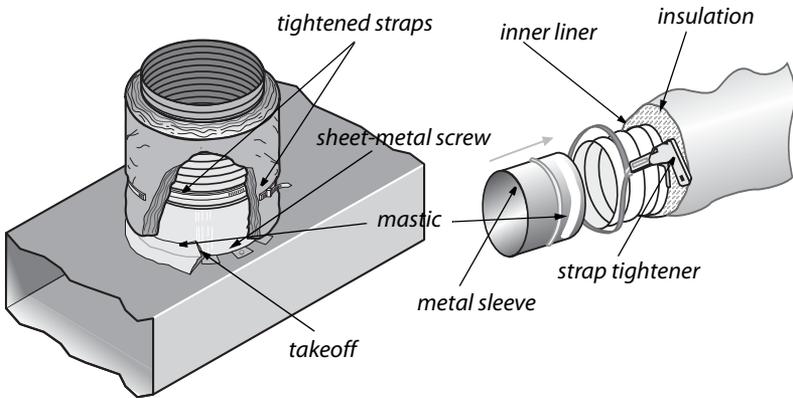

**Flexduct joints:** Flexduct itself is usually fairly airtight, but joints, sealed improperly with tape, can be very leaky. Use methods shown here to make flexduct joints airtight.

- ✓ Consider closing supply and return registers in unoccupied basements or crawl spaces.
- ✓ Seal penetrations made by wires or pipes traveling through ducts.
- ✓ Seal the joint between the boot and the ceiling, wall, or floor between conditioned and unconditioned areas.
- ✓ Support the ducts and duct joints with duct hangers at least every 5 feet or as necessary to prevent sagging of more than one-half inch.



**Sealing register boots:** Seal between the boot and floor. Seal joints inside the boot.

### 8.15.3 Materials for Duct Sealing

Duct mastic is the best duct-sealing material because of its superior durability and adhesion. Apply mastic at least  $\frac{1}{16}$ -inch thick, and use reinforcing mesh for all joints wider than  $\frac{1}{8}$ -inch or joints that may move. Install screws to prevent joint movement or separation.

Aluminum foil or cloth duct tape aren't good materials for duct sealing because their adhesive often fails. Consider covering tape with mastic to prevent tape's adhesive from drying out and failing.

## 8.16 DUCT INSULATION


*SWS Detail: 4.1601.1 Insulating Flex Ducts, 4.1601.2 Insulating Metal Ducts*

Insulate supply ducts that are installed in unconditioned areas outside the thermal boundary such as crawl spaces, attics, and attached garages with vinyl- or foil-faced duct insulation. Don't insulate ducts that run through conditioned areas unless they cause overheating in winter or condensation in summer. Use these best practices for installing insulation.

- ✓ Always perform necessary duct sealing before insulating ducts.

- ✓ Duct-insulation R-value must be  $\geq R-8$  in the attic and  $\geq R-6$  in a crawlspace.
- ✓ Insulation should cover all exposed supply ducts, with no significant areas of bare duct left uninsulated.

**Duct insulation:**  
Insulate supply ducts, located in unheated areas, to a minimum of R-6, R-8 in attics.

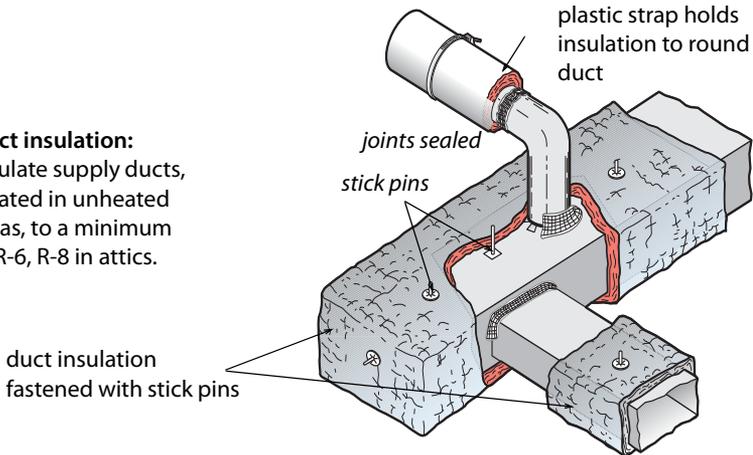

- ✓ Insulation's compressed thickness must be more than 75% of its uncompressed thickness. Don't compress duct insulation excessively at corner bends.
- ✓ Fasten insulation using mechanical means such as stick pins, twine, staples, or plastic straps.
- ✓ Cover the insulation's joints with tape to stop air convection. However, tape often falls off if the installer expects tape to support the insulation's weight.
- ✓ Install the duct insulation 3 inches away from heat-producing devices such as recessed light fixtures.

**Caution:** Burying ducts in attic insulation is common in some regions and it reduces energy losses from ducts. However, condensation on ducts in humid climates is common during the air-conditioning season, so don't allow cellulose to come in contact with metal ducts to avoid corrosion from cellulose's Borate fire retardant.

**Important Note:** Tape can be effective for covering joints in the insulation to prevent air convection, but the tape fails when expected to resist the force of the insulation's compression or weight. Outward-clinch staples or plastic straps can help hold the insulation facing and tape together.


### 8.16.1 Spray Foam Duct Insulation

*SWS Details: 3.1602.2 Duct Spray Polyurethane Foam (SPF) Installation*

High-density spray foam insulation is also a good duct-insulation option, assuming it is listed as ASTM E-84 or UL 723. Spray foam is particularly helpful in areas where the foam can seal seams and insulate in one application. However, the spray foam application is limited by space around the duct to a greater amount than wrapping with fiberglass blankets.

## 8.17 HOT-WATER SPACE-HEATING DISTRIBUTION

The most significant energy wasters in hot-water systems are poor steady-state efficiency, off-cycle flue losses stealing heat from the stored water, and boilers operating at a too-high water temperature. For information about boiler installation, [see page 272](#).

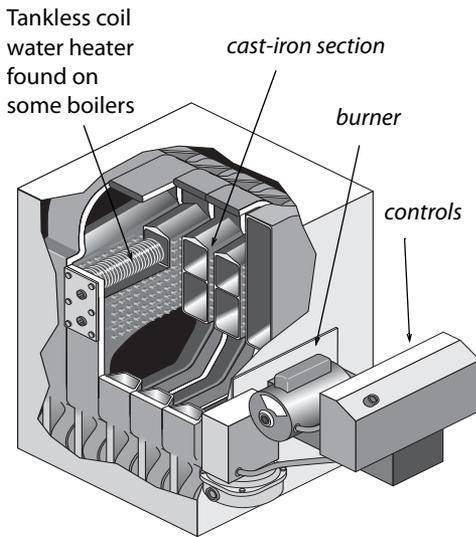

**Cast-iron sectional boilers:**  
The most common boiler type for residential applications.

### 8.17.1 Boiler Efficiency and Maintenance

Monitor boiler performance and efficiency in the following ways.

- Corrosion, scaling, and dirt on the water side of the heat exchanger.
- Corrosion, dust, and dirt on the fire side of the heat exchanger.
- Excess air during combustion from air leaks and incorrect fuel-air mixture.
- Off-cycle air circulation through the firebox and heat exchanger, removing heat from stored water.

#### Boiler Efficiency Improvements

Consider the following maintenance and efficiency improvements for both hot-water and steam boilers based on boiler inspection.

- ✓ Check for leaks on the boiler, around its fittings, or on any of the distribution piping connected to the boiler.
- ✓ Clean fire side of heat exchanger of noticeable dirt.
- ✓ Drain water from the boiler drain until the water flows clean.

## 8.17.2 Distribution System Improvements

### *SWS Details: 5.3104.2 Maintenance: Gas Boiler Service Inspection*

Hydronic distribution systems consist of the supply and return piping, the circulator, expansion tank, air separator, air vents, and heat emitters. A properly designed and installed hydronic distribution system can operate for decades without service. However, many systems have installation flaws or need service.

**Note:** You can recognize a hot-water boiler by its expansion tank, located somewhere above the boiler. The expansion tank provides an air cushion to allow the system's water to expand and contract as it is heated and cooled. Without a functioning expansion tank excessive pressure in the boiler discharges water through the pressure-relief valve.


### Safety Checks and Improvements

Work with contractors and technicians to specify and verify the following safety and efficiency tests and inspections.


- Verify the existence of a 30-psi-rated pressure-temperature (P&T) relief valve. The P&T relief valve should have a drain pipe that terminates 6 inches from the floor. Replace a malfunctioning valve or add a P&T relief valve if none exists. Look for signs of leakage or discharges. Find out why the relief valve is discharging.
- Verify that the expansion tank isn't waterlogged or too small for the system. A non-operational expansion tank can cause the pressure-relief valve to discharge. Measure

the expansion tank's air pressure. The pressure should be one (1) psi per 2.3 feet of the distribution system's height.

- If you observe rust in venting, verify that the return water temperature is warmer than 130° F for gas and warmer than 140° F for oil. These minimum water temperatures prevent acidic condensation.
- Verify that high-limit control disengages the burner at a water temperature of 200°F or less.
- Lubricate circulator pump(s) if necessary.

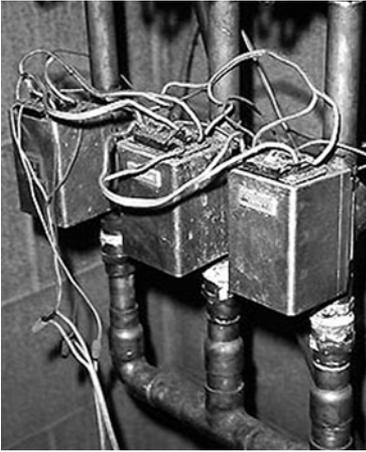

**Zone valves:** Separate thermostats control each zone valve. Zone valves have switches that activate the burner.

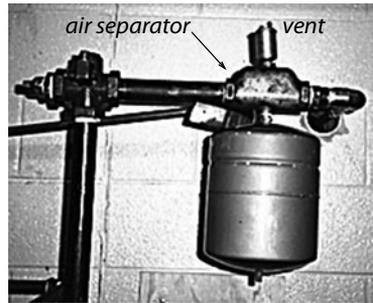


**Expansion tank, air separator, and Vent:** Preventing excessive pressure and eliminating air from the systems are important for hydronic distribution systems.

## Simple Efficiency Improvements

Do the following energy-efficiency improvements.

- ✓ Repair water leaks in the system.
- ✓ Remove corrosion, dust, and dirt on the fire side of the heat exchanger.
- ✓ Check for excess air during combustion from air leaks and incorrect fuel-air mixture.

- ✓ Bleed air from radiators and piping through air vents on piping or radiators. Most systems fill automatically through a shutoff and pressure-reducing valve (PRV) connected to the building's water supply. If there is a shutoff and no PRV, open the shutoff during air-purging and close it afterwards. Then check the system pressure at the expansion tank and adjust the pressure as necessary.

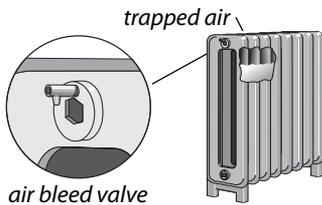

**Purging air:** Trapped air collects at the hot-water system's highest parts. Bleeding air from radiators fills the radiator and gives it more heating surface area.

- ✓ Vacuum and clean fins of fin-tube convectors if you notice dust and dirt there.
- ✓ Insulate all supply and return piping, passing through unheated areas, with foam pipe insulation, at least one-inch thick, rated for temperatures up to 200° F.

## Improvements to Boiler Controls

Consider these improvements to control systems for hot-water boilers.

- ✓ Install outdoor reset controllers to regulate water temperature, depending on outdoor temperature.
- ✓ If possible, operate the boiler without a low-limit control for maintaining a minimum boiler-water temperature. If the boiler heats domestic water in addition to space heating, the low-limit control may be necessary.
- ✓ After control improvements like two-stage thermostats or reset controllers, verify that return water temperature is high enough to prevent condensation and corrosion in the chimney as noted previously.

- ✓ Install electric vent dampers on atmospheric gas- and oil-fired high-mass boilers.

## 8.18 STEAM HEATING AND DISTRIBUTION

Steam heating is less efficient than hot-water heating because steam requires higher temperatures than hot water. For single-family homes, consider replacing a steam heating system with a hot-water or forced-air system. Multifamily buildings, especially multi-story buildings, may have little choice but to continue with steam because of the high cost of switching systems.

**Note:** You can recognize a steam boiler by its sight glass, which indicates the boiler's water level. Notice that the water doesn't completely fill the boiler, but instead allows a space for the steam to form above the boiler's water level.

If the steam-heating system remains, operate it at the lowest steam pressure that heats the building adequately. Two psi on the boiler-pressure gauge is a practical limit for many systems although some systems can operate at pressures down to a few ounces per square inch of pressure. Traps and air vents are crucial to operating at a low steam pressure. Electric vent dampers reduce off-cycle losses for both gas- and oil-fired systems.



**Sight glass & low-water control:** The sight glass shows the boiler water level. The low water control adds water to the boiler and extinguishes the burner if the water level is too low.

## 8.18.1 Steam System Maintenance

### *SWS Details: 5.3104.3 Maintenance: Checklist*

Do these safety and maintenance tasks on steam systems.

- ✓ Verify that steam boilers have functioning high-pressure limits and low-water cut-off controls.
- ✓ Verify the function of the low-water cutoff by flushing the low-water cutoff with the burner operating. Combustion should stop when the water level in the boiler drops below the level of the float. If combustion continues, repair or replace the low-water cutoff.
- ✓ Verify that flush valves on low-water cutoffs are operable and don't leak water.
- ✓ Ask owner about instituting a schedule of blow-down and chemical-level checks.

- ✓ Specify that technicians drain mud legs on return piping.

## 8.18.2 Steam System Energy Conservation

Specify the following efficiency checks and improvements for steam systems.

### One-Pipe Steam

- ✓ Verify that high-pressure limit control is set at or below 1 (one) psi or as low as acceptable in providing heat to the far ends of the building.
- ✓ Verify that steam reaches all radiators during every steam cycle. Steam need not fill radiators on every cycle. In mild weather, steam partly fills radiators before the boiler cycles off.
- ✓ Radiator air vents should be open to release air while the system is filling with steam, then closed when steam reaches the vents. Replace malfunctioning radiator air vents as necessary. However, don't over-vent radiators because this can cause water hammer.
- ✓ Verify air vents function and that all steam radiators receive steam during every cycle. Unplug air vents or replace malfunctioning vents as necessary. Add vents to steam lines and radiators as needed to get steam to all the registers.


### Two-Pipe Steam

- ✓ When you can gain access to all the system's steam traps, repair leaking steam traps or replace them. All failed traps should be replaced at the same time to prevent new traps failing because of water hammer from steam leakage through neighboring failed traps. The only 100% reliable way to test a steam trap is to connect it to a test apparatus and see if it allows steam to pass. However if you have an accurate thermometer, the temperature on the radiator

side of a functioning trap should be more than 215°F and the temperature on the return side of that trap should be less than 205°F when steam is in the radiator.

**One-pipe and two-pipe steam systems:** Still common in multifamily buildings, one-pipe steam works best when very low pressure steam can drive air out of the piping and radiators quickly through plentiful vents. Vents are located on each radiator and also on main steam lines.


**Two-pipe steam systems:** Radiator traps keep steam inside radiators until it condenses. No steam should be present at the condensate tank.

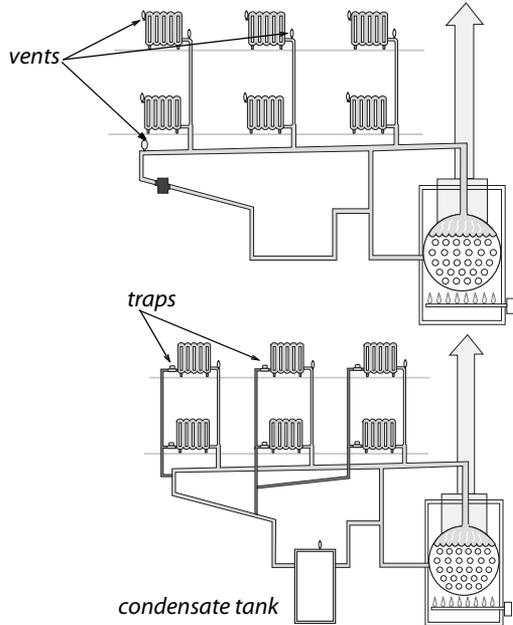


- ✓ When you can't gain access to all the system's steam traps at the same time, consider abandoning failed steam traps and installing radiator-inlet orifices in two-pipe steam radiators. The orifices limit steam flow to an amount that can condense within the radiator. Orifices can also reduce steam delivery to oversized radiators by 20% or a little more.
- ✓ Consider controlling radiators with thermostatic radiator valves (TRVs) except for radiators in the coolest rooms. TRVs can be used with systems equipped with either traps or orifices. For effective temperature control, the thermostatic element of the TRVs must be located in the path of air moving toward the radiator or convector. TRVs are available with sensors located remotely from the valve, which solves the problem of a valve located where the

radiator heats a valve-mounted sensor, fooling it into closing.

- ✓ Inspect return lines and condensate receiver for steam coming back to the boiler. Check radiator and main line traps.
- ✓ Check steam traps with a digital thermometer or listening device to detect any steam escaping from radiators through the condensate return. Replace leaking steam traps or their thermostatic elements.
- ✓ Consider installing remote sensing thermostats that vary cycle length according to outdoor temperature and include night-setback capability.

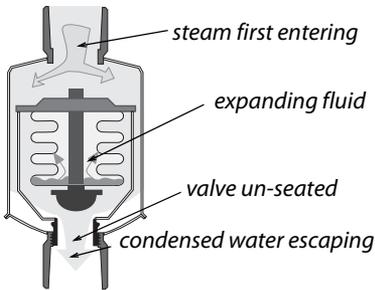

**Steam traps:** Steam enters the steam trap heating its element and expanding the fluid inside. The expanded element plugs the steam's escape with a valve.

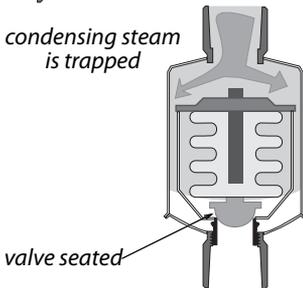

- ✓ Repair leaks on the steam supply piping or on condensate return piping.
- ✓ Consider a flame-retention burner and electric vent damper as retrofits for steam boilers.
- ✓ Clean fire side of heat exchanger of noticeable dirt.

- ✓ All steam piping that passes through unconditioned areas should be insulated to at least R-3 with fiberglass or specially designed foam pipe insulation rated for steam piping.

## 8.19 PROGRAMMABLE THERMOSTATS


### *SWS Details: 5.3104.1 Controls — Thermostat Replacement*

A programmable thermostat may be a big energy saver if the building's occupants understand how to program it. However, a programmable thermostat won't save any energy if occupants already control day and night temperatures effectively.

If you replace the existing thermostat, as a part of weatherization work, discuss programmable thermostats with occupants. If they can use a programmable thermostat effectively, then install one. Educate occupants on the use of the thermostat and leave a copy of manufacturer's directions with them.

#### **Inside a programmable thermostat:**

In addition to the instructions on the exterior of this thermostat are instructions inside for setting the heat anticipator.

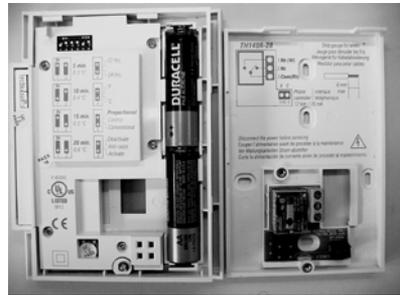

Many models of programmable thermostats have settings that you select from inside the thermostat. These settings include the heat-anticipator setting, which adjusts the cycle length of the heating or cooling system.

## 8.20 ELECTRIC HEAT

Electric heaters are usually 100% efficient at converting the electricity to heat in the room where they are located.

**Important:** Evaluate service and wire sizing for the nameplate power draw of the electric heating systems. If the data plate information is not available, reference NEC 70 for the circuit sizing and OCPD requirements.


## 8.20.1 Electric Baseboard Heat

Electric baseboard heaters are zonal heaters controlled by thermostats within the zone they heat. Electric baseboard heat can help to minimize energy costs, if residents take advantage of the ability to heat by zones.

Baseboard heaters contain electric resistance heating elements encased in metal pipes. These are surrounded by aluminum fins to aid heat transfer. As air within the heater is heated, it rises into the room. This draws cooler air into the bottom of the heater.

- Make sure that the baseboard heater sits at least an inch above the floor to facilitate good air convection.
- Clean fins and remove dust and debris from around and under the baseboard heaters as often as necessary.
- Avoid putting furniture directly against the heaters. To heat properly, there must be space for air convection.


The line-voltage thermostats used with baseboard heaters sometimes don't provide good comfort. This is because these thermostats allow the temperature in the room to vary by 2°F or more. Newer, more accurate thermostats are available. Programmable thermostats for electric baseboard heat use timers or a resident-activated button that raises the temperature for a time and then automatically returns to the setback temperature. Some baseboard heaters use low-voltage thermostats connected to relays that control baseboard heaters in rooms.

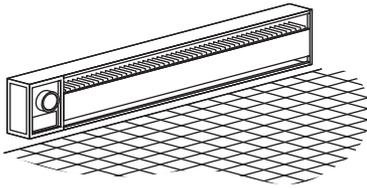

**Electric baseboard:** Electric baseboard is more efficient than an electric furnace and sometimes even outperforms a central heat pump because it is easily zone-able. The energy bill is determined by the habits of the occupants and the energy efficiency of the building.

## 8.20.2 Electric Furnaces

Electric furnaces heat air moved by its fan over several electric-resistance heating elements. Electric furnaces have two to six elements — 3.5 to 7 kW each — that work like the elements in a toaster. The 24-volt thermostat circuit energizes devices called sequencers that bring the 240 volt heating elements on in stages when the thermostat calls for heat. The variable speed fan switches to a higher speed as more elements engage to keep the air temperature stable.

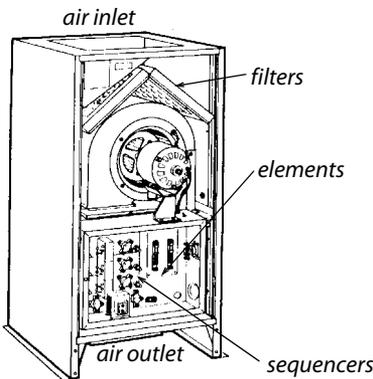

**Electric furnace:** A squirrel-cage blower blows air over 2 to 6 electric resistance coils and down into the plenum below the floor.


## 8.20.3 Central Heat-Pump Energy Efficiency

An air-source heat pump is almost identical to an air conditioner, except for a reversing valve that allows refrigerant to follow two different paths, one for heating and one for cooling.

Heat pumps move heat with refrigeration rather than converting it from the chemical energy of a fuel.

Like air conditioners, air-source heat pumps are available as centralized units with ducts or as room units. Heat pumps are 1.5 to 3 times more efficient than electric furnaces. Heat pumps can provide competitive comfort and value with combustion furnaces, but they must be installed with great care and planning.

**Heat pump:** The air handler contains a blower, indoor coil, strip heat, and often a filter. Static pressure and temperature rise are two indicators of performance.

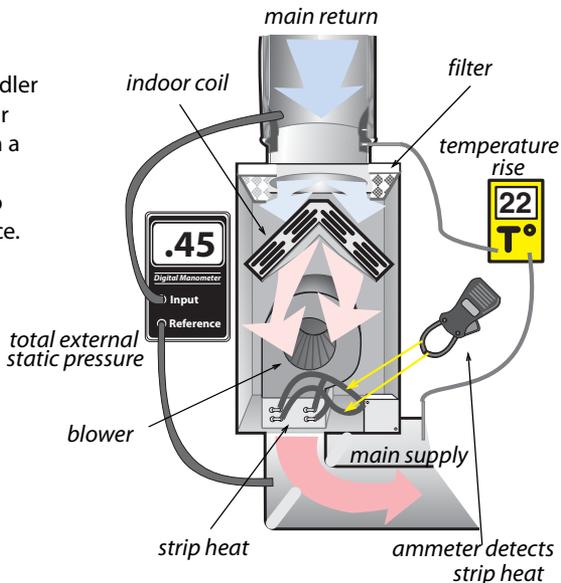


Heat pumps are also equipped with auxiliary electric resistance heat, called strip heat. The energy efficiency of a heat pump depends on how much of the heating load the compressor provides without using the strip heat.

### Evaluating Heat Pumps During the Heating Season

Heat pumps should have two-stage thermostats designed for use with heat pumps. The first stage is compressor heating and the second stage is the inefficient strip heat. Evaluating heat pumps in the winter is more difficult than a summer evaluation. Consider these steps to evaluate heat pumps during the winter.

- Look for a temperature rise of around half the outdoor temperature in degrees Fahrenheit.
- Check for operation of strip heat by measuring amperage. Then use the chart shown here to find out if strip heat is operating.


**Is strip heat activated?** Using an ammeter and the nameplate data on the heat pump, a technician can know when and if the strip heat is activated.

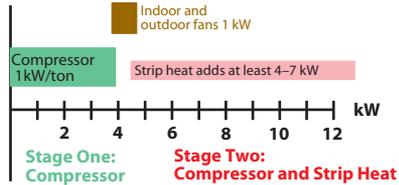

- External static pressure should be 0.5 IWC (125 pascals) or less for older, fixed-speed blowers and less than 0.8 IWC (200 pascals) for variable-speed and two-speed blowers. Lower external static pressure promotes higher airflow.
- Seal supply and return ducts and insulate them after you've verified the airflow as adequate. Return ducts should be sealed too.

Most residential central heat pumps are split systems with the indoor coil and air handler indoors and outdoor coil and compressor outdoors. Individual room heat pumps are more efficient since they don't have ducts, and are factory-charged with refrigerant. The illustrations show features of an energy-efficient heat pump installation.

In the summer, use the same procedures to evaluate central heat pumps as to evaluate central air conditioners, described on [page 360](#).

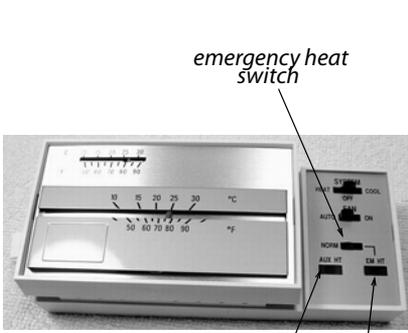


*emergency heat switch*

*auxiliary heat indicator light*

*emergency heat indicator light*

**Heat pump thermostat:** These should have two indicator lights, one for auxiliary heat and one for emergency heat.

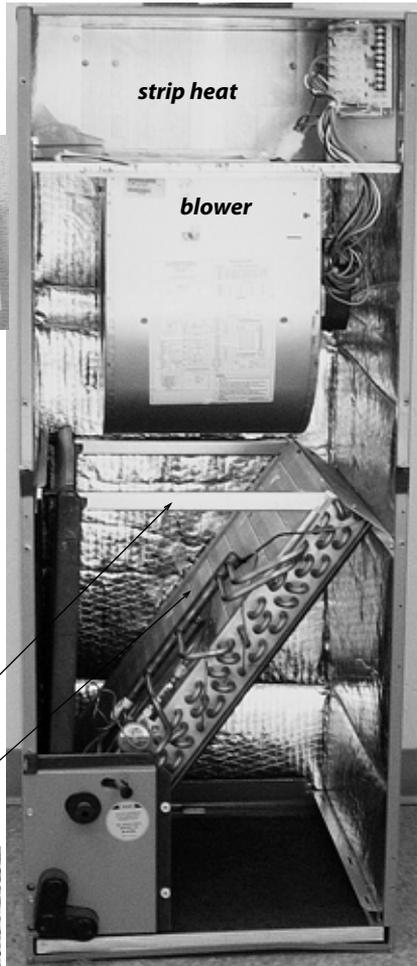

*filter bracket*

*indoor coil*

**Heat pump:** This upflow indoor air handler contains a blower, indoor coil, strip heat, and filter bracket.




**Reversing valve:** The outdoor unit contains a reversing valve installed near the compressor.

The illustration shows features of an energy-efficient heat pump installation.

Multiple returns ensure good airflow to all parts of the home.

Outdoor thermostat prevents strip heat from operating until outdoor temperature is less than 40°F. Thermostat stages elements as needed.

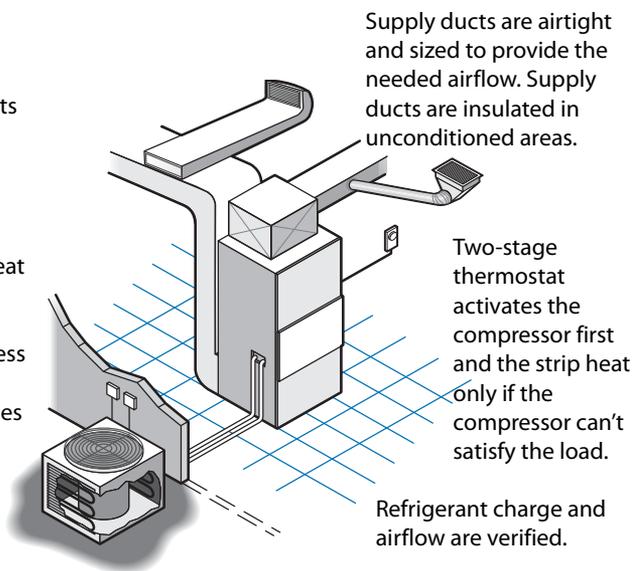

Coil is cleaned every year. Weeds, grass and shrubs shouldn't grow within 3 feet. Verify that no airflow restrictions exist above the outdoor unit.


## 8.20.4 Room Heat Pumps

Room heat pumps can provide all or part of the heating and cooling needs for small homes. These one-piece room systems (also known as terminal systems) look like a room air conditioner, but provide heating as well as cooling. They can also provide ventilation air when neither heating nor cooling are required. They mount in a window or through a framed opening in a wall.

Room (or unitary) heat pumps can be a good choice for replacing existing unvented gas space heaters. Their fuel costs may be somewhat higher than gas furnaces, though they are safer and require less maintenance than combustion appliances. Room

heat pumps also gain some overall efficiency because they heat a single zone and don't have the delivery losses associated with central furnaces or central boilers. If they replace electric resistance heat, they consume only one-half to one-third the electricity to produce the same amount of heat.

Room heat pumps draw a substantial electrical load, and may require 240-volt wiring. Provide a dedicated circuit that can supply the equipment's rated electrical input. Insufficient wiring capacity can result in dangerous overheating, tripped circuit breakers, blown fuses, or motor-damaging voltage drops. In most cases a licensed electrician should confirm that the house wiring is sufficient. Don't run portable heat pumps or any other appliance with extension cords or plug adapters.

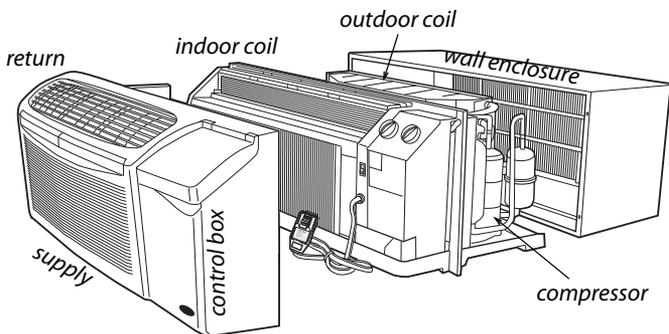


**Unitary heat pumps:** These unitary ductless heat pumps sit inside an exterior wall. They are a very efficient kind of electric heating and cooling.



## 8.20.5 Ductless Minisplit Pumps

Ductless minisplit heat pumps contain an outdoor condenser and one or more indoor fan-coil units that heat or cool the rooms. Mini-split heat pumps are among the most efficient heating and cooling systems available, providing 2-to-4 watt hours of heating or cooling for each watt hour of electricity they use. Specify minisplits heat pumps as replacement HVAC solutions when they are appropriate, for example.

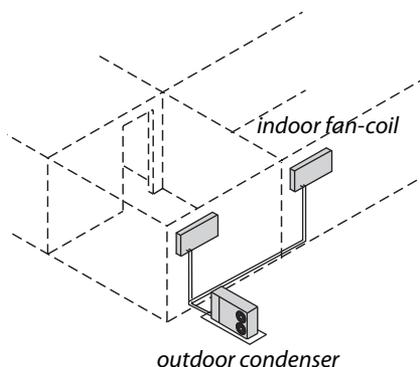

**Ductless mini-split heat pumps:**  
These systems have very high efficiency: 200% to 400%.

- Homes currently having no ducts.
- Homes with poorly designed or deteriorating ducts outside the thermal boundary or located in inaccessible areas, such as floor cavities.
- Isolated part of a building such as an addition or a bonus room.
- Very well-insulated, airtight, and shaded homes.
- Bedrooms needing cooling in homes with no central air conditioning.
- Masonry buildings being retrofitted to replace obsolete central space-conditioning systems (often steam).

## 8.21 EVALUATING DUCTED CENTRAL AIR-CONDITIONING SYSTEMS

An energy-efficient home shouldn't need more than a ton of air-conditioning capacity for every 1000 square feet of floor space. Window shading, attic insulation, and air leakage should be evaluated together with air-conditioner performance.

The following four installation-related problems are characteristic of central air conditioning systems.

1. Inadequate airflow.
2. Duct air leakage.
3. Incorrect charge.
4. Oversizing.

Refrigerant-charge tests and adjustment come after airflow measurement and improvement, and after duct testing and sealing. Manufacturers recommend that you verify adequate airflow before checking and adjusting the refrigerant charge.

**Table 8-15: Compiled Research Results on HVAC Performance<sup>a</sup>**

<b>Installation-Related Problem</b>	<b>%<sup>b</sup></b>	<b>Savings Potential</b>
Duct air leakage (Ave. 270 CFM <sub>25</sub> ) <sup>c</sup>	70%	17% Ave.
Inadequate airflow	70%	7% Ave.
Incorrect charge	74%	12% Ave.
Oversized by 50% or more	47%	2–10%

- a. Report sponsored by Environmental Protection Agency (EPA) and compiled from research from Multiple Field Studies
- b. Percent of tested homes found with a significant problem.
- c. The number of homes of the duct-leakage studies was around 14,000; the number for the other problems was over 400 each.


## 8.21.1 Central Air-Conditioner Inspection

Air conditioners move a lot of air, and that air contains dust. The filter in the air handler catches most large dust. However some dust travels around or through the filter, depending on the filter and its mounting assembly. The condenser coil outdoors isn't protected by a filter and is usually quite dirty.

### Cleaning the Condenser Coil

Dirt enters the coil from the outside. The goal of this procedure is to drive the dirt out by spraying inside to outside. With high-pressure water, however, you can drive the dirt through the coil and into the cabinet where it drains out through drain holes.

- ✓ Inspect the condenser coil and know that it is probably dirty even if it looks clean on the outside. Take a flat toothpick and scrape between the fins. Can you scrape dirt out from between the fins?
- ✓ Apply a biodegradable coil cleaner to the outside of the coil. Then spray cold water through the coil, preferably from inside the cabinet. Many coils can tolerate a high-pressure spray but others need low-pressure spray to avoid bending the fins.
- ✓ Straighten bent fins with a fin comb.

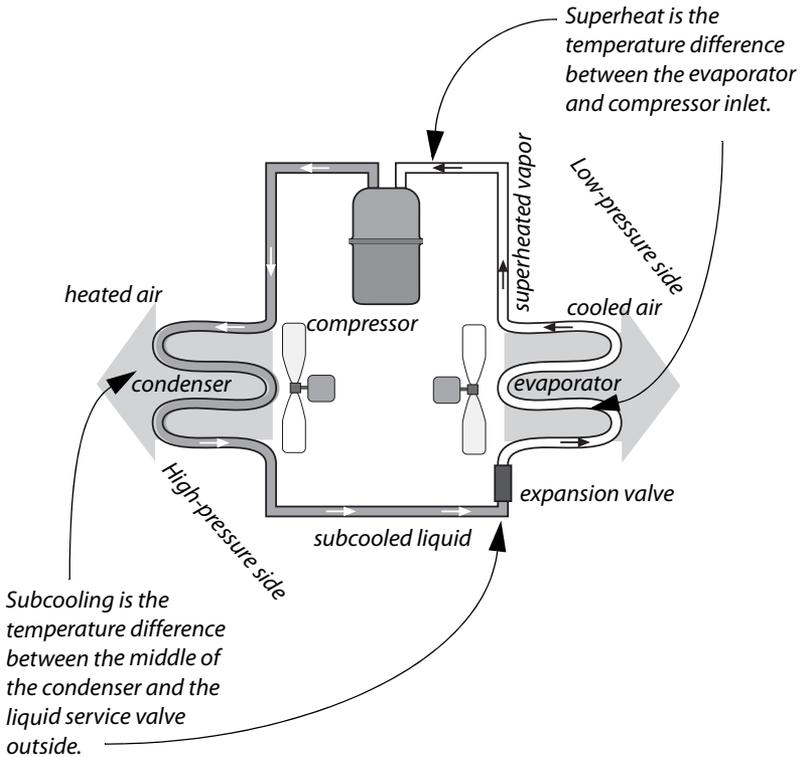


## Cleaning the Evaporator Coil

Dirt enters the filter, blower, and coil from the return plenum.

- ✓ Inspect the filter slot in the air handler or the filter grille in the return air registers. Do the filters completely fill their opening? Are the filters dirty?
- ✓ Inspect the blower in the air handler after disconnecting power to the unit. Can you remove significant dirt from one of the blades with your finger? If the blower is dirty, then the evaporator coil is also dirty.
- ✓ Clean the blower and evaporator. Technicians rake surface dirt and dust off the coil. Then they use an indoor coil cleaner and water for cleaning.
- ✓ Straighten bent fins with a fin comb.

## 8.21.2 Air-Conditioner Sizing

Calculate the correct size of an air conditioner before purchasing or installing it. The number of square feet of floor space that can be cooled by one ton of refrigeration capacity is determined by the home's energy efficiency. Air-conditioners provide cooling most cost-effectively when they are sized accurately and run for long cycles.

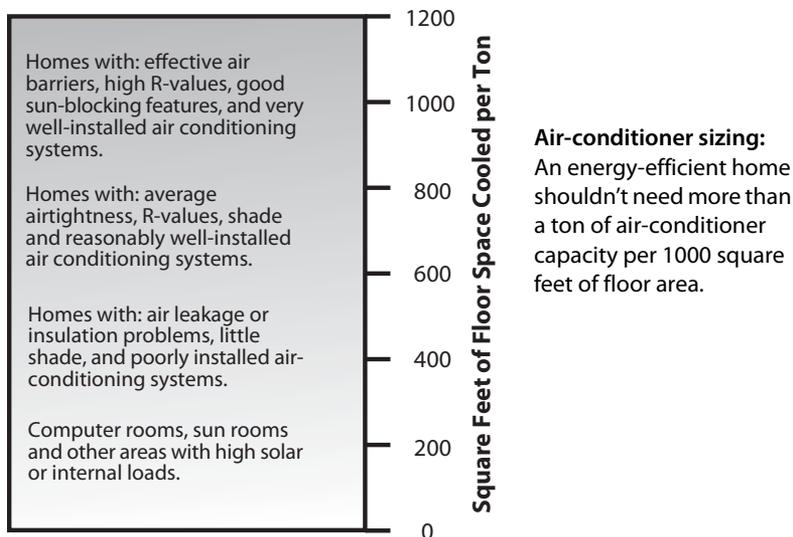

The cooling-cost reduction strategy should focus on making the home more energy efficient and making the air conditioner work more efficiently. Making the home more efficient involves shading, insulation, and air-leakage reduction. Making the air conditioner more efficient involves duct sealing, duct insulation, and a quality installation.

## 8.21.3 Duct Leakage and System Airflow

Unfortunately, duct leakage and poor airflow afflict most air-conditioning systems. The testing and mitigation of these problems was covered earlier in this chapter.


1. See *“Evaluating Duct Air Leakage”* on page 327.

2. See “Ducted Air Distribution” on page 315.

### 8.21.4 Evaluating Air-Conditioner Charge

Air-conditioning replacement or service includes refrigerant charge-checking. HVAC technicians evaluate refrigerant charge by two methods depending on what type of expansion valve the air conditioner has.

1. If the expansion valve has a fixed orifice, the technician performs a superheat test.
2. If the valve is a thermostatic expansion valve (TXV), the technician performs a subcooling test.

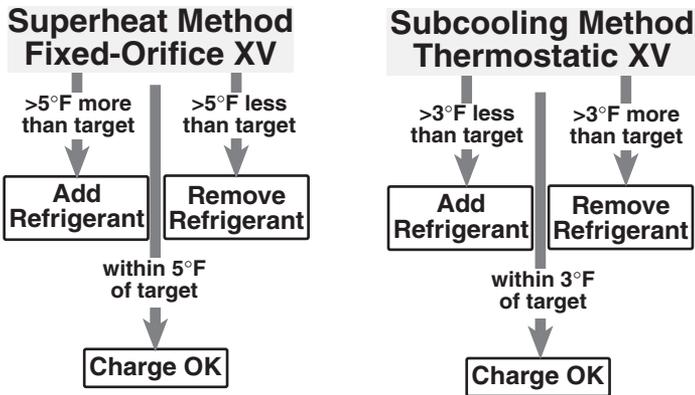

**Charge-checking:** Two methods help technicians judge whether the charge is correct. The remedy for incorrect charge is to either add or remove refrigerant.

These two tests indicate whether the amount of refrigerant in the system is correct, or whether there is too much or too little refrigerant. The amount of refrigerant is directly related to the efficiency of the air-conditioning system.

Perform charge-checking after the airflow tests, airflow adjustments, and duct-sealing are complete. Do charge-checking during the cooling season while the air conditioner is operating.

## 8.22 SWS ALIGNMENT

Field Guide Topic	SWS Detail
Combustion-Safety Evaluation Pg. 251	2.0105.1 Combustion Worker Safety, 5.3003.14 Combustion Analysis of Gas-Fired Appliances (LP and Natural Gas), 5.3003.2 Combustion Analysis of Oil-Fired Appliances
Combustion Safety Tests Pg. 251	
Leak-Testing Gas Piping Pg. 253	
Carbon Monoxide (CO) Testing Pg. 254	2.0105.1 Combustion Worker Safety, 2.0301.2 Carbon Monoxide Alarm or Monitor
Worst-Case CAZ Depressurization Testing Pg. 254	2.0105.1 Combustion Worker Safety, 2.0201.1 Combustion Appliance Zone (CAZ) Testing, 2.0201.2 Combustion Safety
Mitigating CAZ Depressurization and Spillage Pg. 258	
Zone Isolation for Atmospherically Vented Appliances Pg. 261	
Electronic Combustion Analysis Pg. 262	5.3003.2 Combustion Analysis of Oil-Fired Appliances 5.3003.14 Combustion Analysis of Gas-Fired Appliances (LP and Natural Gas), 2.0201.2 Combustion Safety
Critical Combustion-Testing Parameters Pg. 264	

<b>Field Guide Topic</b>	<b>SWS Detail</b>
Heating System Replacement Pg. 266	
Combustion Furnace Replacement Pg. 266	5.3001.1 Load Calculation and Equipment Selection, 5.3001.2 Ductwork and Termination Design, 5.3002.1 Preparation for New Equipment, 5.3003.1 Data Plate Verification
Gas-Fired Heating Installation Pg. 269	2.0201.2 Combustion Safety 5.3003.14 Combustion Analysis of Gas-Fired Appliances (LP and Natural Gas)
Combustion Boiler Replacement Pg. 272	2.0105.1 Combustion Worker Safety, 5.3001.1 Load Calculation and Equipment Selection, 5.3101.2 Space Load Calculation—Heat Emitter Sizing
Oil-Fired Heating Installation Pg. 275	2.0201.2 Combustion Safety, 2.0203.3 Draft Regulation—Category I Appliance, 5.3003.9 Heating and Cooling Controls, 5.3003.4 Evaluating Electrical Service
Evaluating Oil Tanks Pg. 278	
Combustion Space Heater Replacement Pg. 279	2.0201.2 Combustion Safety
Space Heater Operation Pg. 280	

<b>Field Guide Topic</b>	<b>SWS Detail</b>
Unvented Space Heaters Pg. 281	2.0202.1 Unvented Space Heaters: Propane, Natural Gas, and Kerosene Heaters, 2.0401.1 Air Sealing Moisture Precautions
Gas Burner Safety & Efficiency Service Pg. 282	
Combustion Efficiency Test for Furnaces Pg. 282	
Inspecting Gas Combustion Equipment Pg. 283	
Testing and Adjustment Pg. 283	
Oil Burner Safety and Efficiency Service Pg. 285	
Oil Burner Testing and Adjustment Pg. 285	5.3003.2 Combustion Analysis of Oil-Fired Appliances
Oil Burner Inspection and Maintenance Pg. 289	5.3003.4 Evaluating Electrical Service
Inspecting Furnace Heat Exchangers Pg. 291	
Wood Stoves Pg. 292	
Wood Stove Clearances Pg. 293	
Stove Clearances Pg. 293	
Wood Stove Inspection Pg. 294	
Inspecting Venting Systems Pg. 297	
Vent Connectors Pg. 297	
Masonry Chimneys Pg. 300	2.0203.2 Combustion Flue Gas—Orphaned Water Heaters

<b>Field Guide Topic</b>	<b>SWS Detail</b>
Manufactured Chimneys Pg. 304	
Chimney Terminations Pg. 305	
Air Leakage through Masonry Chimneys Pg. 306	4.1001.3 Fireplace Chimney and Combustion Flue Vents
Special Venting Considerations for Gas Pg. 307	
Venting Fan-Assisted Furnaces and Boilers Pg. 308	
Combustion Air Pg. 310	2.0203.1 Combustion Air for Natural Draft Appliances
Un-Confined-Space Combustion Air Pg. 311	
Confined-Space Combustion Air Pg. 311	
Ducted Air Distribution Pg. 315	
Sequence of Operations Pg. 315	
Solving Airflow Problems Pg. 315	5.3003.3 Evaluating Air Flow
Unbalanced Supply-Return Air-flow Test Pg. 319	
Evaluating Furnace Performance Pg. 322	
Improving Forced-Air System Airflow Pg. 324	
Evaluating Duct Air Leakage Pg. 327	
Troubleshooting Duct Leakage Pg. 327	

<b>Field Guide Topic</b>	<b>SWS Detail</b>
Measuring Duct Air Leakage with a Duct Blower Pg. 331	
Measuring House Pressure Caused by Duct Leakage Pg. 334	
Sealing Duct Leaks Pg. 335	
Sealing Return Ducts Pg. 335	3.1602.1 Air Sealing Duct System, 3.1602.5 Return—Framed Platform, 3.1602.4 Air Sealing System Components, 3.1602.7 Return and Supply Plenums in Basements and Crawl Spaces
Sealing Supply Ducts Pg. 337	3.1602.1 Air Sealing Duct System, 3.1602.5 Return—Framed Platform 3.1602.4 Air Sealing System Components, 3.1602.7 Return and Supply Plenums in Basements and Crawl Spaces 3.1601.3 Support
Materials for Duct Sealing Pg. 340	
Duct Insulation Pg. 340	4.1601.1 Insulating Flex Ducts, 4.1601.2 Insulating Metal Ducts
Spray Foam Duct Insulation Pg. 342	3.1602.2 Duct Spray Polyurethane Foam (SPF) Installation
Hot-Water Space-Heating Distribution Pg. 342	

<b>Field Guide Topic</b>	<b>SWS Detail</b>
Boiler Efficiency and Maintenance Pg. 343	
Distribution System Improvements Pg. 344	5.3104.2 Maintenance: Gas Boiler Service Inspection
Steam Heating and Distribution Pg. 347	
Steam System Maintenance Pg. 348	5.3104.3 Maintenance: Checklist
Steam System Energy Conservation Pg. 349	
Programmable Thermostats Pg. 352	5.3104.1 Controls — Thermostat Replacement
Electric Heat Pg. 352	
Electric Baseboard Heat Pg. 353	
Electric Furnaces Pg. 354	
Central Heat-Pump Energy Efficiency Pg. 354	
Room Heat Pumps Pg. 358	
Ductless Minisplit Pumps Pg. 360	
Evaluating Ducted Central Air-Conditioning Systems Pg. 361	
Central Air-Conditioner Inspection Pg. 362	
Air-Conditioner Sizing Pg. 364	
Duct Leakage and System Airflow Pg. 364	
Evaluating Air-Conditioner Charge Pg. 365	



## CHAPTER 9: VENTILATION

This chapter discusses ventilation, fans, termination fittings, and ducts. Before installing a ventilation system, read *“Health and Safety” on page 19* for more information on controlling the sources of moisture and indoor air pollutants.

This chapter covers these types of ventilation.

- Local or spot ventilation
- Whole-house ventilation
- Attic and crawl space ventilation
- Ventilation for cooling

### 9.1 POLLUTANT CONTROL

Controlling pollutants at the source is the highest priority for good indoor air quality. Mechanical ventilation can dilute pollutants. However, ventilation is ineffective against prolific sources of moisture and pollutants. Ask these questions to evaluate pollution sources.

- Do the occupants have symptoms of building-related illnesses? *See also “Health and Safety” on page 19.*
- Do sources of moisture like ground water, humidifiers, water leaks, or unvented space heaters cause indoor dampness, high relative humidity, or moisture damage? *See “Gas Range and Oven Safety” on page 25.*
- Are there combustion appliances, especially unvented ones, in the living space?
- Do the occupants smoke?
- Are there paints, cleaners, pesticides, gas or other chemicals stored in the home?

## 9.1.1 Pollution-Control Checklist

*SWS Details: 6.6005.1 Clothes Dryer, 6.6005.2 Kitchen Range*

Survey the home for pollutants before air-sealing the home. Perform the following pollutant control measures if needed.

- ✓ Repair roof and plumbing leaks.
- ✓ Install a ground moisture barrier over any bare soil in crawl spaces or dirt-floor basements.
- ✓ Verify that all dryer ducts and exhaust fans move their air to the outdoors.
- ✓ Verify that combustion-appliance vent systems operate properly. Don't air-seal homes if unvented space heaters will be left as the primary source of heat.
- ✓ Verify that kitchen range hoods vent to the outdoors.
- ✓ Move paints, cleaning solvents, and other chemicals out of the conditioned space if possible.

The home's occupants are often the source of many home pollutants, like candles and deodorizers. Educate the residents about minimizing pollutants in the homes.

## 9.2 WHOLE-BUILDING VENTILATION

*SWS Details: 6.6201.1 Installed System Air Flow*

Most homes in North America currently rely on air leakage for ventilation. The American Society of Heating, Refrigeration, and Air Conditioning Engineers (ASHRAE) publishes ventilation standards. Their current standard, ASHRAE 62.2-2013, requires fan-powered ventilation in all homes, as well as local exhaust ventilation in kitchens and bathrooms. The standard allows for natural infiltration (air leakage) to contribute toward the required whole-building ventilation rate. The standard also

allows for whole-building fan-powered ventilation to make up for insufficient local ventilation.

Refer to the standard for more details, guidance, and exceptions that are beyond the scope of this field guide. <http://www.tech-street.com/ashrae/products/1855284>. Residential Energy Dynamics provides a free online tool to help calculate ASHRAE 62.2-2013 ventilation rates. <http://residentialenergydynamics.com>

If you air-seal homes during weatherization, you may need to install whole-building mechanical ventilation systems under ASHRAE 62.2–2013, which has 3 components.

- Whole-building ventilation requirement.
- Local ventilation requirement.
- Natural infiltration credit.

## 9.2.1 Whole-Building Ventilation Requirement

*SWS Details: 6.6201.1 Installed System Air Flow, 6.9901.1 Supplemental Ventilation Information—ASHRAE 62.2, 6.6204.1 Commissioning Existing Exhaust or Supply Ventilation Systems, 6.6201.2 Primary Ventilation Air Flow between Rooms*

To comply with ASHRAE 62.2–2013, you can use either the formula or the table shown here to determine the whole-building ventilation airflow requirement. You can provide this fan-powered airflow in a number of ways.

- A dedicated exhaust or supply fan running continuously or cycling by automatic control.
- A bathroom or kitchen exhaust fan running continuously or cycling by automatic control.
- A central air handler drawing filtered outdoor air into its return.

- A balanced ventilation system such as a heat-recovery ventilator (HRV) or energy-recovery-ventilator (ERV).

If any room in the house exceeds  $\pm 3$  pa pressure with reference to the outdoors when all interior doors are closed and while the ventilation system is operating, then install transfer grilles or jumper ducts as needed to reduce the room to outdoors pressure difference to less than  $\pm 3$  pa. *SWS Detail: 6.6201.2 Primary Ventilation Air Flow between Rooms*

### Option 1: The Formula

If you want to install the minimum ventilation capacity, use these steps to follow the formula option.

1. Determine the floor area of the conditioned space of the home in square feet ( $A_{\text{floor}}$ ).
2. Determine the number of bedrooms ( $N_{\text{br}}$ ).
3. Insert these numbers in the formula below.

$$\text{Fan Airflow(CFM)} = 0.03A_{\text{floor}} + 7.5(N_{\text{br}} + 1)$$

*From ASHRAE Standard 62.2-2013 equation 4.1a.*

### Option 2: The Table

You can also determine the fan airflow under ASHRAE 62.2–2013 using the table shown here. This option will always provide a higher ventilation rate than the formula.

**Table 9-1: CFM Requirements for Whole-Building Ventilation**

Floor Area (ft <sup>2</sup> )	Number of Bedrooms				
	1	2	3	4	5
<b>&lt;500</b>	30	38	45	53	60
<b>501–1000</b>	45	53	60	68	75
<b>1001–1500</b>	60	68	75	83	90
<b>1501–2000</b>	75	83	90	98	105
<b>2001–2500</b>	90	98	105	113	120
<b>2501–3000</b>	105	113	120	128	135
<b>3001–3500</b>	120	128	135	143	150
<b>3501–4000</b>	135	143	150	158	165
<b>4001–4500</b>	150	158	165	173	180
<b>4501–5000</b>	165	173	180	188	195

Fan flow in CFM. From ASHRAE Standard 62.2-2013, Table 4.1a

## 9.2.2 Local Exhaust Ventilation Requirement

*SWS Detail: 6.6201.1 Installed System Air Flow, 6.6005.2 Kitchen Range*

There are two options for complying with the ventilation requirements for kitchens and bathroom. Demand controlled exhaust, or continuous exhaust.

- For demand controlled exhaust specify a minimum of 100 CFM for the kitchen, and 50 CFM for each bathroom.
- For continuous exhaust specify a minimum of 20 CFM for each bathroom, and 5 ACH for the kitchen (based on volume).

## Local Exhaust Deficit

If the existing kitchen or bathroom ventilation doesn't meet the requirements in "[Local Exhaust Ventilation Requirement](#)" on [page 377](#), you may adjust the whole-building ventilation rate to compensate for the local airflow deficits. Follow these steps to calculate the local-ventilation deficit in CFM that must be added to the whole-building ventilation rate.

1. Determine the total local exhaust ventilation requirement for all kitchens and bathrooms.
2. Measure the delivered airflow of existing kitchen or bathroom exhaust fans using flow hood, flow grid, or other airflow measuring device. Subtract this amount from the total local exhaust ventilation requirement.
3. If the local jurisdiction allows for operable windows to provide for local ventilation, subtract 20 CFM for each kitchen or bathroom that has an operable window.

The result of these steps is the local exhaust ventilation deficit in CFM. Add  $\frac{1}{4}$  of this deficit to the required whole-building ventilation rate.



**Measuring fan airflow:** Use an exhaust-fan flow meter or a flow hood to verify the airflows through local exhaust fans and whole-building ventilation fans.

### 9.2.3 Infiltration Credit

ASHRAE 62.2-2013 allows for infiltration to contribute to the building's ventilation. It is possible that infiltration will meet the entire whole-building ventilation requirement for very leaky

buildings. For moderately leaky buildings, infiltration may contribute a portion of the building’s ventilation. The amount of the infiltration credit is determined with a blower door test, the building height, and weather data based on the building’s location. Calculating the infiltration credit is complicated. To simplify the calculations, use the *RED Calc Free* online tool at <http://www.residentialenergydynamics.com/> and select the “Use Local Ventilation Alternative Compliance” option or consult with the formula and table shown next.

### Infiltration Credit Formula and Tables

To manually calculate the infiltration credit, use the formula below and the two tables that follow.

#### Infiltration Credit Formula

$$\text{Infiltration credit}_{\text{CFM}} = 0.52 \times \text{CFM}_{50} \times S \times \text{WSF}$$

Table 9-2: S-Values for Infiltration Credit

S- Values				
1	1.5	2	2.5	3
1.00	1.18	1.32	1.44	1.55

**Table 9-3: wsf-Values for Infiltration Credit**

<b>S- Values</b>	<b>wsf</b>
Northern Kentucky	0.50
Lexington / Bluegrass	0.48
Louisville Standiford AP	0.47
Louisville Bowman AP	0.41
Jackson	0.38
Henderson City	0.47
Fort Knox	0.45
London	0.42
Paduca	0.46
Somerset	0.38
Fort Campbell	0.44
Bowling Green	0.43

## 9.3 FAN AND DUCT SPECIFICATIONS

This section covers fan and duct specifications for both local ventilation and whole-building ventilation. Duct sizing, materials, and installation determine whether airflow meets the design amount (CFM). Most existing exhaust fans and ventilation systems don't achieve their design airflow because of installation flaws.

### 9.3.1 Fan Specifications

*SWS Detail: 6.6003.1 Surface-Mounted Ducted, 6.6003.2 Inline, 6.6003.3 Through the Wall, 6.6003.4 Multi-Port System, 6.6003.5 Garage Exhaust Fan, 6.6288.1 Sound-Rating Limits*

Continuous ventilation is highly recommended because it simplifies design and control. Continuous ventilation also minimizes depressurization by allowing selection of the minimum-

sized fan. Exhaust fans, installed as part of weatherization work, must vent to outdoors and should include the following features.

1. Rated for continuous operation if the fan operates continuously.
2. A weatherproof termination fitting.
3. Unless the fan operates continuously, the fan housing or termination fitting should house a backdraft damper.
4. Noise rating and ventilation efficacy as specified in the table.

**Table 9-4: Fan Noise Limits ASHRAE 62.2 - 2013**

<b>Fan</b>	<b>Noise Rating (sones)</b>
Continuous operation	1 sone or less
Local ventilation up to 400 CFM	3 sones or less

### Fan Installation

Observe these procedures when installing ventilation fans.

- ✓ Install the fan or ventilator as close as possible to its termination.
- ✓ Orient the fan or ventilator housing so that the exit fittings face toward their termination fittings.
- ✓ Remove an integral backdraft damper if the fan operates continuously.
- ✓ Be careful not to inhibit the back-draft-damper operation by installing screws that interfere with the damper's movement or by damaging the damper housing.
- ✓ Repair or replace the backdraft damper on an existing fan, if the damper doesn't open and close freely.
- ✓ Install in-line fans and multi-port ventilators in remote areas such as attics and crawl spaces and connect the fans to intake grilles in rooms.

- ✓ Isolate in-line fans and multi-port ventilators from framing to minimize noise.
- ✓ Measure the fan airflow to verify compliance with Standard 62.2 - 2013.



**Two- or variable-speed fan:** An occupancy sensor toggles between speeds. A 6-inch outlet provides airflow for whole-building ventilation.



**Advanced 4-speed range fan:** Lower speeds for continuous ventilation and higher ones for spot ventilation.



**In-line fan in attic:** A Y guides exhaust airflow from two bathrooms for both local exhaust and whole-building ventilation.

## 9.3.2 Termination Fittings

*SWS Detail: 6.6002.2 Terminations, 6.6102.2 Intakes*


Termination fittings for intake and exhaust ducts must exclude pests and water. Termination fittings must comply with these specifications.

- ✓ Termination fitting must direct water away from its opening.
- ✓ Flash or weather-seal termination fittings.
- ✓ Termination fittings must have insect screens over the openings.
- ✓ The termination-fitting collar must be the same diameter as the exhaust or intake fitting on the fan.



**PVC elbow:** This screened PVC elbow is an intake fitting for an HRV.

- ✓ If the fan has no backdraft damper and the fan operates intermittently, install a termination fitting with a backdraft damper, to operate in the direction of airflow.
- ✓ Fasteners must not interfere with backdraft-damper operation.

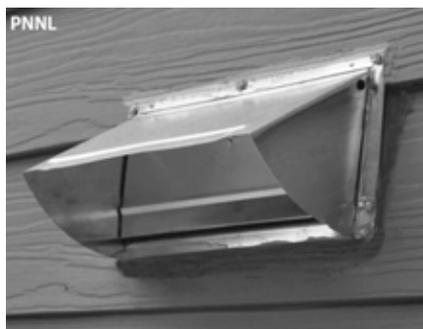

**Termination fitting:** If the fan operates intermittently, the termination fitting or the fan must have a backdraft damper.

## Locating Termination Fittings

Locate termination fittings using these specifications.

- ✓ At least 6 inches above grade
- ✓ At least 10 feet from another fan termination
- ✓ Above local snow or flood line
- ✓ At least 18 inches above a sloped asphalt based roof
- ✓ Never on a flat roof
- ✓ As required by local building authority
- ✓ Exhaust terminations must be at least 3 feet away from an operable window, an exterior door, or the property line.

### 9.3.3 Duct Sizing

Fans often fail to deliver their rated airflow capacity. Bends, unstraight flex duct, dirty grills, and backdraft dampers can reduce design airflow by 50% or more.

If you follow the sizing in this table, you may achieve the fan's rated airflow for short duct runs with a maximum of two elbows.

For more detailed duct-sizing recommendations, see [“ASHRAE 62.2 Duct Sizing” on page 493](#).

**Table 9-5: Round Duct Diameters (inches) for Desired Airflows**

<b>Desired CFM</b>	<b>25</b>	<b>50</b>	<b>75</b>	<b>100</b>	<b>150</b>	<b>200</b>
<b>Rigid</b>	4	5	6	7	8	9
<b>Flex duct</b>	5	6	7	8	9	10
Friction rate = 0.05; maximum equivalent length =100 feet						

## 9.3.4 Duct Materials and Installation

*SWS Detail: 6.6002.1 Ducts, 6.6002.2 Terminations, 6.6003.2 Inline, 6.6003.1 Surface-Mounted Ducted, 6.6003.4 Multi-Port System, 6.6005.2 Kitchen Range, 6.6102.1 Outside Air Ventilation Supply Ducts, 6.6102.2 Intakes, 6.6103.1 Inline or Multi-Port, 6.6202.2 Heat Recovery Ventilator (HRV) and Energy Recovery Ventilator (ERV) Installation*

This sections covers SWS requirements and best practices for installing ventilation ducts connected to exhaust fans, ventilators, and air handlers.

*See also "Sealing Duct Leaks" on page 335.*

### Rigid Duct Installation

Observe these best practices for installing rigid ventilation ducts.

- ✓ Prefer rigid smooth metal pipe (30 gauge or thicker) or plastic pipe (Schedule 30 or thicker) for ventilation duct.
- ✓ Limit elbows to a maximum of two per duct run.
- ✓ Use three sheet-metal screws to fasten sections of round metal duct together.
- ✓ Join rigid duct sections so the edge of male end of a duct section isn't opposing airflow.
- ✓ Follow manufacturer's instructions to join other types of rigid ducts together.
- ✓ Seal all rigid-duct joints and seams with mastic, mastic and webbing, or metal tape, labeled UL181B or UL181B-M. *See "Sealing Duct Leaks" on page 335.*
- ✓ Support metal ducts with at least  $\frac{1}{2}$ -inch, 18 gage strapping or at least 12-gage galvanized wire, not less than 10 feet apart.


- ✓ Insulate metal ducts to R-8 to prevent condensation if they travel through unconditioned spaces. *See “Duct Insulation” on page 340.*
- ✓ Fasten PVC exhaust ducts together with approved PVC cement.

## Flexible Duct Installation

Observe these best practices for installing flexible ducts.

- ✓ Stretch flex duct and support it every 4 feet with a 1.5-inch duct support.
- ✓ Use tool-tensioned plastic tie bands to join both the inner liner and the outer liner of the flex duct to the rigid duct or a fitting on the fan or termination fitting.
- ✓ Flexible air duct material must meet UL 181, NFPA 90A/90B, International Mechanical Code, or the Uniform Mechanical Code.

**Flex duct joint to metal:** Seal the metal takeoff to the main duct. Seal the inner liner of the flex duct to the takeoff with a tool-tensioned tie band.

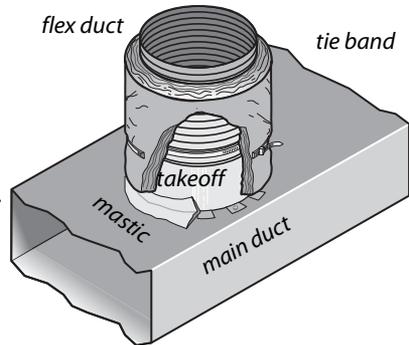

## 9.4 WHOLE-BUILDING VENTILATION SYSTEMS

This section discusses three options for design of whole-building ventilation systems.

- ✓ Exhaust ventilation
- ✓ Supply ventilation

- ✓ Balanced ventilation

See *“Fan and Duct Specifications” on page 380.*

We begin by discussing ducts for all types of ventilation systems.

## 9.4.1 Exhaust Ventilation


### *SWS Detail: 6.6201.1 Installed System Air Flow*

Exhaust ventilation systems employ an exhaust fan to remove indoor air, which is replaced by infiltrating outdoor air.

Installing a two-speed bathroom fan is a common ventilation strategy. The new fan runs continuously on low speed for whole-building ventilation. A built-in occupancy sensor switches the fan automatically to a high speed to remove moisture and odors from the bathroom quickly.

A remote fan that exhausts air from several rooms through ducts (4-to-6 inch diameter) may provide better ventilation for larger more complex homes, compared to a single-point exhaust fan.

- ✓ Fans must conform to *“Fan Specifications” on page 380*
- ✓ Ducts must conform to *“Duct Materials and Installation” on page 385.*
- ✓ Termination fittings must conform to *“Termination Fittings” on page 382.*

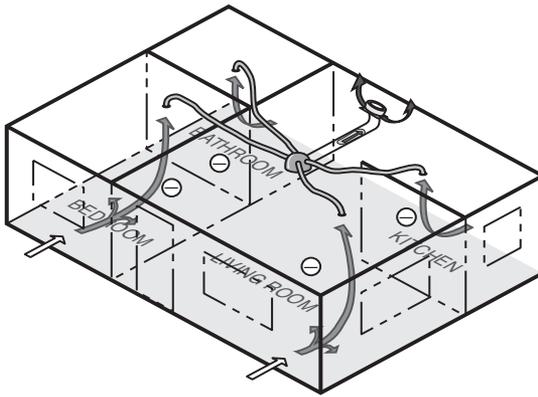

**Multi-port exhaust ventilation:** A multi-port ventilator creates better fresh-air distribution than a single central exhaust fan.



**Passive intake vent:** Exhaust ventilation systems often use passive vents to supply make-up air. This vent is close-able for very cold weather.

Exhaust ventilation systems create a negative house pressure, drawing outdoor air in through leaks in the shell. This keeps moist indoor air from traveling through building cavities, which would occur with a positive house pressure. The negative house pressure reduces the likelihood of moisture accumulation in building cavities during the winter months in cold climates. In hot and humid climates, however, this depressurization can draw moist outdoor air into the home through building cavities. Therefore we recommend supply ventilation for warm humid climates rather than exhaust ventilation.


## 9.4.2 Supply Ventilation

*SWS Detail: 6.6102.3 Intake for Ventilation Air to Forced Air System Used for Heating or Cooling*

Supply ventilation, using the home's air handler, is never operated continuously as with exhaust ventilation because the furnace or heat-pump blower is too large and would over-ventilate

the home and waste electrical energy. Supply ventilation may not be appropriate for tight homes in very cold climates because supply ventilation can push moist indoor air through exterior walls, where moisture can condense on cold surfaces.

**Supply ventilation:** A furnace or heat pump with an outside air duct intake is used for ventilation with a control that ensures sufficient ventilation.

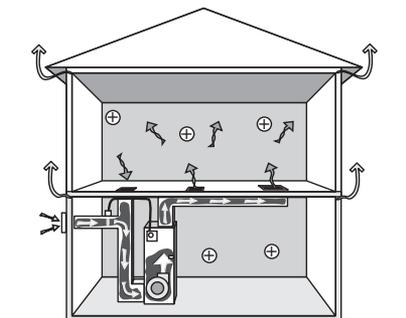

## Motorized Outdoor-Air Damper

A motorized damper that opens when the air-handler blower operates must control outdoor-air supply. The furnace/air conditioner heats or cools the outdoor air as necessary before delivering it to the living spaces.

The damper control estimates how much ventilation air is needed. The damper closes after the required amount of ventilation air has entered during heating or cooling. The control also activates the damper and the blower for additional ventilation air as needed without heating or cooling the air, during mild weather.

## Supply-Ventilation System Requirements

Supply ventilation typically uses the furnace or heat pump as a ventilator. A 5-to-10 inch diameter duct connects the furnace's main return duct to a termination outdoors.

- ✓ The existing duct system must leak less than 10% of the air handler flow when measured at 25 Pa. WRT outside.
- ✓ The outdoor air must flow through a MERV 6 or better air filter before flowing through heating and cooling equipment.

- ✓ Ducts must conform to *“Duct Materials and Installation” on page 385.*
- ✓ Termination fittings must comply with *“Termination Fittings” on page 382.*


### 9.4.3 Balanced Ventilation

#### *SWS Detail: 6.6202.2 Heat Recovery Ventilator (HRV) and Energy Recovery Ventilator (ERV) Installation*

Balanced ventilation systems exhaust stale air and provide fresh air through a ducted distribution system. Of the three ventilation systems discussed here, balanced systems do the best job of controlling pollutants in the home.

Balanced systems move equal amounts of air into and out of the home. Most balanced systems incorporate heat-recovery ventilators or energy-recovery ventilators that reclaim heat and moisture from the exhaust air stream.

**Centralized balanced ventilation:**  
Air is exhausted from areas most likely to contain pollutants and fresh air is supplied to living areas.

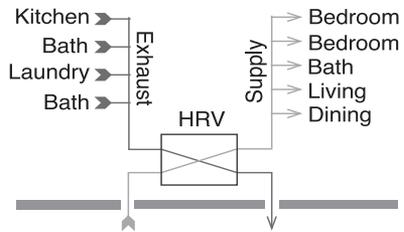


Balanced ventilation systems can improve the air quality and comfort of a home, but they require a high standard of care. Testing and commissioning is vital during both the initial installation and periodic service calls.

#### Heat-Recovery and Energy-Recovery Ventilators

The difference between heat-recovery ventilators (HRVs) and energy-recovery ventilators (ERVs) is that HRVs transfer heat only, while ERVs transfer both sensible heat and latent heat (moisture) between air streams.

HRVs are often installed as balanced whole-building ventilation systems. The HRV core is an air-to-air heat exchanger in which the supply and exhaust air streams pass one another and exchange heat without mixing.

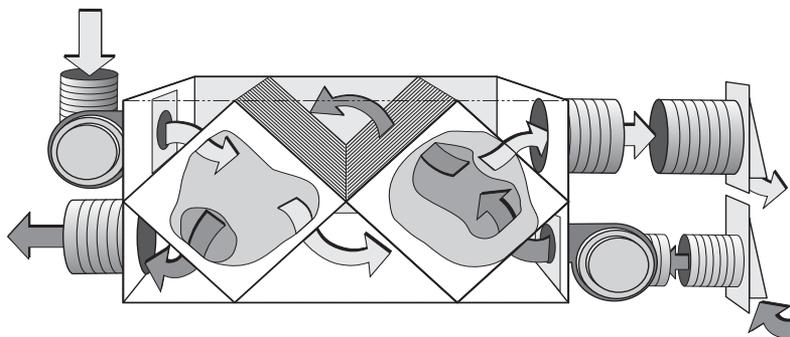

**Heat-recovery ventilator:** Heat from the exhaust air heats a plastic or aluminum heat exchanger, which in turn heats the fresh intake air. Two matched fans provide balanced ventilation.

#### 9.4.4 Adaptive Ventilation

The home's residents can maintain good indoor air quality by using spot ventilation together with opening windows and doors. Depending on climate and season, residents can control natural ventilation to provide clean air, comfort, and energy efficiency.

- ✓ Choose windows and screen doors in strategic locations to ventilate using prevailing winds.
- ✓ Make sure that windows and screen doors, chosen for ventilation, open and close and have effective insect screens.
- ✓ Open windows to provide make-up air when an exhaust fan or the clothes dryer is operating.
- ✓ Understand that dust and pollen may enter through windows or screen doors and consider the consequences.

## 9.5 ATTIC VENTILATION

### *SWS Detail: 4.1088.1 Attic Ventilation*

Attic ventilation has the following functions.

- To keep the attic insulation and the attic's other building materials dry by circulating dry outdoor air through the attic.
- To prevent ice dams in cold weather by preventing snow melt by keeping the roof deck cold during the winter.
- To remove solar heat from the attic during the summer.

### 9.5.1 Attic Ventilation as a Solution for Moisture Problems

The best way to keep attic insulation dry is to air-seal the attic floor to block moist air from entering the attic. Adding attic vents may help to solve certain attic moisture problems.

- Seasonal moisture deposition removed by vents.
- Ice damming in areas that currently lack high and low vents.

Adding attic vents won't solve these attic moisture problems.

- Moisture deposited by air leaks between the living space and the attic.
- Rain driven through attic vents.
- Roof leaks that dampen building materials beyond the capacity of the vents to dry.

### 9.5.2 When to Install Attic Ventilation

Install more attic ventilation only if you believe that the home needs one of the attic-ventilation functions listed above.

- Don't increase attic ventilation without first sealing attic air leaks and testing the attic air barrier for adequate airtightness.
- Avoid cutting new vents through the roof to avoid the possibility of roof leaks.
- Attic ventilation may not provide a useful function in some climates, such as persistently damp climates or windy, rainy climates.

**Important note:** An outright exception to ventilating attics is offered by the IRC if a code official determines that “atmospheric or climatic conditions” aren't favorable to attic ventilation.

### 9.5.3 Attic Ventilation Requirements


Always vent exhaust fans directly to outdoors (through a soffit, gable, or wall) and never into a ventilated attic.

Net free area is the area of the vent minus the vent's solid obstructions such as screens and louvers. The net free area is typically 50% to 70% of the gross vent area.

The IRC and SWS state these requirements for attic ventilation.

- ✓ Provide a maximum ratio of one square foot of net free vent area to 150 square feet of attic area.
- ✓ The IRC requires only one square foot of net free area per 300 square feet of attic area for ceilings, with an interior vapor barrier, or with distributed ventilation (high and low), or with thorough air-sealing of the ceiling.
- ✓ Vents must have screens, with  $\frac{1}{4}$ -to- $\frac{1}{16}$  inch or less opening, to prevent the entry of pests and to reduce the entry of snow and rain.
- ✓ Vertical vents must have louvers to deflect rain.

**Soffit chute or baffle:** Install a maximum amount of insulation that the baffle allows. The chute prevents wind-washing and conveys the ventilation air over the insulation. The distributed vents ventilate the whole surface of the insulation and cool the whole roof in winter, preventing ice damming.

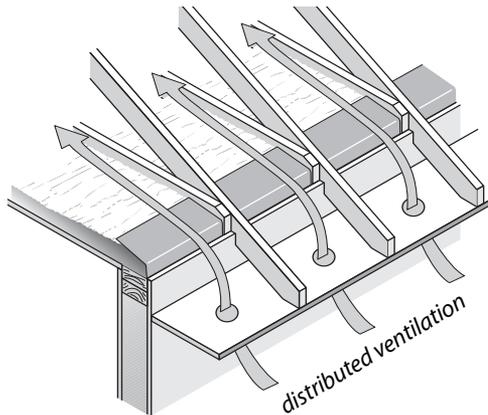


- ✓ Install vent chutes or baffles to prevent blown insulation from entering the space between soffit vents and the attic. The baffles should allow the maximum amount of insulation to be installed over top plates without restricting ventilation paths. Vent chutes or baffles also help prevent the wind-washing of insulation caused by cold or hot air entering soffit vents. They should extend upwardly along the rafter to at least 4 inches above the finished insulation level.
- ✓ Don't use powered ventilators to increase attic ventilation because of their energy consumption and doubtful effectiveness.

## High and Low Vents

A combination of high and low vents is the best way to move ventilating air through the attic. Soffit vents and ridge vents are an ideal combination for high-low attic ventilation. However, gable vents and roof vents, located high or low, also create acceptable ventilation.

**Low and high attic ventilation:** Distributed ventilation — high and low — is more effective than vents that aren't distributed.

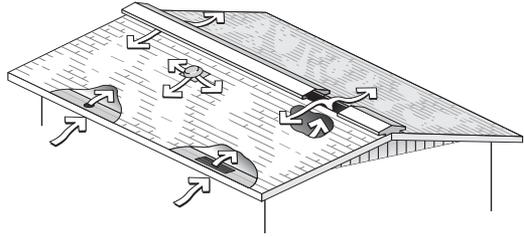

## 9.5.4 Power Ventilators

Power ventilators have limited value ventilating attics for air-conditioning energy savings or moisture mitigation.

- Power ventilators typically run longer than necessary.
- Power ventilators often consume more electricity than they save in reduced air conditioning.
- Power ventilators can pull conditioned air out through ceiling air leaks, counteracting their ventilating or cooling benefit.

## 9.5.5 Unventilated Attics

According to the IRC, new attics may be unventilated if the two conditions listed here are met.

1. The roof assembly is insulated with an air-impermeable insulation, such as high-density sprayed polyurethane, to the bottom of the roof sheathing.
2. There is no vapor barrier installed in the ceiling.

Existing unventilated attics don't need additional vents unless there is evidence indicating that additional ventilation is necessary.

## 9.6 CRAWL SPACE VENTILATION

*SWS Detail: 2.0401.2 Vented Crawl Space—Venting, 2.0111.2 Crawl Spaces—Pre-Work Qualifications, 2.0111.3 Crawl Spaces—Debris Removal, 2.0404.3 Closed Crawl Spaces—Crawl Space Conditioning, 2.0701.1 Crawl Spaces—Providing Access*

Before taking steps to improve crawl space ventilation, comply with these requirements.

- ✓ Install a ground moisture barrier as specified in *“Crawl Space Moisture and Safety Issues” on page 34*.
- ✓ The crawl space should have an access hatch or door that is 24 inches by 18 inches.

### 9.6.1 Naturally Ventilated Crawl Spaces

*SWS Detail: 2.0401.1 Air Sealing Moisture Precautions, 2.0403.3 Closed Crawl Spaces—Vapor Retarders on Walls*

When insulating the floor, the crawl space is usually ventilated naturally through passive vent openings in the foundation wall. A ground moisture barrier protects the floor insulation and other building materials from moisture. The vent openings can remove small amounts of moisture from the crawl space. Two specifications apply to ventilated crawl spaces.

1. A crawl-space with a ground-moisture barrier may have vent openings equal to 1 square foot of vent area to 300 square feet of crawl-space floor area. A minimum of two vents should be installed on opposite corners of the crawl space.
2. In a dry crawl space with a ground-moisture barrier, ventilation openings may be minimized to one square foot of net free ventilation area for every 1500 square feet of crawl-space floor area, according to the 2012 IRC.

## 9.6.2 Power-Ventilated Crawl Spaces

### *SWS Detail: 2.0401.1 Air Sealing Moisture Precautions*

The 2012 International Residential Code (IRC) allows you to seal the crawl-space vents when you insulate the foundation walls. These three specifications apply to unventilated, power-ventilated, or conditioned crawl spaces.

1. If you removed moisture sources like standing water and installed a ground-moisture barrier, then you can seal the foundation vents completely.
2. The IRC requires foundation insulation installed from the subfloor to the ground in the crawl space. Then install the insulation 24 inches horizontally to lengthen the horizontal heat transmission path from the crawl space to outdoors.
3. The 2012 International Residential Code (IRC) requires 1 CFM per 50 square feet of crawl space floor area in powered exhaust ventilation. The IRC requires openings from the crawl space into the home so that make-up air comes from the living space.

## 9.6.3 Conditioned Crawl Spaces

### *SWS Details: 2.0403.2 Closed Crawl Spaces—Ground Moisture Barriers, 2.0404.3 Closed Crawl Spaces—Crawl Space Conditioning*

The 2012 International Residential Code (IRC) requires 1 CFM per 50 square feet of crawl space floor area in conditioned supply air from a forced-air system. The IRC requires openings from the crawl space into the home for this option.

The conditioned crawl space, although allowed by the IRC, may be an ineffective moisture-and-energy solution for existing crawl spaces. Heating the ground in winter wastes energy.


Refrigerating the ground in summer with an air-conditioning system wastes energy and may also cause moisture problems. We can't recommend this practice.

## 9.7 VENTILATION FOR COOLING

Ventilation cooled homes for centuries before air conditioning was invented. Ventilation is still an effective method for clients who can't afford air conditioning. Ventilate with fans during the coolest parts of the day and night, and close the windows during the hottest periods.



**Modern whole-house fans:**  
Modern models feature multiple speeds, tight-sealing insulated enclosures, and quiet operation

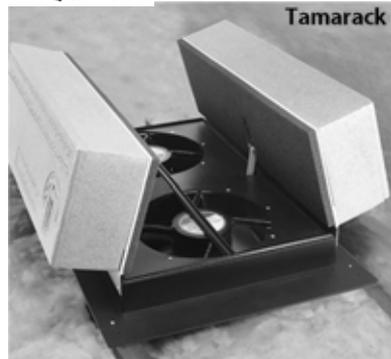


### 9.7.1 Whole-House Fans

Whole-house fans range in diameter from 24 inches to 42 inches, with capacities ranging from 3,000 to 10,000 cubic feet per minute (cfm). The capacity of the fan in cfm is rated for two different conditions: 1) free air; and 2) air constricted by 1 inch of static pressure. The second condition is closer to the actual operating conditions of the fan in a home, and the cfm rating at 1 inch of static pressure may still be 10 to 30 percent higher than

the actual volume of air moved by the installed whole-house fan. This means you should probably install a fan with a greater capacity than the sizing recommendations that follow.

Whole-house fans require 2 to 4 times the normal area of attic vent openings. Install a minimum of 1 square foot of net free area for every 750 cfm of fan capacity. However, more vent area is better for optimal whole-house-fan performance because the extra vent area increases airflow.

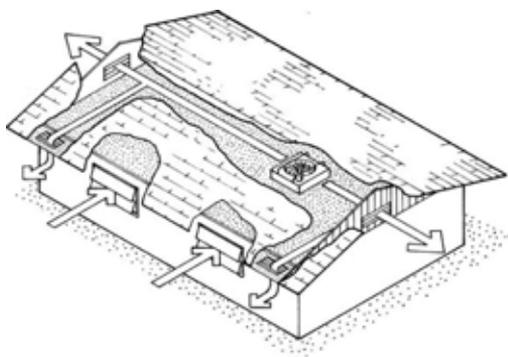

**Whole-house fan circulation:** the whole-house fan sucks air out of the house and exhausts it into the attic or through a gable wall. Cooler air enters the windows as make-up air for the fan.

To estimate the suitable size of a whole-house fan in cubic feet per minute, first determine the volume of your home in cubic feet. To calculate volume, multiply the square footage of the floor area in your home that you want to cool by the height from floor to ceiling. Take that volume and multiply by 15 to 40 air changes per hour, depending on how much ventilation you want. Then, divide by 60 minutes to get cubic feet per minute of capacity for the whole-house fan.

$$\text{Fan Airflow(CFM)} = \frac{\text{House volume X 15-40 ACH}}{60}$$

Some fans come with a tight-sealing winter cover. If the fan doesn't have such a cover, or if the doesn't allow you to cover the fan easily, then you can fabricate a cover for the grille on the ceiling. A seasonal cover, held in place with rotating clips or


spring clips and sealed with foam tape, works well. If the clients switch between air conditioning and cooling with a whole-house fan as the summer weather changes, build a tightly-sealed, hinged door for the fan opening that is easy to open and close when they switch cooling methods.

**Air-sealed and dammed whole-house fan:** The skylight shaft must be insulated and air sealed from the ceiling to the roof.




## 9.7.2 Window Fans

Window fans are best used in windows facing the prevailing wind or away from it to provide cross ventilation. Window fans can augment any breeze or create a breeze when the air is still. If the wind direction changes in your area, use reversible type window fans so you can either pull air into the home or push air out, depending on which way the wind is blowing. Experiment with positioning the fans in different windows to see which arrangement works best.

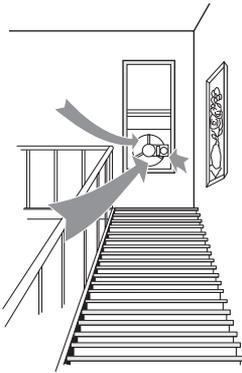

**Window fans:** Window fans circulate outdoor air when it is cooler than indoor air. The air circulation removes heat from the house.

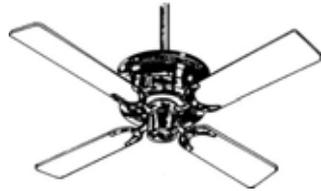

**Ceiling fans:** Ceiling fans cool people by convecting air next to their skin and helping evaporate sweat.

### 9.7.3 Air Circulation

Air circulating fans are very effective cooling energy savers. Air circulating fans may allow a 4 degree rise in the thermostat setting with no decrease in comfort.

Use circulating fans with air conditioners, evaporative coolers, whole-house fans, or by themselves. Circulating fans save cooling energy by increasing air movement over the skin to help occupants feel cooler.

Ceiling fans and various types of portable fans provide more comfort at less cost than any other electrically powered cooling strategy. Options include: small personal fans that sit on table-tops, or heavier units that sit on the floor or on metal stands with wheels.

Ceiling fans produce high air speeds with less noise than oscillating fans or box fans. High quality ceiling fans are generally more effective and quieter than cheaper ones. Ceiling fans are a key element to providing low-cost comfort to a home.


### 9.7.4 Evaporative Coolers

*SWS Detail: 3.1602.6 Capping Dual-Cooling Up-Ducts, 5.3003.8 Evaporative Cooler Maintenance and Repairs*

Evaporative coolers (also called swamp coolers) are an effective energy efficient cooling strategy in dry climates. An evaporative cooler is a blower and wetted pads installed in a compact louvered air handler.

Evaporative coolers employ different principles from air conditioners because they reduce air temperature without removing heat from the air. They work well only in climates where the summertime relative humidity remains less than 50%. They compare to an air conditioner with a SEER between 30 and 40, which is 2 to 3 times the SEER of the most efficient air conditioners.


Installers mount evaporative coolers on a roof, through a window or wall, or on the ground. The cooler can discharge air directly into a room or hall or it can be connected to ducts for distribution to numerous rooms.

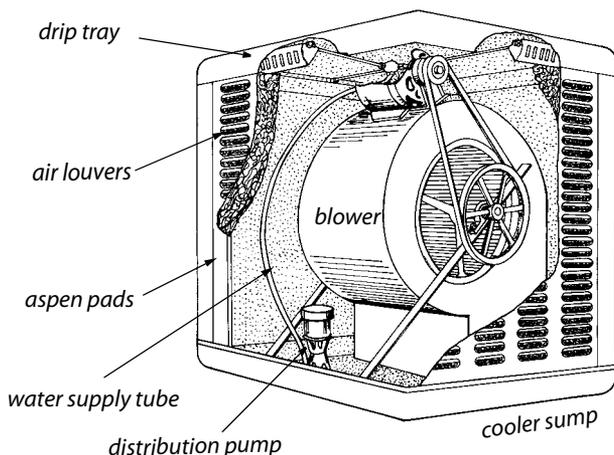

### Evaporative Cooler Operation

The evaporative cooler's blower moves outdoor air through water-saturated pads, reducing the air's temperature to below the indoor air temperature. The blower moves this evaporatively cooled outdoor air into the house, pushing warmer indoor air out through open windows or dedicated up-ducts.

A water pump in the reservoir circulates water through tubes into a drip trough, which then drips water into the thick pads. A float valve connected to the home's water supply keeps the reservoir supplied with fresh water to replace the water that evaporates.

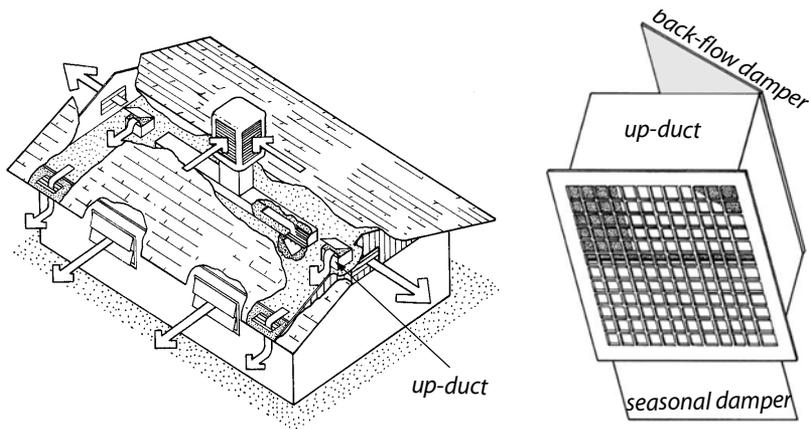

**Air circulation:** Outdoor air is sucked through the evaporative cooler and blown into the home pushing house air out of the partially open windows. Some homes with evaporative coolers employ up-ducts instead of open windows for security concerns.

Opening windows in occupied rooms, and closing windows in unoccupied rooms concentrates the cooling effect where residents need it. Experiment to find the right windows to open and how wide to open them. If the windows are open too wide hot air will enter. If the windows are not open far enough humidity will rise, and the air will feel sticky.

## Up-Ducts

Up-ducts are one-way vents from the living space to the attic. Up-ducts are for occupants who want to avoid opening windows for security reasons. The cool air from the evaporative cooler flows into the living space, through the up-ducts, into the attic, and out the attic vents. Up-ducts can be a significant source of air leakage. They may be temporarily sealed seasonally or even removed during weatherization.

## Evaporative Cooler Sizing and Selection

Evaporative coolers are rated in cubic feet per minute (cfm) of airflow they deliver. Airflow capacity ranges from 2000 to 7000 cfm. Recommendations vary from 2-to-3 cfm per square foot of floor space for warm dry climates and 3-to-4 cfm/sf for hot desert climates.

## Evaporative Cooler Maintenance

Evaporative coolers see a lot of water, air, and dirt during operation. Dirt is the enemy of evaporative-cooler operation. Evaporative coolers process a lot of dirt because their aspen pads are good filters for dusty outdoor air.

Airborne dirt that sticks to the cooler pads washes into the reservoir. Most evaporative coolers have a bleed tube or a separate pump that changes the reservoir water during cooler operation to drain away dirty water. Evaporative coolers need regular cleaning, depending on how long the cooler runs and how well the dirt-draining system is working. Be sure to disconnect the electricity to the unit before servicing or cleaning it.

Observe these general specifications for maintaining evaporative coolers.

- ✓ Aspen pads can be soaked in soapy water to remove dirt. Clean louvers in the cooler cabinet when you clean or change pads. Replace the pads when they become unabsorbent, thin, or loaded with scale and entrained dirt.
- ✓ If there is a bleed tube, check discharge rate by collecting water in a cup or beverage can. You should collect a cup in three minutes or a can in five minutes.
- ✓ If the cooler has two pumps, one is a sump pump. The sump pump drains the sump every five to ten minutes of cooler operation.
- ✓ If there is noticeable dirt on the blower's blades, clean the blower.

- ✓ Clean the holes in the drip trough that distributes the water to the pads.
- ✓ Clean the reservoir every year to remove dirt, scale, and biological matter.
- ✓ Pay particular attention to the intake area of the circulating pump during cleaning. Debris can get caught in the pump impeller and stop the pump.
- ✓ Check the float assembly for positive shutoff of water when the sump reaches its level. Repair leaks and replace a leaky float valve.
- ✓ Investigate signs of water leakage and repair water leaks.

**Table 9-6: Evaporative Cooler Discharge Temperatures**

		Outdoor Relative Humidity %														
		2	5	10	15	20	25	30	35	40	45	50	55	60	65	70
Outdoor Temperature F	75	54	55	57	58	59	61	62	63	64	65	66	67	68	69	70
	80	57	58	60	62	63	64	66	67	68	71	72	73	74	76	76
	85	61	62	63	65	67	68	70	71	72	73	74	75	76	77	79
	90	64	64	67	69	70	72	74	76	77	78	79	81	82	83	84
	95	67	68	70	72	74	76	78	79	81	82	84	85	87		
	100	69	71	73	76	78	80	82	83	85	87	88				
	105	72	74	77	79	81	84	86	88	89						
	110	75	77	80	83	85	87	90	92							
	115	78	80	83	86	89	91	94								
	120	81	83	86	90	93	95									
125	83	86	90	93	96											

An evaporative cooler with good pads and adequate airflow should give the temperatures listed here, depending on outdoor temperature and relative humidity.

## 9.8 SWS ALIGNMENT

Field Guide Topic	SWS Detail
Pollutant Control Pg. 373	
Pollution-Control Checklist Pg. 374	6.6005.1 Clothes Dryer, 6.6005.2 Kitchen Range
Whole-Building Ventilation Pg. 374	6.6201.1 Installed System Air Flow
Whole-Building Ventilation Requirement Pg. 375	6.6201.1 Installed System Air Flow, 6.9901.1 Supplemental Ventilation Information—ASHRAE 62.2, 6.6204.1 Commissioning Existing Exhaust or Supply Ventilation Systems, 6.6201.2 Primary Ventilation Air Flow between Rooms
Local Exhaust Ventilation Requirement Pg. 377	6.6201.1 Installed System Air Flow 6.6005.2 Kitchen Range
Fan and Duct Specifications Pg. 380	
Fan Specifications Pg. 380	6.6003.1 Surface-Mounted Ducted, 6.6003.2 Inline, 6.6003.3 Through the Wall, 6.6003.4 Multi-Port System, 6.6003.5 Garage Exhaust Fan 6.6288.1 Sound-Rating Limits
Termination Fittings Pg. 382	6.6002.2 Terminations 6.6102.2 Intakes
Duct Sizing Pg. 384	

Field Guide Topic	SWS Detail
Duct Materials and Installation Pg. 385	6.6002.1 Ducts, 6.6002.2 Terminations, 6.6003.2 Inline, 6.6003.1 Surface-Mounted Ducted, 6.6003.4 Multi-Port System, 6.6005.2 Kitchen Range, 6.6102.1 Outside Air Ventilation Supply Ducts, 6.6102.2 Intakes, 6.6103.1 Inline or Multi-Port, 6.6202.2 Heat Recovery Ventilator (HRV) and Energy Recovery Ventilator (ERV) Installation
Whole-Building Ventilation Systems Pg. 386	
Exhaust Ventilation Pg. 387	6.6201.1 Installed System Air Flow
Supply Ventilation Pg. 388	6.6102.3 Intake for Ventilation Air to Forced Air System Used for Heating or Cooling
Balanced Ventilation Pg. 390	6.6202.2 Heat Recovery Ventilator (HRV) and Energy Recovery Ventilator (ERV) Installation
Adaptive Ventilation Pg. 391	
Attic Ventilation Pg. 392	4.1088.1 Attic Ventilation
Attic Ventilation as a Solution for Moisture Problems Pg. 392	
When to Install Attic Ventilation Pg. 392	
Attic Ventilation Requirements Pg. 393	

<b>Field Guide Topic</b>	<b>SWS Detail</b>
Power Ventilators Pg. 395	
Unventilated Attics Pg. 395	
Crawl Space Ventilation Pg. 396	2.0401.2 Vented Crawl Space—Venting, 2.0111.2 Crawl Spaces—Pre-Work Qualifications, 2.0111.3 Crawl Spaces—Debris Removal, 2.0404.3 Closed Crawl Spaces—Crawl Space Conditioning, 2.0701.1 Crawl Spaces—Providing Access
Naturally Ventilated Crawl Spaces Pg. 396	2.0401.1 Air Sealing Moisture Precautions, 2.0403.3 Closed Crawl Spaces—Vapor Retarders on Walls
Power-Ventilated Crawl Spaces Pg. 397	2.0401.1 Air Sealing Moisture Precautions
Conditioned Crawl Spaces Pg. 397	2.0403.2 Closed Crawl Spaces—Ground Moisture Barriers, 2.0404.3 Closed Crawl Spaces—Crawl Space Conditioning
Ventilation for Cooling Pg. 398	
Whole-House Fans Pg. 398	
Window Fans Pg. 400	
Air Circulation Pg. 401	
Evaporative Coolers Pg. 401	3.1602.6 Capping Dual-Cooling Up-Ducts 5.3003.8 Evaporative Cooler Maintenance and Repairs

# CHAPTER 10: BASELOAD MEASURES

Baseload energy consumption accounts for a large part of home energy use. This chapter discusses energy savings for refrigeration, entertainment, lighting, laundry, and water heating.

**Table 10-1: Levels of Household Electric Baseload Consumption**

<b>Indicator</b>	<b>Low</b>	<b>Medium</b>	<b>High</b>
kWh per Year	<4500	4500–8500	>8500
kWh per Month	<375	375–700	>700
kWh per Day	<12	12–23	>23
kWh per Person (Annual)	<1900	1900–3500	>3500

Doesn't include heating, cooling, or water heating. Assumes 2.4 persons per household and average annual consumption of 6500 kWh per household.

**Table 10-2: Electrical Consumption of Typical Appliances**

<b>Appliance</b>	<b>Annual usage (kWh)</b>	<b>Annual cost</b>
Ten-year-old refrigerator or freezer	1250	\$188
New ENERGY STAR refrigerator or freezer	500	\$75
Television	100–1000	\$15–\$150
Clothes dryer	1200	\$180
Well pump	500	\$75
Furnace fan	500	\$75
Computer	50–400	\$8–\$60
Hot tub, spa	2300	\$345
Water bed	1000	\$150

Data from Lawrence Berkeley Laboratory and others. Based on 15¢ per kilowatt-hour for electricity.

## 10.1 REFRIGERATOR REPLACEMENT AND MAINTENANCE

Refrigerators built after 1993 use less electricity than refrigerators built before that year. Another efficiency increase occurred in 1999 in the refrigerator industry.

### 10.1.1 Refrigerator Replacement

#### *SWS Detail: 7.8001.1 Refrigerator and Freezer Replacement*

Comply with the following requirements when replacing refrigerators.

- ✓ The new refrigerator must fit the existing space.

- ✓ The new refrigerator must be 40% more efficient than the minimum federal standards or be labeled ENERGY STAR.
- ✓ Take refrigerators that are replaced to a facility that is licensed to reclaim their refrigerant and recycle the refrigerator's parts.
- ✓ No refrigerator, taken out of service, may be returned to service by sale, barter, or for free.
- ✓ Instruct the client about location and operation of energy controls such as the thermostats for the refrigerator and freezer.

Some clients use two or more refrigerators in their homes, and this practice results in high electricity usage. Suggest to these clients to consolidate food storage into a large single refrigerator.



**Refrigerator clean and tune:**  
Clean coils and check temperatures. Adjust temperatures that are out of range.




### 10.1.2 Refrigerator Cleaning and Tuning

*SWS Detail: 7.8001.2 Cleaning and Tuning Existing Refrigerators and Freezers*

Cleaning and tuning an existing refrigerator can increase its efficiency. Follow these procedures.

- ✓ Clean dirt off clogged coils.

- ✓ Move objects that block airflow around the refrigerator, and ask the client to store the objects elsewhere.
- ✓ Measure refrigerator temperature and verify that it is between 35° and 40° F. Otherwise re-set the thermostat to this temperature range.
- ✓ Measure the freezer temperature, and verify that it is more than or equal to 0° F. If it is colder than 0°, re-set the freezer's thermostat to 0° F.
- ✓ Check the condensation-control switch. If the condensation control is on, the refrigerator door or door frame is being heated. Try turning the switch to “energy saver” which turns the heating elements off. If frost forms on the door, turn the control back on.
- ✓ Explain the function of the condensation control to clients. If the energy-saver setting isn't adequate for very humid weather, the occupants could toggle setting.

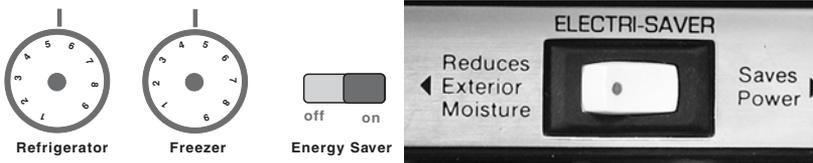

**Refrigerator energy controls:** Refrigerator and freezer temperatures aren't typically labeled in degrees, so there might be some trial and error in getting the setting within range. The condensation control is either on and heating the door perimeter or off and not heating the door perimeter.

### 10.1.3 Refrigerator Metering Protocol

Older refrigerators use from 1000 to 2000 kWh per year. Newer ENERGY STAR refrigerators use less than 400 kWh per year. You need a minimum of two hours to accurately measure refrigerator energy consumption using a recording watt-hour meter.


There are two common options for evaluating refrigerator energy consumption for replacement.

1. The first option is to use the resources included in the [WAPTAC Refrigerator Guide](#). These resources include a database of refrigerators by model with approximate electricity usage and a refrigerator analysis tool.
2. The second option is to follow the metering procedure presented here. The Kentucky WAP requires all refrigerators being considered for replacement to be metered a minimum of 120 minutes. Enter the results into the approved software.

A number of unusual circumstances could reduce the accuracy of the metering, including the following.

- A quantity of warm food recently placed in the refrigerator.
- Abnormally high or low ambient temperature. For example: refrigerators in garages during the summer or winter; or refrigerators in vacant homes where heating or cooling systems aren't operating.

**Recording watt-hour meter:**  
Measures energy consumption over time. The better units can also calculate monthly consumption, or record maximum current draw to help identify the defrost cycle.

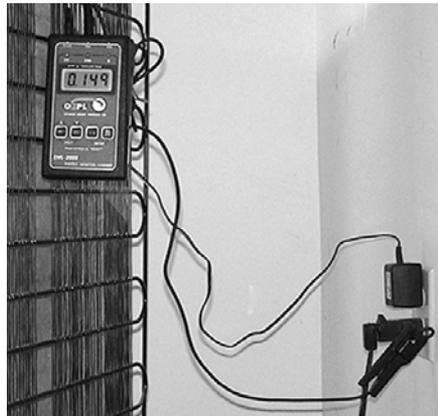

## Refrigerator Metering Procedure

If the refrigerator is an automatic-defrost model, you could measure an inaccurate reading if the unit goes into the electric defrost mode during the test period. The following test protocol includes provisions to prevent the defrost mode from activating.

1. Connect the refrigerator to a recording watt-hour meter. Run the test for at least two hours. You don't need to stop at exactly two hours, and a longer measurement is OK. During the test, avoid opening the refrigerator, or do so briefly.
2. At the end of the test, read the kilowatt/hours of consumption measured by the meter. Divide this number by the number of hours in the test. This gives you the number of kilowatt-hours consumed each hour. Multiply this number by the total number of hours in a year (8760 hours per year). The product of this calculation is the annual kilowatt-hours expected to be consumed by the unit.
3. Plug the refrigerator back into the outlet.

$$\begin{array}{c}
 \text{length of test} \\
 \text{in hours} \quad \searrow \\
 \mathbf{0.32 \div 2 = 0.16 \times 8760 = 1402} \\
 \nearrow \qquad \qquad \qquad \uparrow \qquad \qquad \qquad \nearrow \\
 \text{kilowatt-hours} \qquad \qquad \text{hourly} \qquad \qquad \text{predicted annual} \\
 \text{consumed} \qquad \qquad \qquad \text{consumption} \qquad \qquad \text{consumption in} \\
 \qquad \qquad \qquad \text{in kilowatt-hours} \qquad \qquad \text{kilowatt-hours}
 \end{array}$$

**Refrigerator consumption example:** In this example, a 2-hour measurement was performed. During this time, the appliance consumed 0.32 kilowatt-hours of electricity, or 0.16 kilowatt-hours per hour. The annual total of 1402 kilowatt-hours, calculated above, is well beyond the 450 kilowatt-hours per year consumed by today's most efficient refrigerators.

**Table 10-3: Kilowatt-Hours per Hour & Kilowatt-Hours per Year**

kWh/hour	kWh/year	kWh/hour	kWh/year
0.23	2000	0.16	1400
0.22	1900	0.15	1300
0.21	1800	0.14	1200
0.19	1700	0.13	1100
0.18	1600	0.11	1000
0.17	1500	0.10	900

## 10.2 ENTERTAINMENT AND COMPUTER SYSTEMS

*SWS Detail: 7.8002.1 Entertainment and Computer Systems and Components Replacement*



### **Computer power settings:**

Go to your computer's control panels and set the *power-saver control* to rest the display and sleep the computer after some chosen time of inactivity.

The purpose of this section is to help clients conserve electricity that they use for entertainment and computing. These measures are not to be paid for with DOE or LIHEAP funds.

- ✓ Advise clients to buy equipment labeled ENERGY STAR.
- ✓ Advise clients to buy electronic equipment that doesn't need to be left on when not being used.
- ✓ Standby losses for electronic equipment must be one watt or less.

- ✓ Patch all holes, made for installation of electronic equipment, in an airtight and weather-tight manner.
- ✓ Read the operating manual and enable all energy-saving features of an appliance. Explain the energy-saving features to the client.
- ✓ Verify that clients have operating instructions for their electronic equipment or that they know how to access instructions using the Internet.
- ✓ Recycle or dispose of equipment using principles of the Environmental Protection Agency (EPA) Responsible Recycling (R2) Initiative.



**Smart plug strips:** A variety of plug strips with built-in controls are now available. The plug strips interrupts power to appliances by remote control, on a time schedule, or by sensing occupancy.

## 10.3 LIGHTING-EFFICIENCY IMPROVEMENTS

Lighting-efficiency improvements include bulb (lamp) replacement, daylighting, fixture replacement, and energy-efficient lighting controls.

### 10.3.1 Daylighting

#### *SWS Detail: 7.8003.1 Lighting Upgrade*

Use daylighting as appropriate to save electricity. The Kentucky WAP does not pay for window coverings designed to maximize useful daylight. The client should be educated on using passive lighting when available.


## 10.3.2 Lighting Retrofit Equipment

### *SWS Detail: 7.8003.1 Lighting Upgrade*

Consider the following requirements when retrofitting lighting equipment. LED replacement lighting is not eligible for reimbursement with DOE or LIHEAP funding.

- ✓ Ask the customer about their lighting usage, and explain the electrical savings potential for switching to compact fluorescent lamps (CFLs) or light-emitting diodes (LEDs).
- ✓ Demonstrate a CFL or LED bulb to the customer if they're hesitant about replacing their incandescent light bulbs.
- ✓ Select the type of CFL or LED and its wattage, according to its use and the customer's accustomed light level.
- ✓ Turn on each CFL or LED after installation to ensure that it operates. Make sure that the customer is satisfied with the light level.
- ✓ Replace halogen torchieres with fluorescent torchieres.
- ✓ All bulbs, fixtures, and controls must be appropriate for the intended application (for example: enclosed, dimmable, indoor, outdoor).
- ✓ Select bulbs, fixtures, and controls to provide the brightness and light quality required in that application (for example: task lighting, walkway lighting, night lights).
- ✓ Selected equipment should have the highest level of efficiency within a technology, such as bulbs, fixtures, or controls.
- ✓ All bulbs, fixtures, and controls must be ENERGY STAR® rated where applicable.
- ✓ When possible, select bulbs, fixtures, and controls that employ the latest energy-efficient lighting technology.

- ✓ Bulb wattage must not exceed rated wattage of the light fixture.
- ✓ Select bulb replacements based on expected life span, light quality, and lifetime energy use.
- ✓ Install occupancy sensing controls where appropriate.
- ✓ All bulbs, fixtures, and controls will be UL-approved and installed according to local code(s) and *NFPA 70 National Electric Code*
- ✓ Inform customers about proper recycling of fluorescent bulbs by stores, municipal waste departments, or other recycling organizations.
- ✓ Replace fluorescent light ballasts containing polychlorinated biphenyls (PCBs) according to the EPA's *Healthy Indoor Environment Protocols for Home Energy Upgrades*.

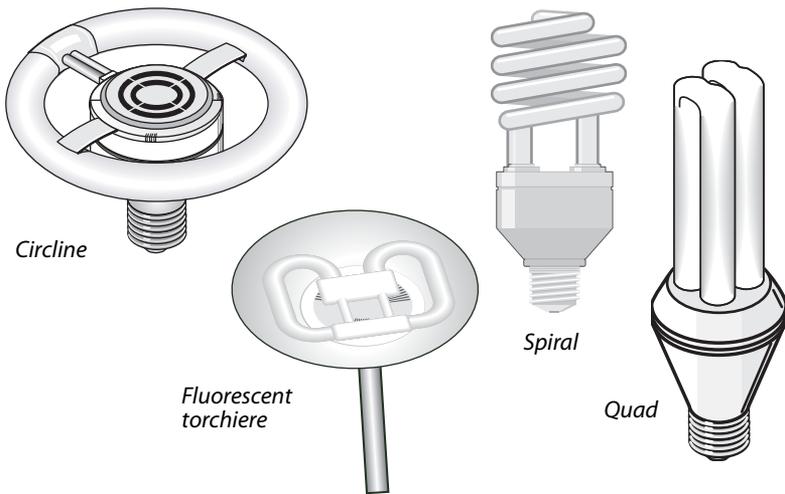

**Compact fluorescent lamps:** These advanced lamps use about one-third of the electricity of the incandescent lamps they usually replace, and they last about ten times as long.

## 10.4 CLOTHES WASHER SELECTION/REPLACEMENT

Observe the following standards to minimize the energy consumption of clothes washers.

### 10.4.1 Clothes Washer Selection

#### *SWS Detail: 7.8004.1 Washing Machine*

Comply with these requirements when selecting a new clothes washer. This measure is not to be paid for with DOE or LIHEAP funds.

- ✓ Select clothes washers that meet or exceed ENERGY STAR® and WaterSense® specifications.
- ✓ Maintain adequate clearance around appliance when fit into the available space, so access to cabinets and light switches aren't blocked.
- ✓ Appliance must be covered by a minimum one-year warranty.
- ✓ Standby losses for clothes washers must be one watt or less.

### 10.4.2 Clothes Washer Installation

#### *SWS Detail: 7.8004.1 Washing Machine*

Comply with these requirements when installing a new clothes washer. This measure is not to be paid for with DOE or LIHEAP funds.

- ✓ Install clothes washers in accordance with manufacturer specifications, (including leveling, plumbing connections, electrical connections) and meet all applicable codes.
- ✓ Install shut-off valves on hot and cold supply water if not already present.

- ✓ If located in conditioned or finished area, install an overflow pan and drain the pan to a safe location
- ✓ Air seal any penetrations to the exterior of the home created by the washer's installation.
- ✓ Demonstrate energy-related appliance controls to the occupant.
- ✓ Provide specific information about proper maintenance of the washer to the occupant.
- ✓ Provide warranty information, operation manuals, and installer to the owner.

## 10.5 CLOTHES DRYER SELECTION/REPLACEMENT

The following standards minimize the energy consumption of clothes dryers.

### 10.5.1 Clothes Dryer Selection

#### *SWS Detail: 7.8004.2 Clothes Dryer Replacement*

Comply with these requirements when selecting a new clothes dryer. This measure is not to be paid for with DOE or LIHEAP funds.

- ✓ Adequate clearance will be maintained around appliance when fit into available space so access to cabinets and light switches are not blocked
- ✓ Appliance will be covered by a minimum one-year warranty
- ✓ Equipment will be selected with features that reduce peak electric demand and absolute energy use.
- ✓ Standby losses for equipment will be one watt or less

## 10.5.2 Clothes Dryer Installation

### *SWS Detail: 7.8004.2 Clothes Dryer Replacement*

Install the appliance in accordance with manufacturer specifications and all applicable codes. If existing venting doesn't meet manufacturer specifications, code, or the following criteria, install new venting using the following specifications. This measure is not to be paid for with DOE or LIHEAP funds.

- ✓ Vent all dryers, other than condensing dryers to the outdoors.
- ✓ Vent appliance to the outdoors using metal-to-metal or UL listed foil-faced dryer vent.
- ✓ Use only metal clamps on semi-rigid metal and UL listed foil-type vent pipes.
- ✓ Install a pest screen at the termination.
- ✓ Insulate at least 3 feet of the vent closest to the home's exterior to a minimum of R-6.
- ✓ If a combustion appliance is used, perform combustion-safety testing as described in "[Combustion-Safety Evaluation](#)" on page 251.
- ✓ Seal penetrations to the outdoors created by the appliance installation to an airtight condition.
- ✓ Demonstrated energy-related dryer controls to the occupant.
- ✓ Provide specific information of the proper maintenance of the equipment to the occupant.
- ✓ Provide warranty information, operation manuals, and installer contact information to the occupant.
- ✓ Recycle or remove and dispose of replaced appliances in accordance with local regulations, including older equipment switches containing mercury

## 10.5.3 Clothes Dryers Service and Venting

### *SWS Detail: 6.6005.1 Clothes Dryer*

Clogged clothes-dryer vents are a leading cause of house fires. The drying time of a load of laundry is determined by the dryer installation and the amount of lint in the dryer, vent piping, and vent termination. Lint builds up over time and slows drying time, increasing energy use and cost. The original installation can also cause excessive drying time when flexible vents are excessively long, kinked, or restricted in some other way.

Vinyl flexible dryer vent isn't an approved dryer vent material and should be replaced with metal flexible dryer vent.

#### Service Procedures

Observe the following suggestions when servicing clothes dryers to prevent fires, reduce drying time, improve energy efficiency, and reduce lint build-up.


- ✓ Unplug the clothes dryer before making any improvements.
- ✓ Remove the vent pipe and vent termination and clean all lint out of them.
- ✓ Clean lint out of the electric heating elements and the air-way around them.
- ✓ Inspect the airway at the dryer's vent connection, and clean the lint out of it.

#### Dryer Exhaust Venting Requirements

Follow these venting requirements for clothes dryers when servicing dryers.

- ✓ Dryer vents should be piped in 4-inch-diameter rigid aluminum or galvanized pipe whenever and wherever possible.
- ✓ Don't use screws or rivets to join rigid pipe sections because they collect lint. Join and seal the sections with silicone caulking.

- ✓ Exhaust venting duct must be supported at maximum 4-foot intervals.
- ✓ Use short, stretched pieces of flexible metal dryer vent, labeled UL 2158A, to connect the dryer to the rigid vent through difficult framing or to allow dryer to be moved in and out. Make connections using rigid fittings installed male-to-female in the direction of exhaust flow to prevent lint build-up.
- ✓ Fasten UL listed foil-type vent or semi-rigid sheet metal to rigid metal with a clamp.
- ✓ Other specialized duct fittings will be fastened in accordance with manufacturer specifications.
- ✓ Seal duct connection with foil tape labeled UL 181B or 181B-M.
- ✓ Install a booster fan for dryer ducts exceeding 35 feet in duct equivalent length. When calculating duct length, add 5 feet for each 90° bend and 2.5 feet for each 45° bend.
- ✓ Provide make-up air if you measure excessive depressurization or if the dryer moves 200 CFM or more.

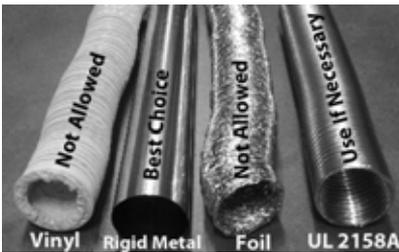

**Dryer vent types:** Clothes dryer energy-efficiency depends on the type of vent material and the equivalent length of the vent.

## 10.6 WATER-HEATING ENERGY SAVINGS

For safety information on combustion water heaters, see *“Spillage and CO Testing” on page 257.*

The most important tasks in evaluating hot water energy savings are determining the water heater’s insulation level, measuring the shower’s flow rate, and measuring the water temperature.

**Table 10-4: Water Heating Consumption According to Family Size**

<b>Number of Residents</b>	<b>Annual kWh</b>	<b>Annual Therms</b>	<b>Gallons Per Day</b>
<b>1</b>	2700	180	25
<b>2</b>	3500	230	40
<b>3</b>	4900	320	50
<b>4</b>	5400	350	65
<b>5</b>	6300	410	75
<b>6</b>	7000	750	85

Author's interpretation of data from single-family homes with existing water heaters from Energy Information Administration, Lawrence Berkeley Laboratory, *Home Energy Magazine*, and others.


## 10.6.1 Water-Saving Shower Heads and Faucet Aerators

### *SWS Detail: 7.8101.1 Shower Head and Faucet Aerator*

Most families use more hot water in the shower than for any other use. A low-flow shower head reduces this consumption.

- ✓ Water-saving shower heads must be rated for a flow of  $\geq 2.5$  gallons per minute.
- ✓ Water-saving aerators must be rated for a flow of  $\geq 2.2$  gallons per minute.
- ✓ Use caution in removing the existing shower head or aerator from old, fragile plumbing fixtures.
- ✓ The shower or faucet flow rate must be satisfactory to the occupants and be documented.
- ✓ Recycle replaced shower heads and aerators.

**Water-saving shower heads:** Two styles of water-saving shower heads give consumers a choice between steamy showers and less steamy ones.

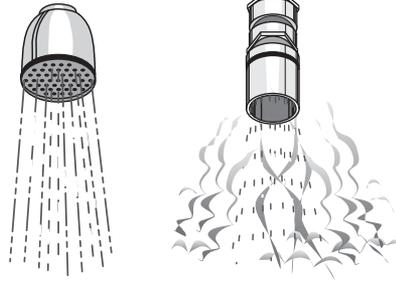

## Measuring Shower or Faucet Flow Rate

You can determine flow rate by measuring the time needed to fill a one-gallon plastic container. If the one-gallon container fills in less than 20 seconds, your flow rate is more than 3 gallons per minute.

1. Start the shower and set it to the maximum showering rate.
2. Start a stopwatch at the same time you move the container underneath the shower, capturing its entire flow.
3. Record the number of seconds and divide 60 by that number to find gallons per minute.

**Measuring shower flow rate:** If you divide 60 by the number of seconds needed to fill a gallon container, you will calculate flow in gallons per minute.

$$\frac{1 \text{ gal}}{15 \text{ sec}} \times \frac{60 \text{ sec}}{1 \text{ min}} = 4 \frac{\text{gal}}{\text{min}}$$



## 10.6.2 Water Heater Blankets

*SWS Detail: 7.8102.2 Storage-Type Appliance, 7.8103.1 Storage-Type Appliance*

Install an R-11 insulation blanket on all water heaters that are outside the heated space, **unless the manufacturer's label prohibits it**. Follow these guidelines to avoid fire hazards and to simplify future service.

### Gas Water Heaters


When you install insulation on gas water heaters, use these specifications.

- ✓ Keep insulation at least 2 inches away from the gas valve and the burner access panel. Don't install insulation below the burner access panel.
- ✓ Don't cover the pressure relief valve or discharge line with insulation.
- ✓ Don't insulate the tops of gas-fired water heaters because the insulation can obstruct the draft diverter.

### Electric Water Heaters

When you install insulation on electric water heaters, use these specifications.

- ✓ Mark the blanket to locate the thermostat and heating element access plates and cut the blanket at these locations. Remove the insulation from the access plate and discard it.
- ✓ Secure the perimeter of the opening with tape.
- ✓ Cover the top of the water heater with insulation.
- ✓ Don't cover the pressure relief valve and discharge line with insulation.
- ✓ If you specify insulation for an existing water heater which has a relief valve but no discharge line, install a discharge line outside the insulation to within 6 inches of the floor. Discharge to outdoors where a floor drain isn't present.

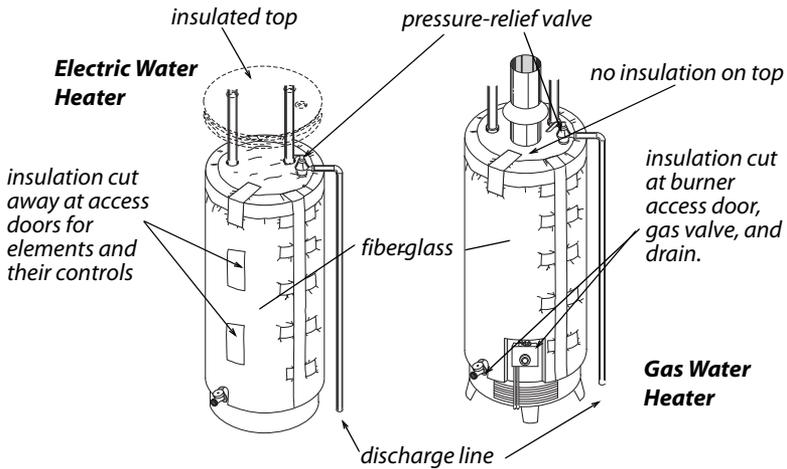

**Water heater insulation:** Insulation should be installed carefully so it doesn't interfere with the burner, elements, draft diverter, FVIR combustion intake, or pressure relief valve and discharge line.

## 10.6.3 Measuring and Adjusting Hot Water Temperature


*SWS Detail: 7.8103.1 Storage-Type Appliance, 7.8103.2 On-Demand Appliance*

Use the following instructions to adjust water temperature.

- ✓ Shut off power to an electric water heater before opening thermostat access panels.
- ✓ Measure the water temperature at the nearest faucet to the water heater. Reduce the temperature to 120° F with the customer's permission.
- ✓ On electric water heaters, set both upper and lower thermostats to the same temperature.



**Setting hot-water temperature:** Getting the temperature correct can take a few measurements and re-adjustments.



*Gas water heater control*



*Electric water heater control*

## 10.6.4 Heat Traps and Water-Heater Pipe Insulation


*SWS Detail: 7.8103.1 Storage-Type Appliance, 7.8103.2 On-Demand Appliance*

Install heat traps if the water heater has no built-in heat traps. Heat traps are piping loops or valves that prevent thermosiphoning of water in and out of the piping near the water heater.

Install pipe insulation to slow convection of hot water into the water lines near the tank.

- ✓ Interior diameter of pipe sleeve must match exterior diameter of pipe
- ✓ Insulate the first 6 feet of hot and cold water pipe from the water heater.
- ✓ Use pipe wrap with a minimum thickness of 1 inch and a minimum R-value of 2. Cover elbows, unions and other fittings with the same insulation thickness as the pipe.
- ✓ Corners must be mitered, tight fitting, sealed and secured with appropriate material to prevent failure.

- ✓ Keep pipe insulation 6 inches away from single-wall vent pipe and 1 inch away from Type B vent.
- ✓ Fasten pipe insulation with zip ties, tape, or other approved method.

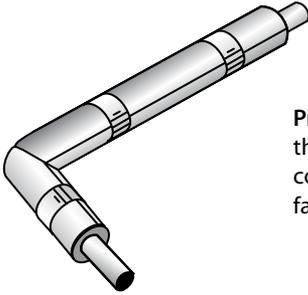

**Properly installed pipe insulation:** Will be the right size for the pipe, will completely cover the pipe, including bends, and will be fastened tightly to the pipe.

## 10.7 SELECTING STORAGE WATER HEATERS

Storage water heaters are the most common water heaters found in homes.

### 10.7.1 Determining a Storage Water Heater's Insulation Level

*SWS Detail: 7.8102.1 Water Heater Selection, 7.8102.2 Storage-Type Appliance*

Common storage water heaters consist of a tank, insulation surrounding the tank, and an outer shell. There is typically either 1 or 2 inches of insulation surrounding the tank. The insulation is either fiberglass or polyisocyanurate.

Follow this procedure to determine the water heater's insulation level.

- ✓ Look for a listing of R-value on a label on the water heater.

- ✓ Find a hole in the outer shell where the flue pipe emerges or where plumbing connects. Look around the hole for either fiberglass or polyisocyanurate insulation.
- ✓ If the hole isn't large enough to see the insulation level on an electric water heater, try removing the access panel for the heating element after disconnecting power from the unit.
- ✓ You may just be able to see the gap between the tank and outer shell. If you can't see this gap, use a ruler or probe to push through the insulation along side of a pipe connecting to the tank until the probe hits the steel tank to determine thickness. Make sure that the probe is against the tank and not against a nut welded to the tank.
- ✓ If additional tank insulation is installed, it must be at least R-11. **Don't install insulation if the manufacturer's label on the water heater prohibits it.**

### Identifying Tank Insulation

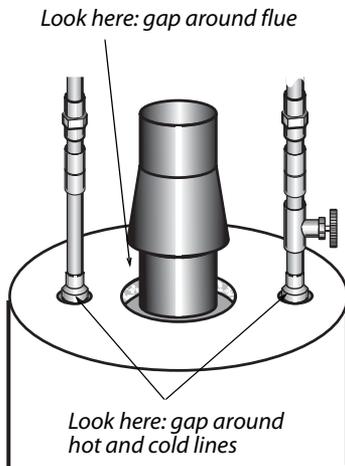


Table 10-5: Insulation R-Values

Insulation/thickness	R
Fiberglass 1 inch	3
Fiberglass 2 inches	6
PIC1 inch	6.5
PIC 2 inches	13
PIC 3 inches	19.5

## 10.7.2 Storage Water-Heater Selection

*SWS Detail: 7.8102.1 Water Heater Selection, 7.8102.2 Storage-Type Appliance*

Existing gas water heaters, including propane, typically use 200 to 400 therms per year. New gas water heaters use as little as 175 therms per year, resulting in a savings of between 25 and 225 therms per year. Similar savings are possible by replacing electric water heaters. Consider the following recommendations for specifying water heaters.

- A replacement gas or oil storage water heater should have an energy factor of at least 0.67 and be insulated with at least 2 inches of foam insulation.
- A replacement electric water heater should have an energy factor of at least 0.93 and be insulated with at least 2.5 inches of foam insulation.

## 10.8 ALTERNATIVE WATER-HEATERS

Weatherization programs sometimes choose alternative water-heating products to improve efficiency and safety.


### 10.8.1 Sidewall-Vented Gas Storage Water Heaters

*SWS Detail: 2.0201.2 Combustion Safety, 7.8102.1 Water Heater Selection, 7.8102.2 Storage-Type Appliance*


When gas storage water heaters cause persistent venting problems, specify a sidewall-venting water heater. Two common types of these water heaters are shown here.

- ✓ Choose a sealed-combustion sidewall-vented gas water heater, if possible. Next best is a fan-assisted unit.

- ✓ The replacement water heater must be installed in accordance with manufacturer specifications, 2012 IRC G2427.8, and additional applicable codes.

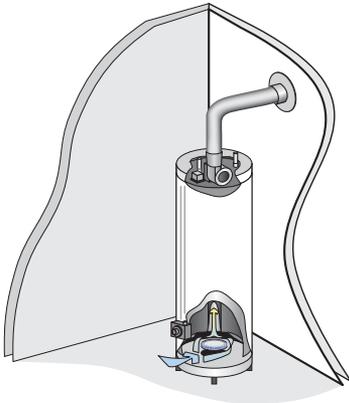

**Fan-assisted water heater:** The fan allows horizontal venting. The water heater may be open combustion or sealed combustion.

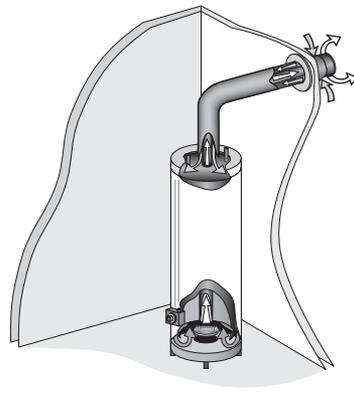

**Direct-vent water heater:** Moves combustion air and flue gases through a concentric pipe system without a draft fan.

## 10.8.2 On-Demand Gas Water Heaters

*SWS Detail: 7.8102.1 Water Heater Selection, 7.8102.3 On-Demand Appliance*

On-demand gas water heaters are more efficient and cost less to operate compared to conventional gas storage water heaters. However, on-demand gas water heaters are more expensive to install and may have shorter lifespans compared to storage water heaters.

- ✓ Choose a sealed-combustion on-demand gas water heater, if possible. Next best is a fan-assisted unit.


## 10.8.3 Heat Pump Water Heaters

Heat pump water heaters can heat water at up to 2.3 times more efficient than electric-resistance storage water heaters. Heat

pump water heaters use heat from surrounding air to heat water. They cost much more than conventional electric water heaters but are far less costly to operate.



**Heat pump water heater:** This heat pump water heater has the heating coil (condenser) surrounded by the domestic water.

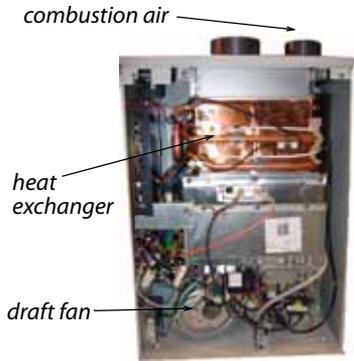

**Sealed-Combustion Tankless Water Heater:** These expensive water heaters have a tiny market share and save around one-third of energy used by the best storage water heaters.

**Table 10-6: Comparison of Advanced Water Heaters**

<b>Advanced Water Heater Type</b>	<b>\$ Savings*</b>	<b>Expected Lifespan</b>	<b>Major Advantages</b>
High-efficiency storage tank (Oil, gas, electric)	≤\$500	8–15 years	Lowest first cost
Instantaneous Tankless (direct fired)	≤\$1800	5-15 years	Unlimited hot water
Heat pump	≤\$3000	5-15 years	Most efficient electric option
From information supplied by ENERGYSTAR.gov by the Environmental Protection Agency. * Lifetime savings compared to conventional water-heater models and same fuel.			

## 10.9 WATER HEATER INSTALLATION

### *SWS Detail: 7.8102.3 On-Demand Appliance, 7.8102.2 Storage-Type Appliance*

Follow these procedures when installing a storage water heater or an alternative water heater.

- ✓ Replacement water heater must have a pressure-and-temperature relief valve with a discharge line that terminates less than 6 inches from the floor into a floor drain or drain pan.
- ✓ The discharge pipe should be made of rigid metal pipe or approved high-temperature plastic pipe.
- ✓ Install dielectric unions and a backflow preventer as part of a water heater replacement if any of these components are missing from the existing installation.
- ✓ Install an expansion tank for all storage water-heater replacements.

- ✓ Install an emergency drain pan under each replacement water heater that is installed in an area that would be damaged by a leak.
- ✓ Install a  $\frac{3}{4}$ -inch drain line to the tapping on drain pan. Terminate the drain line in a floor drain or outdoors, at least 6 inches above grade.
- ✓ Install heat traps on the water heater's inlet and outlet piping if the manufacturer hasn't provided traps.
- ✓ Adjust water temperature to 120° F or to the lowest setting acceptable to occupants.


For a complete list of DOE installation requirements for water heaters, see [SWS Detail 7.8102.2 Storage-Type Appliance](#).

## 10.10 COMPARING WATER HEATERS

The choice of fuel and model for a storage water heater isn't easy and it involves many factors including safety, reliability, efficiency, and installed cost.

### 10.10.1 Safety Comparison

Conventional direct-fired gas water heaters vent their combustion by-products to a gravity vented chimney. They can spill products of combustion into the living space, especially if the chimney isn't tall enough, warm enough, or sized properly. Sharing of a main chimney with another combustion appliance can cause venting problems. If the furnace or boiler is replaced with a sealed-combustion or horizontal-vented model, the chimney may then be too big for the remaining combustion water heater.

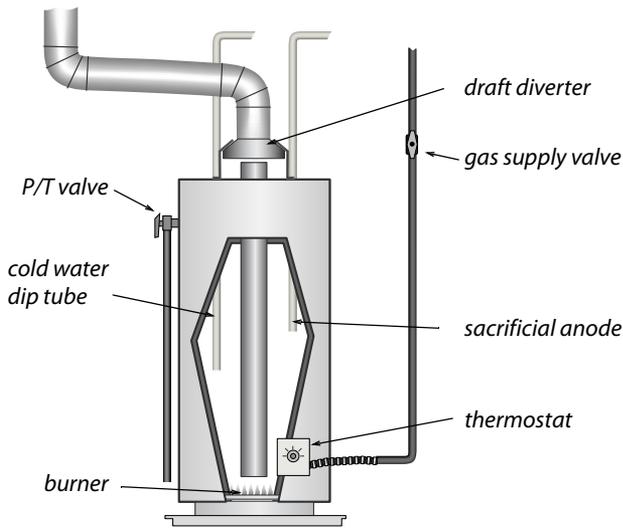

**Standard gas water heater:** These open combustion appliances are often troubled by spillage and backdrafting.

Electric water heaters have no chimney and need no combustion air, which makes them safer for buildings with low natural air leakage, compared to conventional gas storage water heaters.

Electric water heaters have no products of combustion to worry about. However, because their recovery capacity is generally much less than gas water heaters of the same size, there is a greater chance of someone trying to compensate for a cold shower by setting the electric water heater to an unsafe temperature where occupants could get scalded.

### 10.10.2 Reliability Comparison

Storage water heaters are popular because they are inexpensive and reliable. Both gas and electric storage water heaters are simpler and more reliable than more expensive and complex water heaters. The lifespan of storage water heaters depends on local water quality and the quality of the water heater's tank.


Most heaters have glass-lined steel tanks which are typically warranted for five years. All types of heaters are available with

larger or additional sacrificial anodes, which are pieces of metal that corrode before the tank does, thereby extending the tank life and maybe the warranty. If you buy a ten-year guarantee heater instead of a five-year guarantee heater, this choice might reduce the future cost of replacement and possible water damage from tank leaks.

### 10.10.3 Efficiency and Energy Cost Comparison

Conventional gas storage water heaters are rated at about 80% steady-state efficiency. However, whenever a storage water heater isn't firing, it's losing heat up the chimney. This happens when cold air, flowing through the heater, is warmed by the heater and escapes up the flue. This off-cycle heat loss reduces annual efficiency drastically and may result in the water heater's energy factor (EF) being less than 0.60.

The exact EF for a particular storage water heater is difficult to estimate because of many factors including: chimney height, chimney diameter, wind, the home's air-tightness, outdoor temperature, and water heater temperature setpoint. With these variables the actual EF can vary from 0.60 to 0.40 or even lower. Nevertheless, gas storage water heaters cost less to operate than electric water heaters with the same insulation level.

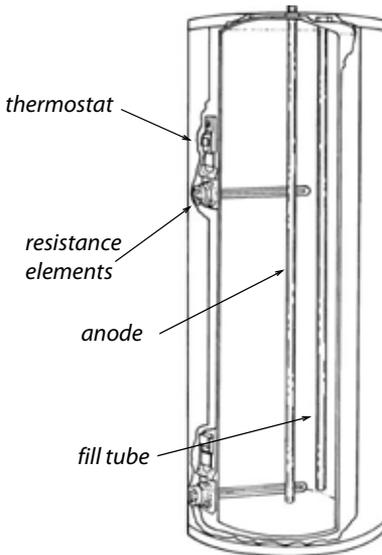

**Standard electric storage water heater:** Electric water heating is more expensive than gas or oil but safer. Electric water heaters should have at least 2 inches of foam insulation.

Electricity is approximately 2.5 times as expensive as natural gas. However, electric water heaters have no chimney and therefore no chimney losses. They do lose heat through the insulation jacket, which brings their EF down to around 0.90. Heat-pump water heaters have an operating efficiency of 200% because they heat water with heat from the surrounding air. But because the electricity production and transmission system in the U.S. is about 31% efficient, the overall energy use and cost for heating water with electricity is still higher than with gas.

## 10.11 SWS ALIGNMENT

Field Guide Topic	SWS Detail
Refrigerator Replacement and Maintenance Pg. 410	
Refrigerator Replacement Pg. 410	7.8001.1 Refrigerator and Freezer Replacement

<b>Field Guide Topic</b>	<b>SWS Detail</b>
Refrigerator Cleaning and Tuning Pg. 411	7.8001.2 Cleaning and Tuning Existing Refrigerators and Freezers
Refrigerator Metering Protocol Pg. 412	
Entertainment and Computer Systems Pg. 415	7.8002.1 Entertainment and Computer Systems and Components Replacement
Lighting-Efficiency Improvements Pg. 416	
Daylighting Pg. 416	7.8003.1 Lighting Upgrade
Lighting Retrofit Equipment Pg. 417	7.8003.1 Lighting Upgrade
Clothes Washer Selection/ Replacement Pg. 419	
Clothes Washer Selection Pg. 419	7.8004.1 Washing Machine
Clothes Washer Installation Pg. 419	7.8004.1 Washing Machine
Clothes Dryer Selection Pg. 420	
Clothes Dryer Selection Pg. 420	7.8004.2 Clothes Dryer Replacement
Clothes Dryer Installation Pg. 421	7.8004.2 Clothes Dryer Replacement
Clothes Dryers Service and Venting Pg. 422	6.6005.1 Clothes Dryer
Water-Heating Energy Savings Pg. 423	
Water-Saving Shower Heads and Faucet Aerators Pg. 424	7.8101.1 Shower Head and Faucet Aerator


<b>Field Guide Topic</b>	<b>SWS Detail</b>
Water Heater Blankets Pg. 425	7.8103.1 Storage-Type Appliance, 7.8102.2 Storage-Type Appliance
Measuring and Adjusting Hot Water Temperature Pg. 427	7.8103.1 Storage-Type Appliance, 7.8103.2 On-Demand Appliance
Heat Traps and Water-Heater Pipe Insulation Pg. 428	7.8103.1 Storage-Type Appliance, 7.8103.2 On-Demand Appliance
Selecting Storage Water Heaters Pg. 429	
Determining a Storage Water Heater's Insulation Level Pg. 429	7.8102.1 Water Heater Selection, 7.8102.2 Storage-Type Appliance
Storage Water-Heater Selection Pg. 431	7.8102.1 Water Heater Selection, 7.8102.2 Storage-Type Appliance
Alternative Water-Heaters Pg. 431	
Sidewall-Vented Gas Storage Water Heaters Pg. 431	2.0201.2 Combustion Safety, 7.8102.1 Water Heater Selection, 7.8102.2 Storage-Type Appliance
On-Demand Gas Water Heaters Pg. 432	7.8102.1 Water Heater Selection, 7.8102.3 On-Demand Appliance
Heat Pump Water Heaters Pg. 432	
Water Heater Installation Pg. 434	7.8102.3 On-Demand Appliance, 7.8102.2 Storage-Type Appliance
Comparing Water Heaters Pg. 435	

<b>Field Guide Topic</b>	<b>SWS Detail</b>
Safety Comparison Pg. 435	
Reliability Comparison Pg. 436	
Efficiency and Energy Cost Comparison Pg. 437	



# CHAPTER 11: MOBILE HOMES

Mobile homes are covered by their own details and outcomes in the SWS, which refers to mobile homes as manufactured homes. These two names refer to the same type of housing. We prefer the term “mobile home.” In this chapter, we cover mobile-home air sealing, insulation, windows, doors, and heating systems.

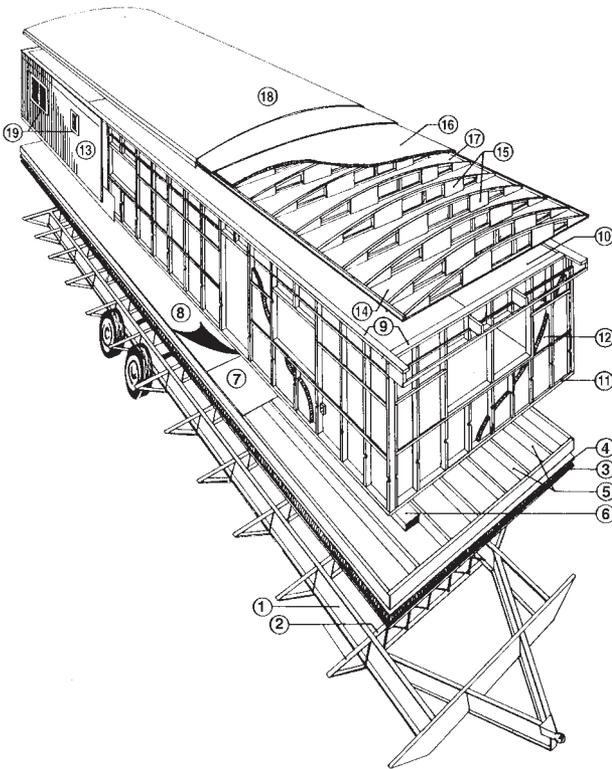

**Typical components of a mobile home:** 1–Steel chassis. 2–Steel outriggers and cross members. 3–Underbelly. 4–Fiberglass insulation. 5–Floor joists. 6–Heating/air conditioning duct. 7–Decking. 8–Floor covering. 9–Top plate. 10–Interior paneling. 11–Bottom plate. 12–Fiberglass insulation. 13–Metal siding. 14–Ceiling board. 15–BOWSTRING trusses. 16–Fiberglass insulation. 17–Vapor barrier. 18–Galvanized steel one-piece roof. 19–Metal windows.

## 11.1 MOBILE HOME AIR SEALING

### SWS Detail: 3.1101 Manufactured Housing Walls

The location and relative importance of mobile home air leaks was a mystery before blower doors. Some mobile homes are fairly airtight, and others are very leaky. Air leakage serves as ventilation in most mobile homes. Observe the Minimum Ventilation Guidelines outlined in *“Whole-Building Ventilation” on page 374*.

A duct airtightness tester, which pressurizes the ducts and measures their air leakage, is the best way to measure and evaluate duct air sealing. *See “Evaluating Duct Air Leakage” on page 327*. For simply locating duct leaks, the blower door used in conjunction with a pressure pan does a good job. *See “Pressure Pan Testing” on page 328*.

Most mobile home duct sealing is performed through the belly. This work is more difficult once the belly has been re-insulated. Inspect the ductwork and seal any major leaks, such as disconnected trunk lines, before insulating the belly.

**Table 11-1: Air Leakage Locations & Typical CFM<sub>50</sub> Reduction**

<b>Air Sealing Procedure</b>	<b>Typical CFM<sub>50</sub> Reduction</b>
Patching large air leaks in the floor, walls and ceiling	200–900
Sealing floor cavity used as return-air plenum ( <i>See “Floor return air” on page 448.</i> )	300–900
Sealing leaky water-heater closet	200–600
Sealing leaky supply ducts	100–500
Installing tight interior storm windows	100–250
Caulking and weatherstripping	50–150

Mobile home shell air leakage is often substantially reduced when insulation is installed in roofs, walls, and belly cavities. Prioritize your efforts by performing these tasks in this order.

1. Evaluate the insulation levels. If adding insulation is cost-effective, perform the usual pre-insulation air sealing measures that also prevent spillage of insulation out of the cavity.
2. Install cavity insulation. Perform duct sealing first if the belly is to be insulated.
3. Re-check the air leakage rate.
4. Perform additional air sealing as needed.

### 11.1.1 Shell Air Leakage Locations

*SWS Detail: 3.1001.4 General Penetrations (Electrical, HVAC, Plumbing, Vent Termination, Recessed Lighting)*

Blower doors have pointed out the following shell locations as the most serious air leakage sites.

- ✓ Plumbing penetrations in floors, walls, and ceilings. Water-heater closets with exterior doors are particularly serious Air Leakage problems, having large openings into the bathroom and other areas
- ✓ Torn or missing underbelly, exposing flaws in the floor to the ventilated crawl space
- ✓ Large gaps around furnace and water heater chimneys
- ✓ Severely deteriorated floors in water heater compartments
- ✓ Gaps around the electrical service panel box, light fixtures, and fans
- ✓ Joints between the halves of double-wide mobile homes and between the main dwelling and additions

Note: Window and door air leakage is more of a comfort problem than a serious energy problem.

## 11.1.2 Duct Leak Locations

### *SWS Detail: 3.1602.11 Air Sealing System*

Blower doors and duct testers have pointed out the following duct locations as the most serious energy problems.

- ✓ Floor and ceiling cavities used as return-air plenums — These floor return systems should be eliminated and replaced with return-air through the hall or a large grille in the furnace-closet door.
- ✓ Joints between the furnace and the main duct — The main duct may need to be cut open from underneath to access and seal these leaks between the furnace, duct connector, and main duct. With electric furnaces you can access the duct connector by removing the resistance elements. For furnaces with empty A-coil compartments, you can simply remove the access panel to seal the duct connector.
- ✓ Joints between the main duct and the short duct sections joining the main duct to a floor register
- ✓ Joints between register boots and floor
- ✓ The poorly sealed ends of the duct trunk, which often extend beyond the last supply register
- ✓ Disconnected, damaged or poorly joined crossover ducts
- ✓ Supply and return ducts for outdoor air conditioner units
- ✓ Holes cut in floors by tradesmen.
- ✓ New ductwork added to supply heat to room additions

Be sure to seal floor penetrations and ductwork before performing any belly repair. Pollutants in the crawl space such as mold and dust will be disturbed by repair work and can be drawn into the home by duct depressurization.


*See “Pressure Pan Testing” on page 328. See “Sealing Supply Ducts” on page 337.*

### 11.1.3 Belly Pressure Test


#### *SWS Detail: 5.3001.3 Replace Return Air Systems that Incorporate Floor Cavity (Belly) and/or Attic as the Return Air Pathway*

Mobile home supply duct leaks pressurize the belly cavity. Follow these steps to perform this rough test to determine if duct leaks are present and their general location.


- ✓ Repair the rodent barrier.
- ✓ Turn on the air handler.
- ✓ Insert a manometer hose into the belly through the rodent barrier and test the pressure with-reference-to the outdoors.
- ✓ Start near the furnace, and work your way toward the ends alongside the trunk line. A pressure rise gives you a rough idea of the location of leaks, size of leaks, and tightness of the nearby rodent barrier.
- ✓ Repair the ducts and re-test.

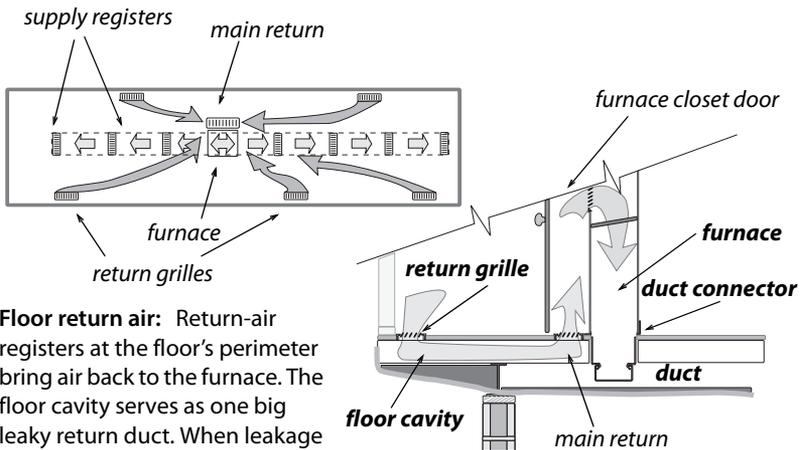

**Floor return air:** Return-air registers at the floor's perimeter bring air back to the furnace. The floor cavity serves as one big leaky return duct. When leakage is serious, the floor return system should be eliminated.

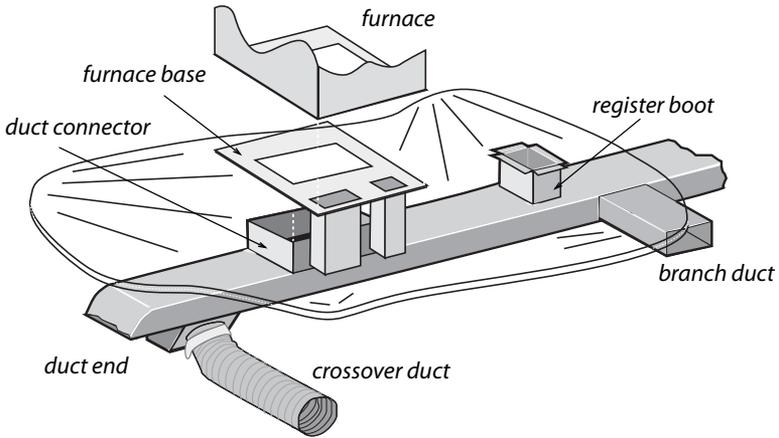

**Mobile home ducts:** Mobile home ducts leak at their ends and joints — especially at the joints beneath the furnace. The furnace base attaches the furnace to the duct connector. Leaks occur where the duct connector meets the main duct and where it meets the furnace. Branch ducts are rare, but easy to find, because their supply register isn't in line with the others. Crossover ducts are found only in double-wide and triple-wide homes.

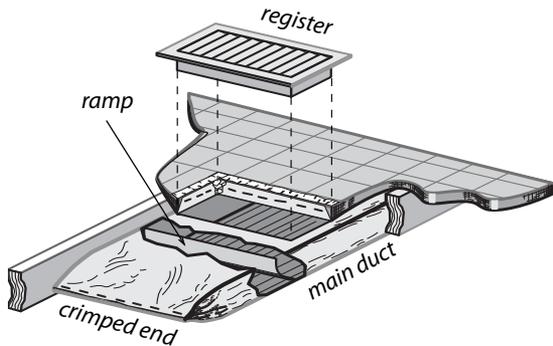

**Sealing the end of the main duct:** The main duct is usually capped or crimped loosely at each end, creating a major air leakage point. Seal this area and improve airflow by installing a sheet metal ramp, accessed through the last register, inside the duct. Seal the ramp to the ductwork with metal tape and silicone or mastic.

## 11.2 MOBILE HOME INSULATION


### SWS Detail: 2.0104.1 Insulation Worker Safety

Address all significant moisture problems before insulating. The most important single moisture-control measure is installing a ground-moisture barrier. *See also "Preparing for Foundation or Floor Insulation" on page 208.*

### 11.2.1 Insulating Mobile Home Roof Cavities

SWS Details: 4.1003.10 Installing Fiberglass Blown Insulation for Flat, Bowed, or Vaulted Ceilings (via Interior Access Through the Ceiling), 4.1003.8 Installing Fiberglass Blown Insulation for Flat, Bowed, or Vaulted Ceilings (via Roof Side Lift), 4.1003.9 Installing Fiberglass Blown Insulation for Flat, Bowed, or Vaulted Ceilings (via Exterior Access from Top of Roof), 4.1003.11 Installing Fiberglass Blown Insulation in Roof-Over Constructions

Blowing a closed mobile home roof cavity is similar to blowing a closed wall cavity, only the insulation doesn't have to be as dense. Use fiberglass blowing wool because cellulose is too heavy and absorbs water too readily for use around a mobile home's lightweight sheeting materials.

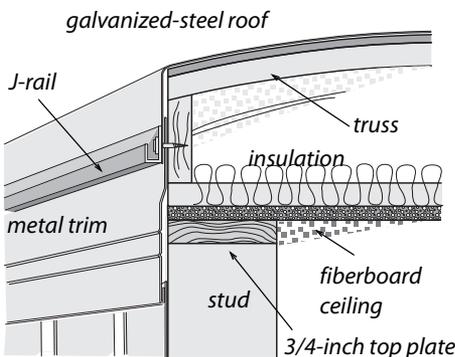

#### **Bowstring roof details:**

Hundreds of thousands of older mobile homes were constructed with these general construction details.

There are three common and effective methods for blowing mobile home roof cavities.

1. Cutting a square hole in the metal roof and blowing fiberglass through a flexible fill-tube.
2. Disconnecting the metal roof at its edge and blowing fiberglass through a rigid fill-tube.
3. Blowing fiberglass through holes drilled in the ceiling.


## Preparing to Blow a Mobile Home Roof

Perform these steps before insulating mobile home roofs.

- ✓ Reinforce weak areas in the ceiling.
- ✓ Inspect the ceiling and seal all penetrations.
- ✓ Take steps to maintain safe clearances between insulation and recessed light fixtures and ceiling fans.

## Blowing Through the Top


Blowing through the roof top does a good job of filling the critical edge area with insulation, and the patches are easy to install if you have the right materials. It is important to complete the work during good weather, however, since the roof will be vulnerable to rain or snow during the job.

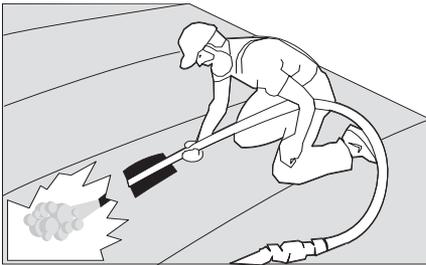

**Roof-top insulation:** Blowing fiberglass insulation through the roof top is effective at achieving good coverage and density on almost any metal roof.


If the roof contains a strongback running the length of the roof, the holes should be centered over the strongback, which is usually near the center of the roof's width. A strongback is a 1-by-4 or a 1-by-6, installed at a right angle to the trusses near their center point, that adds strength to the roof structure.

1. Cut 10-inch square holes at the roof's apex on top of every second truss. Each square hole permits access to two truss cavities.
2. Use a 2-inch or 2- $\frac{1}{2}$ -inch diameter fill-tube. Insert the fill-tube and push it forcefully out toward the edge of the cavity.
3. Blow fiberglass insulation into each cavity.
4. Stuff the area under each square hole with a piece of unfaced fiberglass batt so that the finished roof patch will stand a little higher than the surrounding roof.
5. Patch the hole with a 14-inch-square piece of stiff galvanized steel, sealed with roof cement and screwed into the existing metal roof.
6. Cover the first patch with a second patch, consisting of an 18-inch-square piece of foil-faced butyl rubber.

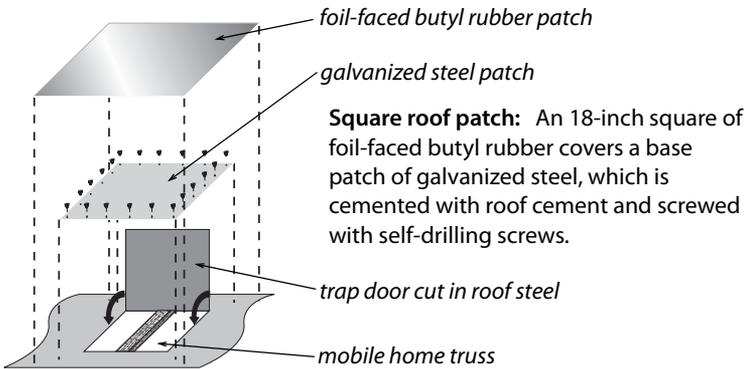

## Blowing a Mobile Home Roof from the Edge

Erect scaffold to do this procedure safely and efficiently. Mobile home metal roofs are usually fastened only at the edge, where the roof joins the wall.

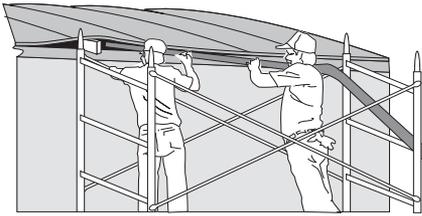

**Roof-edge blowing:** Use a rigid fill tube to blow insulation through the roof edge. This avoids making holes in the roof itself, though this process requires much care in refastening the roof edge.

1. Remove the screws from the metal j-rail at the roof edge. Also remove staples or other fasteners, and scrape off putty tape.
2. Pry the metal roof up far enough to insert a 2-inch-diameter, 10- to 14-foot-long rigid fill-tube. Two common choices are steel muffler pipe and aluminum irrigation pipe. Inspect the cavity with a bright light to identify any wires or piping that could be damaged by the fill tube.
3. Blow insulation through the fill-tube into the cavity. Turn off the insulation-material feed and blower on the blowing machine when the tube is a couple feet from the roof edge, in order to avoid blowing insulation out through the opening in the roof edge. Stuff the last foot or two with unfaced fiberglass batts.
4. Fasten the roof edge back to the wall using galvanized roofing nails, a new metal j-rail, new putty tape, and larger screws. The ideal way to re-fasten the metal roof edge is with air-driven galvanized staples, which is the way most roof edges were attached originally.

The re-installation of the roof edge is the most important part of this procedure. Putty tape must be replaced and installed as it was originally. This usually involves installing a layer of putty tape or a bead of high quality caulk under the metal roof and another between the metal roof edge and the j-rail.

The advantages of blowing through the edge is that if you have the right tools, including a powered stapler, this method can be

very fast and doesn't require cutting into the roof. The disadvantages of this procedure are that you need scaffolding to work at the edges, and it won't work on roof systems with a central strongback that stops the fill tube from reaching all the way across the roof.


### Blowing a Mobile Home Roof from Indoors

The advantage to this method is that you are indoors, out of the weather. The disadvantages include being indoors where you can make a mess — or worse, damage something.

Blowing the roof cavity from indoors requires the drilling of straight rows of 3-inch or 4-inch holes and blowing insulation into the roof cavity through a fill tube.

Follow this procedure.

1. Drill a 3-inch or 4-inch hole in an unseen location to discover whether the roof structure contains a strongback that would prevent blowing the roof cavity from a single row of holes.
2. Devise a way to drill a straight row of holes down the center of the ceiling. If a strongback exists, drill two rows of holes at the quarter points of the width of the ceiling.
3. Insert a flexible plastic fill tube into the cavity, and push it as far as possible toward the edge of the roof.
4. Fill the cavity with tightly packed fiberglass insulation.
5. Cap the holes with manufactured plastic caps. Care must be taken not to damage the holes so that the plastic hole covers fit properly. You can also install a piece of painted wood trim over the line of holes.

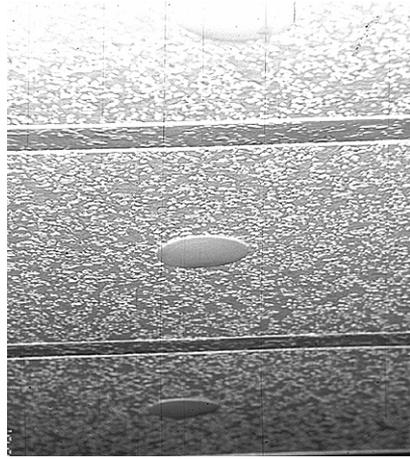

**Blowing through the ceiling:** The contractor pushes the fill-tube into the cavity and out near the edge of the roof. The holes are drilled in a straight line for appearance sake.

## 11.2.2 Mobile Home Sidewall Insulation

*SWS Details: 4.1101.5 Exterior Wall Dense Packing, 4.1104.2 Fiberglass Blown Insulation Installation (Lifting Siding), 4.1104.3 Fiberglass Blown Insulation Installation (via Penetrations Through or Behind the Siding)*


The sidewalls of many mobile homes are not completely filled with insulation. This reduces the nominal R-value of the existing wall insulation because of convection currents and air leakage. Consider the following steps for adding insulation to partially filled mobile home walls.

1. Check the interior paneling and trim to make sure they are securely fastened to the wall. Repair holes in interior paneling and caulk cracks at seams to prevent indoor air from entering the wall. Note the location of electrical boxes and wire to avoid hitting them when you push the fill tube up the wall.
2. Remove the bottom horizontal row of screws from the exterior siding. If the vertical joints in the siding inter-

lock, fasten the bottom of the joints together with  $\frac{1}{2}$ -inch sheet metal screws to prevent the joints from coming apart. Pull the siding and existing insulation away from the studs, and insert the fill tube into the cavity with the point of its tip against the interior paneling.


3. Push the fill tube up into the wall cavity until it hits the top plate of the wall. The tube should go in to the wall cavity 7-to-8 feet. It is important to insert the tube so that its natural curvature presses its tip against the interior paneling. When the tip of the fill tube, cut at an angle, is pressed against the smooth paneling, it is least likely to snag the existing insulation on its way up the wall. If the fill tube hits a belt rail or other obstruction, twisting the tube will help its tip get past the obstruction.
4. Stuff a piece of fiberglass batt into the bottom of the wall cavity around the tube to prevent insulation from blowing out of the wall cavity. Leave the batt in-place at the bottom of the wall, when you pull the fill tube out of the cavity. This piece of batt acts as temporary gasket for the hose and insulates the very bottom of the cavity after the hose is removed. This batt also eliminates the need to blow fiberglass insulation all the way to the bottom, preventing possible spillage and overfilling. If you happen to overfill the bottom of the cavity, reach up inside the wall to pack or remove some fiberglass insulation, particularly any that lies between the loose siding and studs.
5. Draw the tube down and out of the cavity about 6 inches at a time. Listen for the blower fan to indicate strain from back-pressure in the wall. Watch for the fiberglass insulation to slow its flow rate through the blower hose at the same time. Also watch for slight bulging of the exterior siding. These signs tell the installer when to pull the tube down.

- Carefully refasten the siding using the same holes. Use screws that are slightly longer and thicker than the original screws.

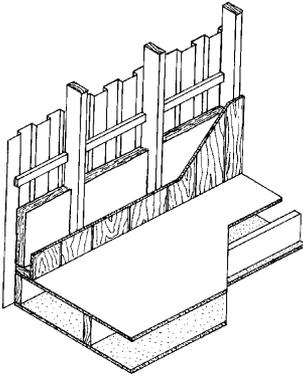

**Adding insulation to mobile home walls:** A contractor uses a fill tube to install more insulation in a partially filled mobile home wall.


**Standard mobile home construction:** 2-by-4 walls and 2-by-6 floor joists are the most common construction details.

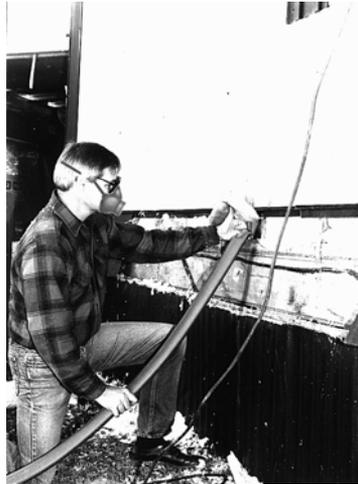

### 11.2.3 Mobile Home Floor Insulation

*SWS Details: 4.1302.1 Prepare Belly Floor Cavity for Insulation, 4.1303.1 Insulation of Floor Cavity with Blown Material*

Mobile home floor insulation is a good energy-saving measure in cool climates. The original insulation is usually fastened to the bottom of the floor joists, leaving much of the cavity uninsulated and subject to convection currents. This greatly reduces the insulation's R-value. Blown-in belly insulation also tends to control duct leakage.

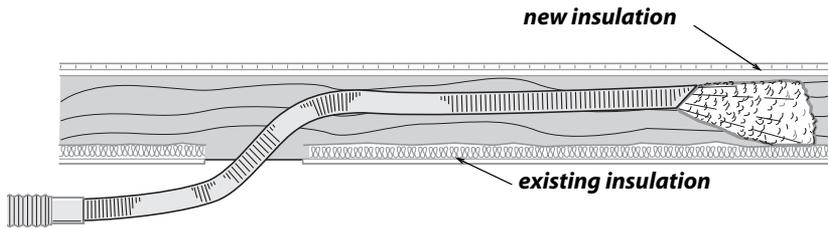

**Blowing bellies:** A flexible fill-tube, which is significantly stiffer than the blower hose, blows fiberglass insulation through a hole in the belly from underneath the home.

## Preparing for Mobile Home Floor Insulation

Prior to installing floor insulation, always perform these repairs.

- ✓ Repair plumbing leaks.
- ✓ Tightly seal all holes in the floor.
- ✓ Inspect and seal ducts.
- ✓ Repair the rodent barrier.
- ✓ Install a ground-moisture barrier in the crawl space if the site is wet.

## Patching the Belly

Mobile homes have two common types of belly covering: rigid fiber board and flexible paper or fabric. The fiberboard is normally stapled to the bottom of the floor joists. To patch a rigid belly, simply screw or staple plywood or another rigid material over the hole.

Flexible belly material may have no solid backing behind the hole or tear because the material forms a bag around the main duct, which is installed below the floor joists. In this case, use both adhesive and stitch staples to bind the flexible patch to the flexible belly material.

## Insulating the Floor



**Patching a flexible belly:** The technician uses both adhesive and stitch staples to fasten a patch.



**Blowing a floor through the belly:**

The contractor inserts a rigid fill tube through the belly to blow insulation into the floor cavity and underbelly.

Two methods of insulating mobile home floors are common. Blown fiberglass is recommended over cellulose for either method.


1. Drilling through the 2-by-6 rim joist and blowing fiberglass through a rigid fill tube into the belly.
2. Blowing fiberglass insulation through a flexible fill tube or a rigid fill tube into the underbelly.

First repair all holes in the belly. Use mobile home belly-paper, silicone sealant, and stitch staples. Use these same patches over the holes cut for fill-tubes. Screw wood lath over weak areas if needed.


When blowing through holes from underneath the home, consider blowing through damaged areas before patching them.

Identify any plumbing lines, and avoid installing insulation between them and the living space if freezing could be an issue. This may require running a piece of belly-paper under the pipes, and insulating the resulting cavity, to include the pipes in the heated envelope of the home.

Unfaced fiberglass batts may also be used to insulate floor sections where the insulation and belly are missing. The insulation should be supported by lath, twine, or insulation supports. This is a good approach when it isn't cost-effective to insulate the entire belly.

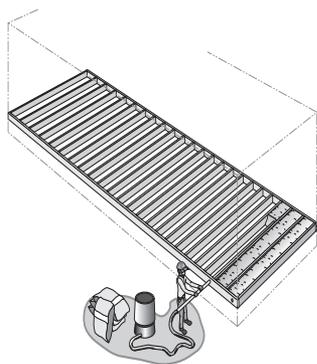

**Blowing crosswise cavities:**  
Blowing insulation into belly is easy if the floor joists run crosswise. However, the dropped belly requires more insulation than a home with lengthwise joists.

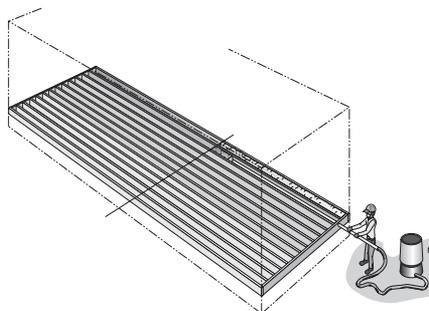

**Blowing lengthwise cavities:**  
Floors with lengthwise joists can rarely be filled completely from the ends because of the long tubing needed. The middle can be filled from underneath.


## 11.3 MOBILE HOME WINDOWS AND DOORS

### *SWS Detail: 3.1201.5 Manufactured Housing Windows and Doors*

Repairing or replacing mobile home windows and doors is often part of a mobile home weatherization job. Installing storm windows or replacing existing windows is expensive per square foot and isn't as cost-effective as insulation. However, storm windows and replacement windows are all energy conservation measures for mobile homes that are worth considering.

## 11.3.1 Mobile Home Storm Windows

### SWS Detail: 3.1201.6 Interior Storm Windows

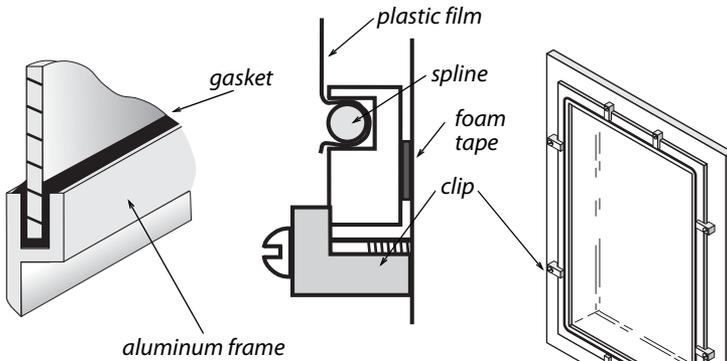


**Glass interior storms:**  
Traditional mobile home storm windows have aluminum frames glazed with glass.

**Plastic storms:** Some newer Storm window designs use a lightweight aluminum frame and flexible or rigid plastic glazing.

Interior storm windows are common in mobile homes. These stationary interior storms serve awning and jalousie windows. Sliding interior storm windows pair with exterior sliding prime windows.

- ✓ Interior storm windows double the R-value of a single-pane window. They also reduce infiltration, especially in the case of leaky jalousie prime windows.
- ✓ Consider repairing existing storm windows rather than replacing them unless the existing storm windows can't be re-glazed or repaired.
- ✓ When sliding primary windows are installed, use a sliding storm window that slides from the same side as the primary window. Sliding storm windows stay in place and aren't removed seasonally, and are therefore less likely to be lost or broken.

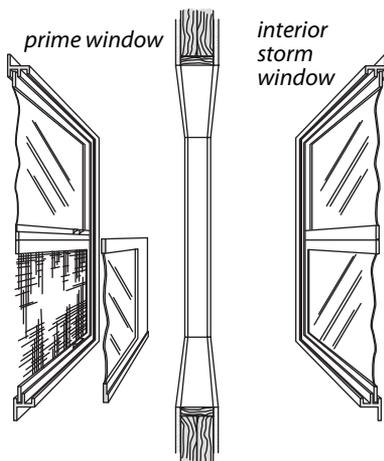

**Mobile home double window:** In mobile homes, the prime window is installed over the siding outdoors, and the storm window is installed indoors.

### 11.3.2 Replacing Mobile Home Windows

*SWS Details: 3.1202.3 Replacing Damaged Window Glass in Manufactured Housing, 3.1203.3 Replacement of Manufactured Housing Windows and Doors*

Replacement windows should have lower U-factors than the windows they are replacing. Inspect condition of rough opening members before replacing windows. Replace deteriorated, weak, or waterlogged framing members.

Prepare the replacement window by lining the perimeter of the inner lip with  $\frac{1}{8}$ -inch thick putty tape. Caulk exterior window frame perimeter to wall after installing the window.


### 11.3.3 Mobile Home Doors

*SWS Detail: 3.1201.5 Manufactured Housing Windows and Doors*

Mobile home doors come in two basic types: the mobile home door and the house-type door. Mobile home doors swing out-

wardly, and house-type doors swing inwardly. House-type doors are available with pre-hung storm doors included.

Existing or replacement mobile home doors should be air-tight, water-tight, and operable. Replace missing or damaged weatherstripping, drip cap, or flashing to ensure that water or air can't penetrate the opening. Properly adjust the door so that it closes securely, but does not crush or deform the weatherstripping.

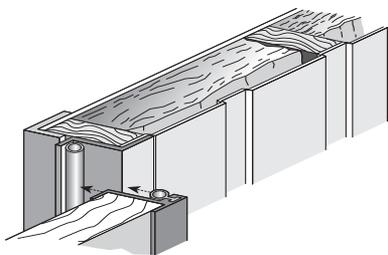

**Mobile home door:** Mobile home doors swing outwardly and have integral weatherstrip.

## 11.4 COOL ROOFS FOR MOBILE HOMES

### 5.3202.1 *Reflective Coatings on Metal Roofs*

Cool roof coatings reduce summer cooling costs and improve comfort by reflecting solar energy away from the home's roof and slowing the flow of heat into the home. They are shown to reduce overall cooling costs by 10-20%, and are a good choice for mobile homes or site-built homes with low slope or flat roofs. Cool roof coatings are usually bright white, and must have a reflectivity of at least 60% to meet the ENERGY STAR or equivalent requirement for cool roof coatings.

Cool roof coatings are usually water-based acrylic elastomers, and are applied with a roller. They can be applied over most low-sloped roofing such as metal, built-up asphalt, bitumen, or single ply membranes. Some underlying materials require a primer to get proper adhesion-check the manufacturer's recommendations for asphalt-shingle roofs.

Surface preparation is critical when applying any coating. The underlying roofing materials must be clean so the coating will stick. Repairs should be performed if the existing roofing is cracked or blistered. Roof coating Won't stick to dirty or greasy surfaces, and they can't be used to repair roofs in poor conditions. Observe the following specifications when installing cool roof coatings.

- ✓ Install the coating when dry weather is predicted. Rain heavy dew, or freezing weather, if it happens within 24 hours of installation, will weaken the coating's bond to the underlying roofing.
- ✓ Protect any nearby windows, siding, or automobiles from splatters. For roller application, use a large brush for the edges, and a shaggy 1 to 1 1/2-inch roller on a 5- or 6- foot pole for the field. Run the coating up the roof jacks and other penetrations to help seal these areas. Install at least two coats, with second coat applied in the opposite direction to the first to get more complete coverage. Allow a day for drying between coats.
- ✓ Clean the roof of loose roofing material and other debris.
- ✓ Wash the roof with a water/tri-sodium phosphate (tsp) solution, or comparable mildew-cide, and scrub brush. Better yet, use a pressure washer.
- ✓ Buy the highest quality coatings, and look for those that are specifically formulated as mobile home roof coatings.
- ✓ Reinforce any open joints around skylights, pipe flashing, roof drains, wall transitions, or HVAC equipment. For build-up asphalt or bitumen roofs, repair any cracks, blisters, or de-laminations. Use polyester fabric and roof coating for these reinforcements and repairs by dipping fabric patches in the roof coating and spreading them over the existing roofing, or by laying dry fabric into a layer of wet coating. Smooth the patches down with a broad-knife

or squeegee to remove bubbles or wrinkles. Allow any repairs to cure for 1 to 2 days before applying the topcoat.

- ✓ For metal roofs, sand any rusted areas down to sound metal. Install metal patches over any areas that are rusted through, followed by polyester patches as described above.

## 11.5 MOBILE HOME SKIRTING

### *SWS Detail: 3.1488.2 Skirting Manufactured Homes*

The primary purpose of skirting is to keep animals out of the crawl space. Skirting must be vented to reduce moisture accumulation in many climates, so there isn't much value in insulating it.

Installation and repair of mobile home skirting is seldom cost-effective and is not allowed in weatherization work. Locate the thermal boundary at the floor of mobile homes.

## 11.6 SWS ALIGNMENT

<b>Field Guide Topic</b>	<b>SWS Detail</b>
Mobile Home Air Sealing Pg. 444	3.1101 Manufactured Housing Walls
Shell Air Leakage Locations Pg. 445	
Duct Leak Locations Pg. 447	3.1602.11 Air Sealing System
Belly Pressure Test Pg. 448	5.3001.3 Replace Return Air Systems that Incorporate Floor Cavity (Belly) and/or Attic as the Return Air Pathway
Mobile Home Insulation Pg. 450	2.0104.1 Insulation Worker Safety

Field Guide Topic	SWS Detail
Insulating Mobile Home Roof Cavities Pg. 450	4.1003.10 Installing Fiberglass Blown Insulation for Flat, Bowed, or Vaulted Ceilings (via Interior Access Through the Ceiling), 4.1003.8 Installing Fiberglass Blown Insulation for Flat, Bowed, or Vaulted Ceilings (via Roof Side Lift), 4.1003.9 Installing Fiberglass Blown Insulation for Flat, Bowed, or Vaulted Ceilings (via Exterior Access from Top of Roof), 4.1003.11 Installing Fiberglass Blown Insulation in Roof-Over Constructions
Mobile Home Sidewall Insulation Pg. 455	4.1101.5 Exterior Wall Dense Packing, 4.1104.2 Fiberglass Blown Insulation Installation (Lifting Siding), 4.1104.3 Fiberglass Blown Insulation Installation (via Penetrations Through or Behind the Siding)
Mobile Home Floor Insulation Pg. 457	4.1302.1 Prepare Belly Floor Cavity for Insulation, 4.1303.1 Insulation of Floor Cavity with Blown Material
Mobile Home Windows and Doors Pg. 460	3.1201.5 Manufactured Housing Windows and Doors
Mobile Home Storm Windows Pg. 461	3.1201.6 Interior Storm Windows
Replacing Mobile Home Windows Pg. 462	3.1202.3 Replacing Damaged Window Glass in Manufactured Housing, 3.1203.3 Replacement of Manufactured Housing Windows and Doors

<b>Field Guide Topic</b>	<b>SWS Detail</b>
Mobile Home Doors Pg. 462	3.1201.5 Manufactured Housing Windows and Doors
Cool Roofs for Mobile Homes Pg. 463	5.3202.1 Reflective Coatings on Metal Roofs
Mobile Home Skirting Pg. 465	3.1488.2 Skirting Manufactured Homes



## CHAPTER 12: AIR LEAKAGE DIAGNOSTICS

This chapter focuses on pressure-testing homes, to determine their airtightness and to guide air-sealing during weatherization. Ideally the air barrier and insulation are installed together at the building's thermal boundary. The airtightness of the air barrier has a substantial effect on the performance of the insulation. The testing described here helps to analyze the existing air barriers and decide whether and where air-sealing is needed.

### 12.1 SHELL AIR-LEAKAGE FUNDAMENTALS

Controlling shell air leakage is a key concern for successful weatherization. The decisions you make about sealing air leaks affect a building throughout its lifespan. Air leakage has these impacts.

- Air leakage accounts for a significant percentage of a building's heat loss.
- Air leakage through insulated assemblies reduces the R-value of insulation.
- Air leakage moves moisture in and out of the house, wetting and/or drying the building.
- Air leakage causes house pressures that can interfere with the venting of combustion appliances.

#### Air Leakage and Ventilation

Most homes depend on air leakage to provide outdoor air for diluting pollutants and admitting fresh air. However, air leaks can also bring pollutants into the home. Mechanical ventilation is a more reliable and efficient way to provide fresh air. See [\*“Whole-Building Ventilation” on page 374.\*](#)

## 12.1.1 Goals of Air-Leakage Testing

Air-leakage testing accomplishes a variety of purposes.


- Air-leakage and pressure testing measures the home's air-tightness level.
- It evaluates the home's ventilation requirements.
- It helps you to decide how much time and effort is required to achieve cost-effective air-leakage and duct-leakage reductions.
- It helps to compare the air-tightness of the air barriers on either side of an intermediate zone, such as an attic or crawl space. For example, comparing the airtightness of the plaster ceiling with that of the ventilated sloped roof gives the auditor an idea of how leaky the ceiling is.
- It helps decide the best place to establish the air barrier in an area that has no obvious thermal boundary such as an uninsulated crawl space.

The reason for the complexity of air-leakage testing is that there is so much uncertainty about air leakage. Testing is needed because there simply is no accurate prescriptive method for determining the severity and location of leaks, especially in complex homes. Depending on the complexity of a home, you may need to perform varying levels of testing to evaluate shell air leakage. In particular, the number of major components like stories, additions, corners, and gables indicates a home's potential for large air-leakage reductions.

*Where is the primary air barrier:  
at the rafter or ceiling joist?*

*Are the intermediate  
zones connected?*

*Are the floor cavities  
connected to  
outdoors?*

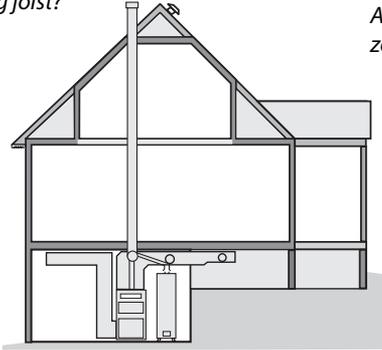

*Do ducts supply  
heated air to the  
addition?*

*Is the half-basement inside or outside the air  
barrier? Is this space heated?*

*Are the crawl space ducts inside or  
outside the air barrier?*

**Questions to ask during an air-leakage evaluation:** Your answers help determine the most efficient and cost-effective location for the air barrier.

## Air-Sealing with Air-Leakage Testing

Dedicate most of your effort to seal the large air leaks that pass directly through the thermal boundary first. Chasing small leaks or leaks that connect to the outdoors through interior walls or floors isn't worth as much effort if the budget is limited.


- ✓ Perform blower door testing.
- ✓ Analyze the test results to determine if air sealing is cost-effective.
- ✓ Locate and seal the air leaks.
- ✓ During air-sealing, monitor your progress with blower door testing.
- ✓ Stop air sealing when air-sealing goals have been achieved or the budget limit has been reached.

## 12.2 HOUSE AIRTIGHTNESS TESTING

House airtightness testing was made possible by the development of the blower door. The blower door measures a home's leakage rate at a standard pressure of 50 pascals. This leakage measurement can be used to compare homes with one another and to established air-leakage standards.

The blower door also allows the auditor to test parts of the home's air barrier to locate air leaks. Sometimes air leaks are obvious. More often, the leaks are hidden, and you need to find their location. This section outlines the basics of blower door measurement along with some techniques for gathering clues about the location of air leaks.

### Blower Door Components

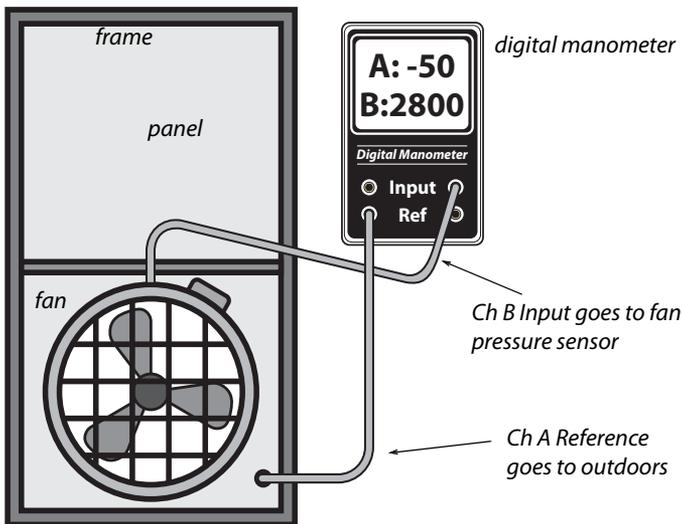


### 12.2.1 Blower-Door Principles

The blower door creates a 50-pascal pressure difference across the building shell and measures airflow in cubic feet per minute ( $\text{CFM}_{50}$ ), in order to measure the leakiness of homes. The blower door also creates pressure differences between rooms in

the house and intermediate zones like attics and crawl spaces. These pressure differences can give clues about the location and combined size of a home's hidden air leaks.

**Blower door test:** Air barriers are tested during a blower-door test, with the house at a pressure of 50 pascals negative with reference to outdoors. This house has 2800 CFM<sub>50</sub> of air leakage. Further diagnostic tests can help determine where that leakage is coming from.

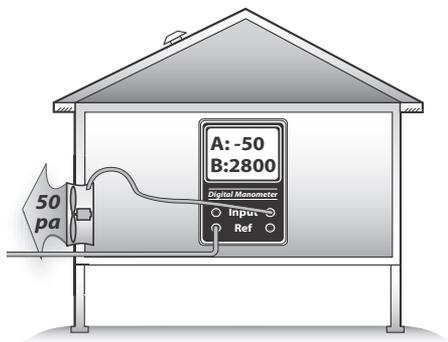


## Blower-Door Terminology


Connecting the digital manometer's hoses correctly is essential for accurate testing.

This method uses the phrase *with-reference-to (WRT)*, to distinguish between the input zone and reference zone for a particular measurement. The outdoors is the most commonly used reference zone for blower door testing. The reference zone is considered to be the zero point on the pressure scale.

For example, *house WRT outdoors* = -50 pascals means that the house (input) is 50 pascals negative compared to the outdoors (reference or zero-point). This pressure reading is called the house pressure.

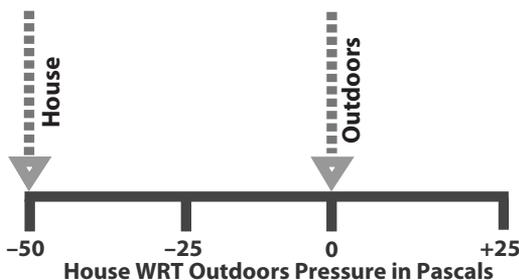

**Digital manometers:** Used to diagnose house and duct pressures quickly and accurately.

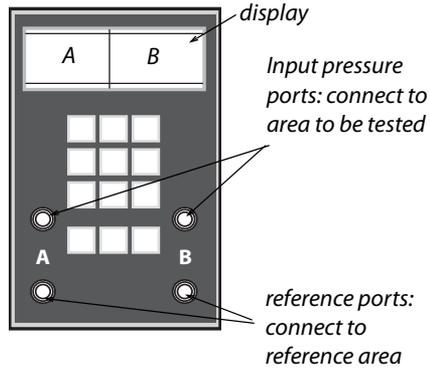

## Low-Flow Rings

During the blower door test, the manometer measures airflow through the fan. This airflow ( $CFM_{50}$ ) is the primary measurement of a home's airtightness and is directly proportional to the surface area of the home's air leaks. For the blower door to measure airflow accurately, the air must be flowing at an adequate speed. Tighter buildings and smaller buildings don't have enough air leakage to create an adequate airspeed to create the minimum fan pressure. This low-flow condition requires using one or two low-flow rings, to reduce the blower-door fan's opening and to increase air speed, fan pressure, and measurement accuracy.

When the air speed is too low, the DG-700 displays "LO" in the Channel B display. After installing one of the low-flow rings, follow the manufacturer's instructions for selecting the proper range or configuration on the digital manometer.

### 12.2.2 Preparing for a Blower Door Test

Preparing the house for a blower door test involves putting the house in its normal heating-season operation with all conditioned zones open to the blower door. Try to anticipate safety problems that the blower door test could cause, particularly with combustion appliances.

- Identify the location of the thermal boundary and determine which house zones are conditioned.
- Identify large air leaks that could prevent the blower door from achieving adequate pressure, such as a pet-door.
- Put the house into its heating-season operation with windows, doors, and vents closed and air registers open.
- Turn off combustion appliances temporarily.
- Open interior doors so that all indoor areas inside the thermal boundary are connected to the blower door. This could include the basement, conditioned kneewall areas, and closets.

### Avoiding Risky Situations

Don't perform a blower door test in risky situations like the following until you remove the risk or perform an acceptable building repair.


- A wood stove is burning.
- Holes in the ceiling that could lead to dust pollution during a blower door test.
- Extremely weak building components, like a poorly installed suspended ceiling or loose wood wall paneling.
- Lead or asbestos dust is present.

### 12.2.3 Blower-Door Test Procedures

Follow this general procedure when performing a blower-door test.

- ✓ Set up the house for winter conditions with exterior doors, primary windows and storm windows closed. The door to the basement should be either open or closed, according to whether or not the basement is considered to be within the thermal boundary.

- ✓ Install blower door frame, panel, and fan in an exterior doorway with a clear path to outdoors. On windy days, install the blower door on the home's leeward side if possible. Pay attention to the blower door's location and any other conditions that may affect test results.
- ✓ Follow manufacturer's instructions for fan orientation and digital-manometer setup for either pressurization or depressurization. Depressurization is the most common orientation.
- ✓ Connect Channel A of the digital manometer to measure *house WRT outdoors*. Place the outside hose at least 5 feet away from the fan.
- ✓ Connect Channel B to measure *fan WRT zone near fan inlet*. Do not place the hose directly in front of the fan intake.
- ✓ Ensure that children, pets, and other potential interferences are at a safe distance from the fan.

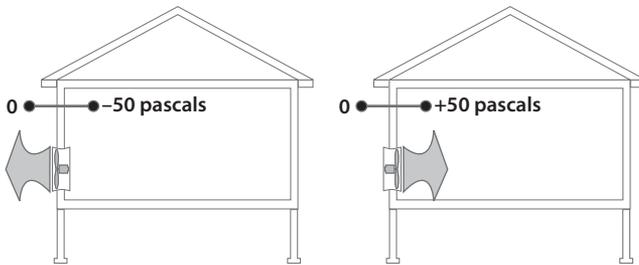

## Conducting the Blower Door Test

Follow these instructions for performing a blower door test, when using a DG700 digital manometer.

1. Turn on the manometer by pushing the ON/OFF button
2. Select the MODE: PR/FL@50.
3. Select the correct DEVICE that matches the blower door you're using.

4. With the fan covered, conduct the BASELINE procedure to cancel out the background wind and stack pressures. Let the manometer average the baseline pressure for at least 30 seconds.
5. Remove the cover from the blower door fan. Complete the next two steps for tighter buildings.
6. Install the flow ring in the blower door fan which matches the expected flow rate. The fan pressure should be at least 25 Pa while measuring CFM@50.
7. Push CONFIG or Range button until you match the flow ring being used.
8. Turn on the blower door fan slowly with the controller. Increase fan speed until the building depressurization on the Channel A screen is between  $-45$  and  $-55$  pascals. It doesn't need to be exactly  $-50$  pascals
9. The Channel B screen will display the single-point CFM<sub>50</sub> air leakage of the building. If this number is fluctuating a lot, push the TIME AVG button to increase the averaging time period.
10. You can also use the cruise-control function to automatically control the fan speed to create and hold  $-50$  pascals of pressure.

### Blower-Door Test Follow-Up

Be sure to return the house to its original condition.

- ✓ Inspect combustion appliance pilot lights to ensure that blower door testing didn't extinguish them.
- ✓ Reset thermostats of heaters and water heaters that were turned down for testing.
- ✓ Remove any temporary plugs that were installed to increase house pressure.

- ✓ Document the location where the blower door was installed.
- ✓ Document any unusual conditions affecting the blower door test


## 12.2.4 Approximate Leakage Area

There are several ways to convert blower-door CFM<sub>50</sub> measurements into square inches of total leakage area. A simple and rough way to convert CFM<sub>50</sub> into an approximate leakage area (ALA) is to divide CFM<sub>50</sub> by 10. The ALA can help you visualize the size of openings you're looking for in a home or section of a home.

$$\text{ALA (SQ INCHES)} = \text{CFM}_{50} \div 10$$

## 12.3 TESTING AIR BARRIERS


Leaks in air barriers cause energy and moisture problems in many homes. Air-barrier leak-testing avoids unnecessary visual inspection and unnecessary air sealing in hard-to-reach areas.

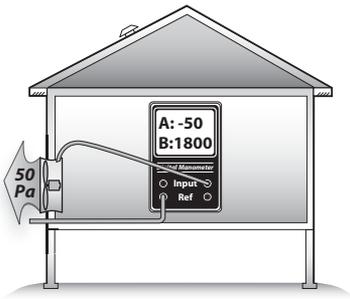

**Blower door test:** Air barriers are tested during a blower-door test, with the house at a pressure of 50 pascals negative with reference to outdoors. This house has 1800 CFM<sub>50</sub> of air leakage. Further diagnostic tests can help determine where that leakage is coming from.

Advanced pressure tests measure pressure differences between zones in order to estimate air leakage between zones. Use these tests to make decisions about where to direct your air-sealing efforts, for example.

- Evaluate the airtightness of portions of a building's air barrier, especially floors and ceilings.
- Decide which of two possible air barriers to air seal — for example, the floor versus foundation walls.
- Determine whether building cavities like porch roofs, floor cavities, and overhangs are conduits for air leakage.
- Determine whether building cavities, intermediate zones, and ducts are connected together through air leaks.
- Estimate the air leakage in CFM<sub>50</sub> through a particular air barrier, for the purpose of estimating the effort and cost necessary to seal the leaks.

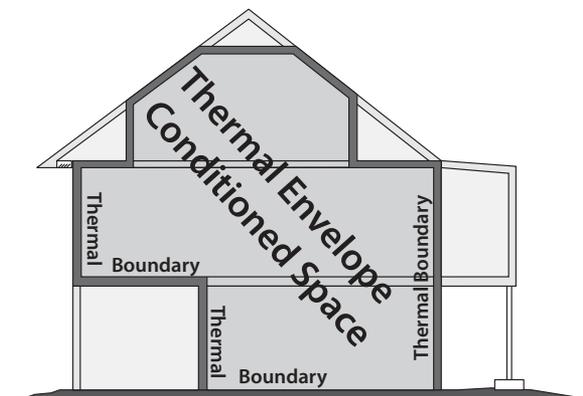

## Air-Barrier Test Results

Air-barrier tests provide a range of information from simple clues about which parts of a building leak the most, to specific estimates of the airflow and hole size through a particular air barrier.

The next table shows examples of how common building materials perform as air barriers. This information is helpful in interpreting blower door tests and selecting air-sealing materials.

**Table 12-1: Building Components and Their Air Permeance**

<b>Good air barriers: &lt;2 CFM<sub>50</sub> per 100 sq. ft.</b>	<b>Poor air barriers: 10–1000 CFM<sub>50</sub> per 100 sq. ft.</b>
5/8" oriented strand board	5/8" tongue-and-groove wood sheathing
1/2" drywall	6" fiberglass batt
4-mil air barrier paper	1.5" wet-spray cellulose
Asphalt shingles and perforated felt over 1/2" plywood	wood siding over plank sheathing
1/8" tempered hardboard	wood shingles over plank sheathing
painted un-cracked lath and plaster	blown fibrous insulation
Measurements taken at 50 pascals pressure. Based on information from: "Air Permeance of Building Materials" by Canada Mortgage Housing Corporation, and estimates of comparable assemblies by the author. Although cellulose reduces air leakage when blown into walls, it isn't considered an air-barrier material.	

### 12.3.1 Primary Versus Secondary Air Barriers

A home's air barrier should be a material that is continuous, sealed at the seams, and impermeable to airflow. Where there are two possible air barriers, in an attic for example, the most airtight barrier is the primary air barrier and the least airtight is the secondary air barrier.

The primary air barrier should be adjacent to the insulation to ensure the insulation's effectiveness. We use pressure-diagnostic testing to verify that the insulation and the primary air barrier are together. Sometimes we're surprised during testing to find that our assumed primary air barrier is actually secondary, and the secondary air barrier is primary.

Intermediate zones are unconditioned spaces that are sheltered within the exterior shell of the house. Intermediate zones can be located inside or outside the home's primary air barrier. Intermediate zones include: unheated basements, crawl spaces, attics, enclosed porches, and attached garages.

Intermediate zones have two potential air barriers: one between the zone and house and one between the zone and outdoors. For example, an attic or roof space has two air barriers: the ceiling and roof. You should know which air barrier is the tightest.


### 12.3.2 Simple Pressure Tests

Blower door tests give us valuable information about the relative leakiness of rooms or sections of the home. Listed below are five simple methods

1. *Feeling zone air leakage:* Close an interior door partially so that there is a one-inch gap between the door and door jamb. Feel the airflow along the length of that crack, and compare that airflow intensity with airflow from other rooms, using this same technique.
2. *Observing the ceiling/attic floor:* Pressurize the home and observe the top-floor ceiling from the attic with a good flashlight. Air leaks will show in movement of loose-fill insulation, blowing dust, moving cobwebs, etc. You can also use a small piece of tissue paper to disclose air movement.
3. *Observing smoke movement:* Pressurize the home and observe the movement of smoke through the house and out of its air leaks.
4. *Room pressure difference:* Check the pressure difference between a closed room or zone and the main body of a home. Larger pressure differences indicate larger potential air leakage within the closed room or else a tight air barrier between the room and main body. A small pressure difference means little leakage to the

outdoors through the room or a leaky air barrier between the house and room.


5. *Room airflow difference*: Measure the house  $CFM_{50}$  with all interior doors open. Close the door to a single room, and note the difference in the  $CFM_{50}$  reading. The difference is the approximate leakage through that room's air barrier.

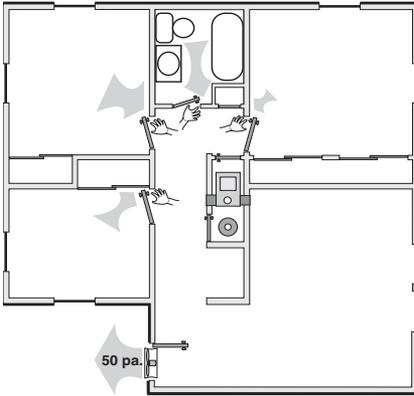

**Interior door test:** Feeling airflow with your hand at the crack of an interior door gives a rough indication of the air leakage coming from the outdoors through that room.

Tests 1, 2, and 3 present good customer education opportunities. Feeling airflow or observing smoke are simple observations, but have helped identify many air leaks that could otherwise have remained hidden.

When airflow within the home is restricted by closing a door, as in tests 4 and 5, it may take alternative indoor paths that render these tests somewhat misleading. Only practice and experience can guide your decisions about the applicability and usefulness of these general indicators.

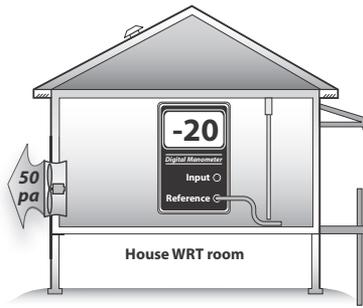


**Bedroom test:** This bedroom pressure difference may be caused by its leaky exterior walls or tight interior walls, separating it from the main body of the home. This test can determine whether or not a confined combustion zone is connected to other rooms.

### 12.3.3 Simple Zone Pressure Testing

Manometers aren't limited to finding indoor WRT outdoor differences. They can also measure pressure differences between the house and its intermediate zones during blower-door tests. The purpose of these tests is to evaluate the air-tightness of the home's interior air barriers.

The blower door, when used to create a house-to-outdoors pressure of  $-50$  pascals, also creates house-to-zone pressures of between  $0$  and  $-50$  pascals in the home's intermediate zones. The amount of depressurization depends on the relative leakiness of the zone's two air barriers.

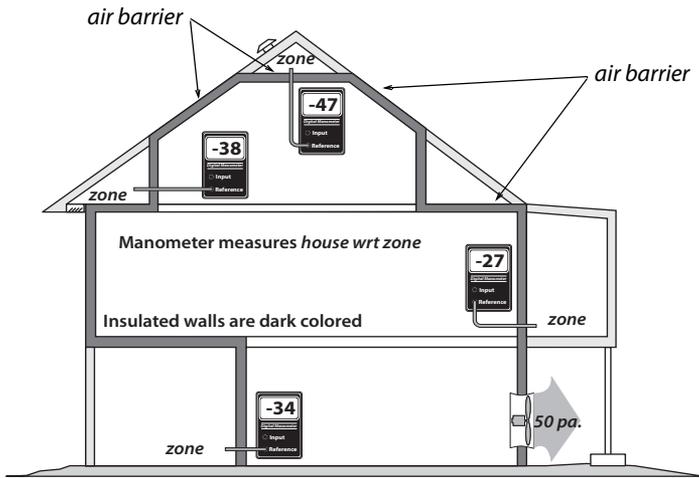

**Pressure-testing building zones:** Measuring the pressure difference across the assumed thermal boundary (*house wrt zone*) tells you whether the air barrier and insulation are aligned. If the manometer reads close to  $-50$  pascals, the air barrier and insulation are aligned and the tested zones are well-connected to outdoors.

For example, in an attic with a fairly airtight ceiling and a well-ventilated roof, the attic will indicate that it is mostly outdoors by having a house-to-zone pressure of  $-45$  to  $-50$  pascals. The leakier the ceiling and the tighter the roof, the smaller that the negative house-to-zone pressure will be. This holds true for other intermediate zones like crawl spaces, attached garages, and unheated basements.



### Zone Leak-Testing Methodology

Depressurize house to  $-50$  pascals with a blower door.


1. Find an existing hole, or drill a hole through the floor, wall, or ceiling between the conditioned space and the intermediate zone.
2. Connect the reference port of a digital manometer to a hose reaching into the zone.
3. Leave the input port of the digital manometer open to the indoors.

4. Read the negative pressure given by the manometer. This is the house-to-zone pressure, which will be  $-50$  pascals if the air barrier between house and zone is airtight and the zone itself is well-connected to outdoors.
5. If the reading is significantly less negative than  $-45$  pascals, find the air barrier's largest leaks and seal them.
6. Repeat steps 1 through 5, performing more air-sealing as necessary, until the pressure is as close to  $-50$  pascals as possible.

**Interpreting house-to-zone pressure:** The greater the negative number the better the air barrier is performing.

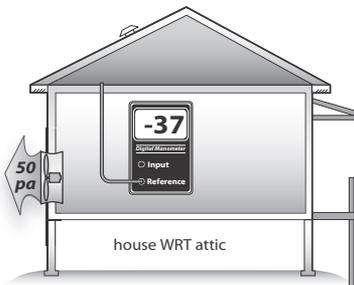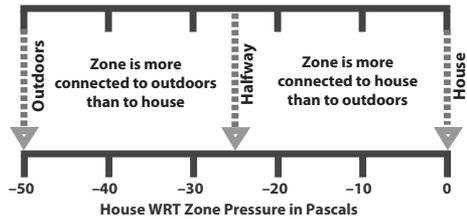

**House-to-attic pressure:** This commonly used measurement is convenient because it requires only one hose.

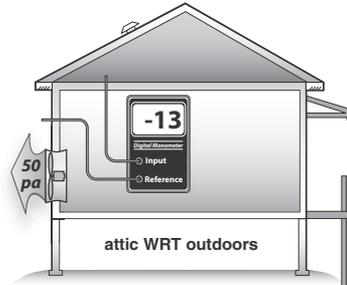


**Attic-to-outdoors pressure:** This measurement confirms the first because the two add up to  $-50$  pascals.

## Leak-Testing Building Cavities

Building cavities such as wall cavities, floor cavities between stories, and dropped soffits in kitchens and bathrooms can also be

tested as described above to determine their connection to the outdoors as shown here.

*These examples assume that the manometer is outdoors with the reference port open to outdoors*

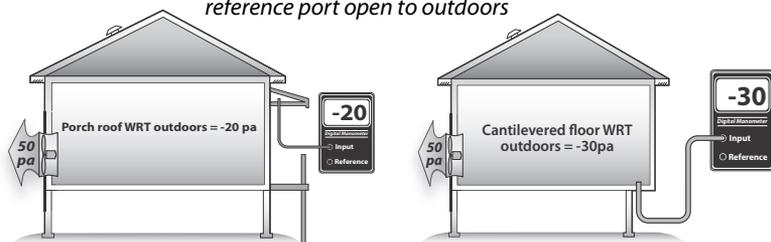


**Porch roof test:** If the porch roof were outdoors, the manometer would read near 0 pascals. We hope that the porch roof is outdoors because it is outside the insulation. We find, however, that it is partially indoors, indicating that it may harbor significant air leaks through the thermal boundary.

**Cantilevered floor test:** We hope to find the cantilevered floor to be indoors. A reading of  $-50$  pascals would indicate that it is completely indoors. A reading less negative than  $-50$  pascals is measured here, indicating that the floor cavity is partially connected to outdoors.

## Testing Zone Connectedness

Sometimes it's useful to determine whether two zones are connected by a large air leak. Measuring the house-to-zone pressure during a blower door test, before and then after opening the other zone to the outdoors, can establish whether the two zones are connected by a large air leak. You can also open an interior door to one of the zones and check for pressure changes in the other zone.

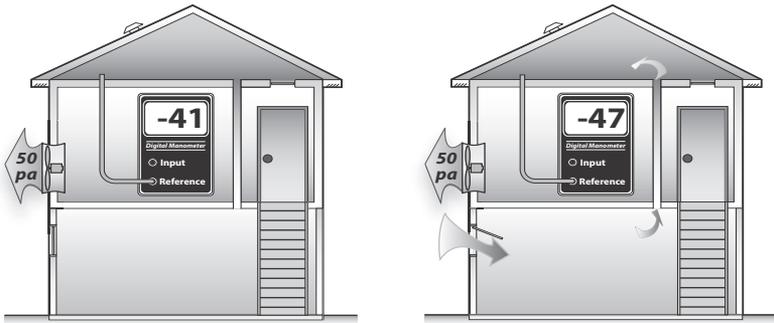

**Zone connectedness:** The attic measures closer to outdoors after the basement window is opened, indicating that the attic and basement are connected by a large bypass.

## Leak-Testing Building Cavities

You can also test building cavities such as wall cavities, floor cavities between stories, and dropped soffits in kitchens and bathrooms with a digital manometer to evaluate their possible connection to the outdoors by way of air leaks.

### 12.3.4 Locating the Thermal Boundary

When retrofitting, you need to decide where to air-seal and where to insulate. Zone pressures are one of several factors used to determine where the thermal boundary should be.


For zone leak-testing, the house-to-zone pressure is often used to determine which of two air barriers is tighter.

- Readings of negative 25-to-50 pascals house-to-attic pressure mean that the ceiling is tighter than the roof. If the roof is almost completely airtight, achieving a 50-pascal house-to-attic pressure difference may be difficult. However if the roof is well-ventilated, achieving a near-50-pascal difference should be possible.
- Readings of negative 0-to-25 pascals house-to-attic pressure mean that the roof is tighter than the ceiling. If the

roof is well-ventilated, the ceiling has even more leakage area than the roof's vent area.

- Readings around  $-25$  pascals house-to-attic pressure indicate that the roof and ceiling are equally airtight or leaky.

Pressure readings more negative than  $-45$  pascals indicate that the ceiling (typical primary air barrier) is adequately airtight. Less negative pressure readings indicate that air leaks should be located and sealed.

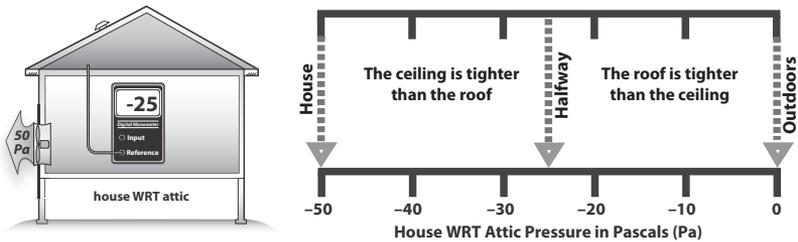


## Floor Versus Crawl Space

The floor shown here is tighter than the crawl-space foundation walls. If the crawl-space foundation walls are insulated, holes and vents in the foundation wall should be sealed until the pressure difference between the crawl space and outside is as negative you can make it — ideally more negative than  $-45$  pascals. A leaky foundation wall renders its insulation nearly worthless.

If the floor above the crawl space were insulated instead of the foundation walls in the above example, the air barrier and the insulation would be aligned.

If a floor is already insulated, it makes sense to establish the air barrier there. If the foundation wall is more airtight than the floor, that would be one reason to insulate the foundation wall.

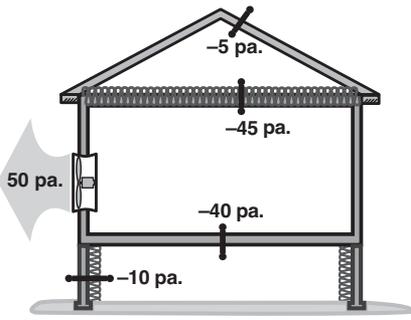

**Pressure measurements and air-barrier location:** The air barrier and insulation are aligned at the ceiling. The crawl-space pressure measurements show that the floor is the air barrier and the insulation is misaligned — installed at the foundation wall. We could decide to close the crawl space vents and air-seal the crawl space. Then the insulation would be aligned with the air barrier.

## Attic Boundary

Generally, the thermal boundary (air barrier and insulation) should be between the conditioned space and attic. An exception would be insulating the roof to enclose an attic air handler and its ducts within the thermal boundary.

## Garage Boundary

The air barrier should always be between the conditioned space and a tuck-under or attached garage, to separate the living spaces from this unconditioned and often polluted zone.

## Duct Location

The location of ducts either within or outside the thermal boundary is an important factor in determining the cost-effectiveness of duct-sealing and insulation. Including the heating ducts within the thermal boundary is preferred because it reduces energy waste from both duct leakage and duct heat transmission.

## 12.4 SWS ALIGNMENT

<b>Field Guide Topic</b>	<b>SWS Detail</b>
Shell Air-Leakage Fundamentals Pg. 469	
Goals of Air-Leakage Testing Pg. 470	
House Airtightness Testing Pg. 472	
Blower-Door Principles Pg. 472	
Preparing for a Blower Door Test Pg. 474	
Blower-Door Test Procedures Pg. 475	
Approximate Leakage Area Pg. 478	
Testing Air Barriers Pg. 478	
Primary Versus Secondary Air Barriers Pg. 480	
Simple Pressure Tests Pg. 481	
Simple Zone Pressure Testing Pg. 483	
Locating the Thermal Boundary Pg. 487	

# APPENDICES

## A-1 R-VALUES FOR COMMON MATERIALS

Material	R-value
Fiberglass or rock wool batts and blown 1"	2.8–4.0
Blown cellulose 1"	3.0–4.0
Vermiculite loose fill 1"	2.7
Perlite 1"	2.4
White expanded polystyrene foam (beadboard) 1"	3.9–4.3
Polyurethane/polyisocyanurate foam 1"	6.2–7.0
Extruded polystyrene 1"	5.0
High-density 2-part polyurethane foam 1"	5.8–6.6
Low-density 2-part polyurethane foam 1"	3.6
Oriented strand board (OSB) or plywood 1/2"	1.6
Concrete or stucco 1"	0.1
Wood 1"	1.0
Carpet/pad 1/2"	2.0
Wood siding 3/8–3/4"	0.6–1.0
Concrete block 8"	1.1
Asphalt shingles	0.44
Fired clay bricks 1"	0.1–0.4
Gypsum or plasterboard 1/2"	0.4
Single pane glass 1/8"	0.9
Low-e insulated glass (Varies according to Solar Heat Gain Coefficient (SHGC) rating.)	3.3–4.2

## **A-2 ASHRAE 62.2 EXAMPLE CALCULATION**

### **Example of Local Ventilation Deficit Calculation**

**Example:** The kitchen of a home has a small range hood providing 30 CFM and a window for an additional 20 CFM. The main bathroom has a fan providing around 30 CFM and no opening window. The second bath has an opening window but no fan. Follow the steps below to find the necessary additional airflow.

### **How to Find the Local Ventilation Deficit: 5 Steps**

- 1. Kitchen Deficit:  $100 \text{ CFM} - (30 + 20) \text{ CFM} = 50 \text{ CFM}$**
- 2. Bathroom 1 Deficit:  $50 \text{ CFM} - 30 \text{ CFM} = 20 \text{ CFM}$**
- 3. Bathroom 2 Deficit:  $50 \text{ CFM} - 20 \text{ CFM} = 30 \text{ CFM}$**
- 4. Total Deficit:  $50 \text{ CFM} + 20 \text{ CFM} + 30 \text{ CFM} = 100 \text{ CFM}$**
- 5. Added CFM Needed ( $I_{\text{def}}$ ):  $100 \text{ CFM} \div 4 = \underline{25 \text{ CFM}}$**

# A-3 ASHRAE 62.2 DUCT SIZING

## Rated Fan CFM

50	80	100	125	150	200	250	300
----	----	-----	-----	-----	-----	-----	-----

Duct Dia.	Smooth Hard Duct - Maximum Duct Length in Feet							
3"	5	X	X	X	X	X	X	X
4"	114	31	10	X	X	X	X	X
5"	NL	152	91	51	28	X	X	X
6"	NL	NL	NL	168	112	53	25	9
7"	NL	NL	NL	NL	NL	148	88	54
8"	NL	NL	NL	NL	NL	NL	198	133

Duct Dia.	HVAC Flex Duct - Maximum Duct Length in Feet							
3"	X	X	X	X	X	X	X	X
4"	56	4	X	X	X	X	X	X
5"	NL	81	42	16	2	X	X	X
6"	NL	NL	158	91	55	18	1	X
7"	NL	NL	NL	NL	161	78	40	19
8"	NL	NL	NL	NL	NL	189	111	69

NL: No limit;  
 X: not allowed

Table assumes no elbows. Deduct 15 ft from allowable duct length for each elbow.

## A-4 FIRE TESTING AND RATING

Test/Rating	Description
ASTM E-136	If a material passes this test, it is non-combustible.
ASTM E-119	Hourly rating of a wall when exposed to fire. Determines how long that the wall holds back heat and flames.
ASTM E-184	Hourly rating for a sealant system for a penetration through a fire-rated (ASTM E119) assembly.
ASTM E-84	Test measures how fast flames spread in a fire tunnel lined with the tested material, compared to red oak, which is given a flame spread of 100. <b>This test classifies materials as Class I, II, or III (or A, B, &amp; C) See flame spread in the three rows below.</b>
Class I or A	Flame spread less than or equal to 25
Class II or B	Flame spread 26 to 75
Class III or C	Flame spread 76 to 200
UL181	Duct materials, duct-closure systems, and duct sealants so labeled pass UL fire-resistance tests.

## A-5 MAXIMUM CAZ DEPRESSURIZATION

Appliance Type	Max. Depress.
Atmospheric water heater only (Category I, natural draft), open-combustion appliances, and orphaned water heater	-2 pa
Atmospheric water heater (Category I, natural draft) and atmospheric furnace (Category I, natural draft), common-vented, open-combustion appliances	-3 pa
Gas furnace or boiler, Category I or Category I fan-assisted, open-combustion appliances, and stand-alone gas water heaters	-5 pa
Oil or gas unit with power burner, low- or high-static pressure burner, open combustion appliances	-5 pa
Wood-burning appliances	-7 pa
Open-combustion furnaces or boilers with fan-powered horizontal venting	-15 pa
Pellet stove with draft fan and sealed vent	-15 pa
Direct-vent, sealed combustion appliances with forced draft.	-25 pa

*SWS Detail: 2.0299.1 Combustion Appliance Depressurization Limits Table*

# A-6 GAS FURNACE OUTPUT TABLE

CFM	Temperature Rise (Supply F° – Return F°)					
	30	40	50	60	70	80
<b>600</b>	19.4	25.9	32.4	38.9	45.4	51.8
<b>700</b>	22.7	30.2	37.8	45.4	52.9	60.5
<b>800</b>	25.9	34.6	43.2	51.8	60.4	69.1
<b>900</b>	29.2	38.9	48.6	58.3	68.0	77.8
<b>1000</b>	32.4	43.2	54.0	64.8	75.6	86.4
<b>1100</b>	35.6	47.5	59.4	71.3	83.2	95.0
<b>1200</b>	38.9	51.8	64.8	77.8	90.7	103.7
<b>1300</b>	42.1	56.2	70.2	84.2	98.3	112.3
<b>1400</b>	45.4	60.5	75.6	90.7	105.8	121.0
<b>1500</b>	48.6	64.8	81.0	97.2	113.4	129.6

# A-7 BPI CO & DRAFT DECISION TABLE

CO Level		Draft and Spillage	Required Action
0 – 25 ppm	and	Passes	Proceed with work.
26 – 100 ppm	and	Passes	Recommend that the CO problem be fixed.
26 – 100 ppm	and	Fails at worst-case only	Recommend a service call for the appliance and/or repairs to the home to correct the problem.
100 – 400 ppm	or	Fails under normal conditions	<b>Stop Work:</b> Work may not proceed until the system is serviced and the problem is corrected.
>400 ppm	and	Passes	<b>Stop Work:</b> Work may not proceed until the system is serviced and the problem is corrected.
>400 ppm	and	Fails under any conditions	<b>Emergency:</b> Shut off the fuel to the appliance and ask the homeowner to call for service immediately.

Building Performance Institute Inc.: Energy Analyst Standard

# A-8 REFRIGERATOR DATING CHART

Refrigerators are listed by brand name, followed by the coding system. If several manufacturers used the same system, they are listed together. Some rules of thumb for easy identification are: (1) Refrigerators that are any color of green, brown, yellow, pink, or blue (actually KitchenAid makes a new unit in cobalt blue) have mechanical handles; have doors held shut with magnetic strips; have rounded shoulders; have a chromed handle; or have exposed "house door" type hinges and at least 10 years old, and (2) the following brands have only been manufactured since around 1984 - Roper, Estate, KitchenAid, Caloric, Modern Maid, and Maytag.

Brand(s)	What to look for	What to avoid	How to decode	Example	
Montgomery Ward, Signature (2000)	Serial # - 1 <sup>st</sup> two digits	n/a	Reverse the digits	56xxxx = 1965	
Sears, Kenmore, Coldspot	Model # - 1 <sup>st</sup> & 3 <sup>rd</sup> digits after ( )	n/a	Combine the digits	xx6x2xxx = 1962	
Whirlpool	Model # - 1 <sup>st</sup> 3 letters (pre 1982) Serial # - 2 <sup>nd</sup> digit (post 1982)	Serials with letters	No need as 1 <sup>st</sup> two digits Add "198" to it	ABCxxx = pre 1982 x2xxx = 1982	
Amana	Serial # - 1 <sup>st</sup> digit (pre 1986)	n/a	BLACKHORSE B=1, L=2	Hxxx = 1966 or 1976 61 is the oldest	
Frigidaire	Serial # - 1 <sup>st</sup> & 4 <sup>th</sup> digit (pre 1989)	Serials with no letter in the 4 <sup>th</sup> space	Add "196, 197, or 198" to the 1 <sup>st</sup> digit. The letter in the 4 <sup>th</sup> space is a month code used only on older models.	3xxBxx = 1972 or 1983	
Gibson, Kelvinator	Serial # - 3 <sup>rd</sup> digit (pre 1989)	n/a	Add "196, 197, or 198" to it	xx3xx = 1963 or 73 or 83	
White, Westinghouse	Serial # - 2 <sup>nd</sup> letter (pre 1989)	Serials without letters	A, V, W=78, B=79, C=80 etc. pre-1978, R=74, U=77 etc.	xLxxx = 1988 74 is the oldest year	
Tappan, O'Keefe & Merritt	Serial # - 7 <sup>th</sup> digit (pre 1989)	n/a	Add "196, 197, or 198" to it	xx xxx-88xx = 1968 or 78 or 88	
Admiral, Crosley, Norge, Magic Chef, Jenn Air	Serial # - last letter	n/a	A=1950 or 1974 (+14 yrs) B=1951 or 1975, etc.	xxxxxD = 1953 or 1977	
General Electric (GE)	Serial # - 2 <sup>nd</sup> letter	n/a	See chart below	xGxxx = 1950 or 1980	
Hotpoint	Same as GE with some exceptions. See GE and Hotpoint exceptions chart below				
GE Decoder Chart:	A = 44, 65, 77, 89 H = 51, 81, 93 R = 58, 84	B = 45, 66 J = 52 S = 59, 85	C = 46, 67 K = 53 T = 60, 74, 86	D = 47, 68, 78, 90 L = 54, 70, 82, 94 V = 61, 75, 87	E = 48, 69 M = 55, 71, 83 W = 62 F = 49, 79, 91 N = 56, 72 X = 63, Y = 64 G = 50, 80, 92 P = 57, 73 Z = 76, 88
Hotpoint Exceptions:	U = 61, V = 62, W = 63, X = 64, Y = 65, Z = 66, A = 67, B = 68				

Revised 5/6/94

# GLOSSARY

*Abatement* : A measure or set of measures designed to permanently eliminate a hazard

*Absolute humidity*: Air's moisture content expressed in grains or pounds of water vapor per pound of dry air.

*Absorptance*: The ratio of a solar energy absorbed to incident solar. Also called absorbtivity.

*Absorption*: A solid material's ability to draw in and hold liquid, gas, or radiant energy.

*Accent Lighting*: Accent lighting illuminates walls, reduces brightness and contrast between walls and ceilings or windows.

*Acoustical Sealant*: Sealing agent used to minimize the entry or exit of sound from an interior space.

*ACH50*: The number of times in one hour that all of the air in a home is replaced by outside air through air leakage and/or ventilation.

*Adsorption*: Adhesion of a thin layer of molecules to a surface they contact.

*Air Barrier*: Any part of the building shell that offers resistance to air leakage. The air barrier is effective if it stops most air leakage. The primary air barrier is the most effective of a series of air barriers.

*Air Changes per Hour at 50 Pascals (ACH<sub>50</sub>)*: The number of times the volume of air in a structure will change in one hour at the induced blower door house pressure of 50 pascals.

*Air Changes per Hour Natural (ACH<sub>nat</sub>)* : The number of times the indoor air is exchanged with the outdoor air in one hour under natural driving forces. It can be estimated using a blower door.

*Air conditioning:* Cooling buildings with a refrigeration system. More generally means both heating and cooling.

*Air Conditioning Contractors of America (ACCA):* Industry group that works toward improving the air conditioning industry, promoting good practices and keeping homes and buildings safe, clean, and comfortable.

*Air exchange:* The process whereby indoor air is replaced with the outdoor air through air leakage and ventilation.

*Air-free carbon monoxide :* A measurement of CO in an air sample or flue gas that takes into account the amount of excess air (oxygen, O<sub>2</sub>) in the sample, incorporating an adjustment to the as-measured CO ppm value, thus simulating air-free (oxygen-free) conditions in the sample. Usually measured in units of parts per million (ppm).

*Air handler:* A steel cabinet containing a blower with cooling and/or heating equipment and connected to ducts that transport indoor air to and from the air handler.

*Air-handling unit (AHU):* See air handler.

*Air leakage:* Uncontrolled ventilation through gaps in the pressure boundary. Typical sites of air leakage include around windows, pipes, wires and other penetrations.

*Air-impermeable insulation:* An insulation having an air permeance equal to or less than 0.02 L/s-m<sup>2</sup> at 75 Pa pressure differential tested according to ASTM E 2178 or E 283.

*Air sealing:* Air sealing is a systematic approach to reducing air leakage in a building.

*Albedo:* The ratio of reflected to incident light.

*Altitude adjustment:* The input modification for a gas appliance installed at a high altitude. When a gas appliance is installed more than 2000 feet above sea level, its input rating may be reduced by approximately 4 percent per 1000 feet above sea level.

*Ambient*: Of the surrounding area or environment.

*Ambient air* : Air in the habitable space. Also the air around a human observer.

*Ambient lighting*: Lighting spread throughout the lighted space for safety, security, and aesthetics.

*American Gas Association (AGA)*: A trade association representing American natural gas supply companies. AGA collaborates with ASC and NFPA on the National Fuel Gas Code.

*American National Standards Institute, Inc. (ANSI)*: A private non-profit organization that oversees the development of voluntary consensus standards for products, services, processes, systems, and personnel in the United States.

*American Recovery and Reinvestment Act (ARRA)*: Bill signed by President Obama in February 2009 as an economic stimulus package

*American Society of Heating, Refrigeration, and Air Conditioning Engineers (ASHRAE)*: A technical society for individuals and organizations interested in heating, ventilation, air-conditioning, and refrigeration. ASHRAE publishes standards and guidelines relating to HVAC systems and issues.

*American Society for Testing and Materials (ASTM)* : A standards organization that develops and publishes voluntary consensus technical standards for a wide range of materials, products, systems, and services.

*Amperage*: The rate that electrical current flows through an appliance at any given time; also called current.

*Ampere*: A unit that measures the rate that electrons move through a conductor. It is comparable to a measurement of water flow.

*Anemometer*: A device for measuring air speed, used in weatherization work to determine flow rates at registers.

*Annual Fuel Utilization Efficiency (AFUE):* A laboratory-derived efficiency for heating appliances that accounts for chimney losses, jacket losses, and cycling losses, but not distribution losses or fan/pump energy.

*Annual return:* The annual savings divided by the initial cost of an ECM, expressed as a percent.

*Appliance:* Any device powered by electricity or combustion fuel.

*Approach temperature:* The temperature difference between the fluid inside a heat exchanger and the fluid outside it.

*Aquastat:* A heating control device that controls the burner or the circulator in a hydronic heating system

*Area:* Length x width = area

*As-measured Carbon Monoxide :* A calculation of CO in parts per million (ppm) of a combustion-gas sample with the excess air (oxygen, O<sub>2</sub>), diluting the CO concentration removed by the calculator in the fuel-gas analyzer.

*ASHRAE:* American Society of Heating, Refrigerating, and Air-Conditioning Engineers. International technical society which develops standards for those concerned with refrigeration processes and the design and maintenance of indoor environments.

*ASHRAE 62.2-20xx:* Air quality standard developed for low-rise residential buildings. Defines the roles of a minimum requirements for mechanical and natural ventilation systems and the building envelope. The most current standard of time of writing was ASHRAE 62.2-2013.

*Asbestos:* A fibrous mineral with fireproofing and insulating characteristics manufactured into a variety of building materials. Small, sharp, asbestos fibers are a known carcinogen when inhaled.

*Association of Energy Engineers (AEE):* A professional organization for energy engineers. AEE offers many certification programs, including one for residential energy auditors.

*Association of Home Appliance Manufacturers (AHAM):* Trade association representing the appliance manufacturing industry

*Atmospheric appliance :* A combustion appliance that burns and exhausts its combustion gases at atmospheric pressure.

*Atmospheric pressure :* The weight of air and its contained water vapor on the surface of the earth. At sea level this pressure is 14.7 pounds per square inch.

*Attic:* The unfinished space between the ceiling assembly of the top story and the roof assembly.

*Attic, habitable:* A finished or unfinished area, not considered a story. See the IRC for specific requirements.

*Audit:* The process of identifying energy conservation opportunities in buildings.

*Auxiliary heat:* Electric resistance heat in a heat pump that heats the building when the compressor isn't able to provide the entire heat capacity needed for cold weather.

*Awning window:* Awning windows are essentially casement windows that swing vertically. Awning windows are often used in basements. Jalousie windows, found on older mobile homes, are a type of awning window.

*B-vent:* A double-wall pipe for gas- or propane-fired combustion appliances.

*Backdrafting:* Continuous spillage of combustion gases from a vented combustion appliance into the conditioned space.

*Backdraft damper:* A damper, installed near a fan, that allows air to flow in only one direction.

*Backer rod:* Polyethylene foam rope used as a backer for caulking.

*Baffle:* 1. A lightweight plate that directs air from a soffit over attic insulation and along the bottom of the roof deck to ventilate the attic and cool the roof deck. 2. A plate or strip designed to retard or redirect the flow of flue gases.

*Balance point* : The outdoor temperature at which no heating is needed to maintain inside temperatures.

*Ballast*: A coil of wire or electronic device that provides a high starting voltage for a lamp and limits the current flowing through it

*Balloon framing*: A method of construction in which the vertical framing members (studs) are continuous pieces running the entire height of the wall.

*Band joist*: See - Rim Joist

*Barometric Vent Damper* : A device installed in the heating unit vent system to control draft. Usually used on oil-fueled units or gas units with power burners

*Barrier*: Material used to block passage or movement.

*Basement*: That portion of a building that is partly or completely below grade.

*Batt*: A blanket of preformed insulation, generally 14 inches to 23 inches wide, and varying in thickness from 3.5 inches to 10 inches.

*Beam*: A strong horizontal building support used to carry the weight of a floor or roof.

*Belly blow*: A process for re-insulating floor cavities with blown-in insulation.

*Belly return* : A configuration found in some mobile homes that uses the belly cavity as the return side of the heating/cooling distribution system.

*Bimetal element*: A metal spring, lever, or disc made of two dissimilar metals that expand and contract at different rates as the temperature around them changes. This movement operates a switch in the control circuit of a heating or cooling device.

*Blocking* : A construction element or material used to prevent the movement of air or insulation into or through building cavities.

*Block Frame:* A non-finned frame that can be used as new or retrofit installation in a block wall application or as a wood window replacement frame.

*Blower Door:* A blower door is a diagnostic tool used to locate the points of infiltration in the building envelope and help prioritize the air sealing protocols.

*Blow-Down:* The act of removing water from a boiler to remove sediment and suspended particles.

*Blower Fan:* The squirrel-cage fan in a furnace or air handler.

*Blown Insulation :* A loose-fill insulation that is blown into attics and building cavities using an insulation blowing machine.

*Board Feet:* A measurement of lumber volume. A board foot equals 144 cubic inches of wood

*Boiler:* A fossil fuel appliance used for producing hot water or steam as the medium to distribute heat to the dwelling unit.

*Boot:* A duct section that connects between a duct and a register or between round and square ducts

*Bonus Room:* A room that does not meet building code requirements in order to be habitable.

*Borescope:* An inspection tool; a reflexible tube with a light and camera or viewer at one end. Boroscopes can be used to look into wall cavities and other tight spaces that would be otherwise impossible to visually inspect.

*Boundary:* Defines where an area ends and another begins.

*Branch Circuit:* An electrical circuit used to power outlets and lights within a home.

*Branch Duct:* An air duct which branches from a main duct.

*Brightness:* The intensity of the sensation derived from viewing a lit surface. Measured in footlamberts, it is also called luminance or luminous intensity.

*British Thermal Unit (Btu)*: The quantity of heat required to raise the temperature of one pound of water one degree Fahrenheit.

*BTUh* : British Thermal Units per hour.

*Building Cavities*: The spaces inside walls, floors, and ceilings between the interior and exterior sheathing

*Building Envelope*: The area of the building that encloses its conditioned and unconditioned spaces.

*Building Management System (BMS)*: Computer-based control system installed in buildings that controls and monitors the building's mechanical and electrical equipment such as air handling and cooling.

*Building Performance Institute (BPI)* : Organization supporting the development of a highly professional building performance industry through individual and organizational credentialing and a quality assurance program.

*Building Science*: A complex perspective on buildings, using contemporary technology to analyze and solve problems of design, construction, maintenance, safety, and energy efficiency.

*Building Shell*: Separates a building's indoors from the outdoors.

*Building Tightness Limit (BTL)* : Calculation procedure, expressed in units of CFM50, based on the American Society of Heating, Refrigerating and Air- Conditioning Engineers Standard 62-2001, Ventilation for Acceptable Indoor Air

*Bulk Moisture*: Large amounts of water intrusion, for example from wind-driven rain or sub-surface water.

*Burner*: A device that facilitates the burning of a fossil fuel, like gas or oil.

*Butyl-backed tape*: Heavy-duty, pressure-sensitive duct joint rolled sealant.

*Bypass* : An air leakage site that allows air to leak out of a building passing around the air barrier and insulation.

*Cad Cell:* A flame sensor composed of the chemical compound cadmium sulfide. Its purpose is to sense whether a flame is present during a burner cycle. If a flame is not detected, it activates a relay, which shuts the burner down.

*Calibration:* Comparison of the test results of an instrument to a known reference point.

*Call-back:* Having a weatherization team return to a job site to perform work not done or redo work done unsatisfactorily.

*Can light:* A light fixture (or can) that is set into the ceiling. Also called a recessed light fixture.

*Cantilever:* A projecting structure, such as a beam, that is supported at one end and carries a load at the other end or along its length.

*Cantilevered Floor:* A floor that extends beyond the foundation of the framed structure below it.

*Cape Cod:* A house design featuring a finished attic space, also called a one-and-a-half story.

*Capillary action:* The ability of water to move through materials, even upward against gravity, through small tubes or spaces.

*Capillary barrier:* A material or air space designed to stop capillary action from carrying water into a building.

*Carbon Dioxide (CO<sub>2</sub>):* A heavy, colorless, nonflammable gas formed by the oxidation of carbon, by combustion, and by the respiration of plants and animals. One of two main products of complete combustion of a hydrocarbon (the other is water vapor).

*Carbon Monoxide (CO):* Carbon Monoxide is a tasteless, odorless, colorless and poisonous gas that is a by-product of incomplete combustion of fossil fuels. It is usually caused by a lack of air to support combustion or impingement of the flame.

*Casement Window:* Casement windows have a single operable sash that swings outward on a horizontal plane. Casement win-

dow frames that have gone out of square due to settling can stick and quite possibly render these types of windows inoperable.

*Casing:* Exposed molding or trim around a window or door.

*Cathedral Ceiling:* A pointed or slanting ceiling of a room that rises through more than one floor.

*Cathedralized Attic:* An attic that is insulated at the underside of the roof deck rather than at the ceiling.

*Caulking:* Mastic compound for filling joints and cracks.

*Celsius:* A temperature scale on which water freezes at 0°C and boils at 100°C.

*Cellulose Insulation:* Insulation, packaged in bags for blowing, made from newspaper or wood waste and treated with a fire retardant.

*Centigrade:* A temperature scale on which water freezes at 0 degrees and boils at 100 degrees

*Central Heating System:* This refers to the primary heating system of the dwelling unit including the heat producing appliance, the return and supply system for heat distribution.

*Certification:* Recognition by an independent person or group that someone can competently complete a job or task, frequently demonstrated by passing an exam.

*Certified Renovator:* A person authorized by the EPA to perform repair and renovation projects that disturb lead-based paint.

*CFM<sub>50</sub>:* This term means the amount of cubic feet per minute of air moving through a structure and measured at 50-pascal pressure.

*CFM<sub>n</sub>:* The cubic feet of air flowing through a house from indoors to outdoors during typical, natural conditions. This figure can be roughly estimated using a blower door.

*CFM - Cubic Feet per Minute:* Usually seen as CFM 50, cubic feet per minute of air movement due to 50 pascal house/outdoor pressure differential.

*Chaseway:* Cavity within a building with a purpose of conveying pipes, ducts, etc. through the building. Chaseways, such as plumbing walls, are common sites for air leakage.

*Chimney:* A building component designed for the sole purpose of assuring combustion by-products are exhausted to the exterior of the building.

*Chimney connector:* A pipe that connects a fuel-burning appliance to a chimney. Also see vent connector.

*Chimney Flue:* A passageway in a chimney for conveying combustion gases to the outdoors.

*Chimney Chase:* Typically refers to the cavity between the chimney and the framing and other building materials that surround the chimney.

*Circuit Breaker:* A device found in a Circuit Panel Box that completes an electric circuit. This breaker disconnects the circuit from electricity when it senses an overload of current.

*Cladding:* The exterior covering or coating on a structure, such as wood siding, stucco, or brick veneer.

*Clean and Tune (C&T):* A procedure performed on a heating or cooling system by a qualified technician to optimize its efficiency.

*Cleanout:* An opening in a chimney (usually at its base) to allow inspection and the removal of ash or debris.

*Clearances:* Allowable distances between heat-producing appliances, chimneys, or vent systems and combustible surfaces.

*Climate zone:* An area with a prevailing climate that distinguishes it from other areas by parameters such as temperature, rainfall, and humidity.

*Codes:* Any set of standards set forth and enforced for the protection of public health and humidity.

*Circuit breaker :* A device that automatically disconnects an electrical circuit from electricity under a specified or abnormal condition of current flow.

*Co-efficient of Performance (COP):* A heat pump or air conditioner's output in watt-hours of heat moved divided by watt-hours of electrical input.

*Coil:* A snake-like piece of copper tubing surrounded by rows of aluminum fins that clamp tightly to the tubing and aid in heat transfer.

*Coil Stock:* Sheet metal packaged as a coil in various widths.

*Cold Air Return (return side) :* Ductwork through which house air is drawn for reheating during a furnace's cycle.

*Cold roof:* The condition in which the roof temperature is equalized from top to bottom by roof ventilation and/or roof insulation.

*Collar beam:* A horizontal piece in roof framing that provides structural strength by connecting opposite rafters.

*Color rendering index (CRI):* A measurement of a light source's ability to render colors the same as sunlight. CRI has a scale of 0 to 100.

*Color temperature:* A measurement of the warmness or coolness of a light source in the Kelvin temperature scale.

*Column:* A vertical building support usually made of wood or steel.

*Combustible:* Means something will burn, although not necessarily readily.

*Combustible gas leak detector :* A device for determining the presence and general location of combustible gases in the air.

*Combustion* : The act or process of burning. Oxygen, fuel, and a spark must be present for combustion to occur.

*Combustion air*: Air that chemically combines with a fuel during the combustion process to produce heat and flue gases, mainly carbon dioxide and water vapor.

*Combustion Analyzer*: A device used to measure and analyze combustion gases for efficiency and safety in heating units.

*Combustion Appliance*: Any appliance in which combustion occurs.

*Combustion Appliance Zone (CAZ)* : The closed space or area that holds one or more combustion appliances.

*Combustion Appliance Zone (CAZ) testing*: Diagnostics performed to ensure that combustion appliances work properly and that house pressures allow combustion gases to vent.

*Combustion Byproducts*: Gases, vapors, and particulates produced whenever carbon-based fuels such as gas, oil, kerosene, wood, or charcoal are burned.

*Combustion Chamber*: The area inside the heat exchanger where the flame burns

*Combustion efficiency*: Synonymous with steady-state efficiency.

*Combustion gases*: Combustion byproducts.

*Commissioning*: The process of testing and adjusting building mechanical systems.

*Common vent* : The portion of the vent or chimney through which passes products of combustion from more than one appliance.

*Compact Fluorescent Lamp (CFL)* : A small fluorescent light engineered to fit in an Edison base of an incandescent fixture.

*Competency*: Demonstrated ability to perform a job or task.

*Compressor*: A motorized pump that compresses the gaseous refrigerant and sends it to the condenser where heat is released

*Concentrically Constructed Direct-Vent* : A direct-vent appliance that has an exhaust-gas vent and a combustion-supply-air vent arranged in a concentric fashion: one pipe is inside the other with a space between the walls of each.

*Condensate*: Vapor condensed back to a liquid. For example: water or refrigerant.

*Condensate Receiver*: A tank for catching returning condensate water from a steam heating system.

*Condense*: When a gas turns into a liquid as it cools, it condenses. When a gas condenses into a liquid it releases heat.

*Condenser*: The coil in a refrigeration system where the refrigerant condenses and releases heat.

*Condensing furnace*: A high-efficiency furnace that removes latent heat from combustion gases by condensing water vapor out of the combustion gases.

*Conditioned*: Intentionally heated or cooled areas of a building

*Conditioned Air*: Air that has been heated, cooled, humidified, or dehumidified to maintain comfort.

*Conditioned space*: For energy purposes, space within a building that is provided with heating and/or cooling equipment or systems, or communicates directly with a conditioned space. For mechanical purposes, an area, room or space being heated or cooled by any equipment or appliance.

*Conductance*: The quantity of heat, in BTUs, that flows through one square foot of material in one hour, when there is a one degree Fahrenheit temperature difference between both surfaces. Conductance values are given for a specific thickness of material.

*Conduction*: Conduction is the transfer of heat through a material by molecular movement. Reducing heat loss through conduction can include the installation insulation in wall, ceiling, and floor cavities, insulation of hot water tanks, creating ther-

mal breaks in window and door framing, and sealing of bypasses and other sources of air movement.

*Conductive heat flow:* Transfer of heat through a solid homogeneous material.

*Conductivity :* The quantity of heat that flows through one square foot of homogeneous material, one inch thick, in one hour, when there is a temperature difference of one degree Fahrenheit between its surfaces.

*Confined Space :* A space, defined for the purpose of evaluating combustion air, with a volume of less than 50 cubic feet per 1,000 BTU per hour of the total input rating of all combustion appliances installed in that space.

*Contractor:* Any for-profit, not-for-profit, or government entity that provides services under contract, not as employees of the purchasing agency.

*Contrast:* Difference in brightness measured by the relationship between an object's brightness and the brightness of its background.

*Control Circuit:* An electrical circuit that activates or deactivates a power circuit or opens and shuts a valve.

*Convection:* The transfer of heat caused by the movement of a fluid like water or air. When a fluid becomes warmer it becomes lighter and rises.

*Convective Loop:* Heat flow resulting from airflow caused by temperature differences between surfaces.

*Cooling Load:* The maximum rate of heat removal required of an air conditioner when the outdoor temperature and humidity are at the highest expected level.

*Core competencies:* Essential skills for weatherization workers, defined by the Weatherization Trainers Consortium.

*Cost Effective:* Having an acceptable payback, return-on-investment, or savings-to-investment ratio.

*Crawl Space:* The low space beneath the ground floor of a building that gives workers access to wiring and plumbing.

*Crew Leader:* A crew leader is a residential energy professional who is responsible for supervising the retrofit activities specified in the scope of work.

*Critical Framing Juncture :* An intersection of framing members and envelope components that require special attention during prep and installation of insulation.

*Cross Section:* A view of a building component drawn or imagined by cutting through the component.

*Crosswise floor joist configuration:* home joist configuration where the main duct is located beneath the floor joists and connected by boots to the sub-floor.

*Cubic Foot Per Minute (CFM):* A measurement of air movement past a certain point or through a certain structure. See also *CFM<sub>50</sub>* and *CFM<sub>n</sub>*.

*Curtain Wall:* A wall between columns and beams that supports no weight but its own

*Dado:* A rectangular groove cut into wood.

*Decatherm:* One million BTUs or 10 therms.

*Decking:* The wood material installed under roofing material to support the roofing.

*Decommissioning:* Removing or retiring equipment from active service including disposing of hazardous material in an approved way.

*Deferral of services:* Postponement or denial of weatherization services to the client.

*Dehumidification:* The removal of water from the air. Excess humidity can cause mold.

*Degree Days (DD):* A measure of outdoor temperature calculated by adding the temperature differences between an indoor

temperature of 65°F and the daily average outdoor temperature for a one-year period.

*Delta T*: Temperature difference.

*Demand*: The peak need for electrical energy. Some utilities levy a monthly charge for demand.

*Demand Side Management (DSM)*: The planning and implementation of those utility-sponsored conservation of electricity or gas.

*Dense Packing*: Blowing insulation with sufficient force to create a high density to reduce settling and minimize air leakage and air convection.

*Density*: The weight of a material divided by its volume, usually measured in pounds per cubic foot.

*Depressurization Tightness Limit (DTL)*: A calculation procedure, expressed in units of CFM<sub>50</sub>, performed to estimate the building tightness level at which combustion appliances might backdraft when the house is under conditions of worst-case depressurization. The DTL sets a low limit for air sealing that may or may not be lower than the BTL for the same house.

*Depressurize*: Cause to have a lower pressure or higher vacuum with respect to a pressure reference point such as the outdoors.

*Desiccant*: A liquid or solid material used to absorb water or water vapor.

*Design Temperature*: A high or low temperature used for designing heating and cooling systems when calculating the building load.

*Desk Monitoring*: Monitoring activities performed through review of paperwork.

*De-superheater*: A heat exchanger that removes the superheat from a compressed refrigerant and transfers that heat to another fluid, usually water.

*Dew point:* The warmest temperature of an object in an environment where water condensation from the surrounding air would form on that object.

*Diffusion:* Movement of water vapor through a material as a function of the vapor pressure across and the vapor permeability of the material.

*Dilution air:* Air that enters through the dilution device—an opening where the chimney joins to an atmospheric-draft combustion appliance

*Dilution Device:* A draft diverter, draft hood, or barometric draft control on an atmospheric-draft combustion appliance.

*Direct current:* An electric current flowing in only one direction.

*Direct Leakage:* Air enters and exits at same location; occurs at direct openings to outdoors.

*Direct-vent appliance :* A combustion appliance for which all combustion gases are vented to the outdoors through an exhaust vent pipe and all combustion supply air is supplied to the combustion chamber from the outdoors through a separate, dedicated supply-air pipe.

*Discount rate:* The interest rate at which expected future cash flows can be discounted. It includes both the present value and fuel escalation rate, and is used to account for the time value of money and the changing price of fuels.

*Distribution system:* A system of wires, pipes, or ducts that distributes energy.

*DOE:* The United States Department of Energy.

*Domestic hot water (DHW):* Refers to a separate, closed system to heat potable (drinkable) water and supply it to the dwelling unit for washing, bathing, etc.

*Dominant duct leakage:* To measure either dominant supply or return leaks in a forced-air distribution system by measuring house pressure.

*Door casing:* A wooden trim around doors that covers the seam between the jamb and the wall.

*Door stop:* The wood trim fastened to the inside of the jamb that positions the door within the jamb and into the latching mechanism.

*Dormer:* A framed structure projecting above a sloping roof surface, and normally containing a vertical window.

*Double-hung window:* Double-hung windows have operable upper and lower sashes that slide vertically in a channel. Upper sashes are often painted shut.

*Downflow:* Airflow configuration in a furnace where cool air is taken from above and discharged as warm air from the bottom.

*Downflow furnace:* Furnace type where the blower is located at the top of the furnace cabinet and air is forced downwards across the heat exchanger and into the ducts located in the belly cavity

*Downstream:* Away from the source of the flow.

*Draft:* A pressure difference that causes combustion gases or air to move through a vent connector, flue, chimney, or combustion chamber.

*Draft diverter:* A device located in gas appliance flue pipe. Used to moderate or divert draft that could extinguish the pilot or interfere with combustion.

*Draft fan:* A mechanical fan used in a venting system to augment the natural draft in gas- and oil-fired appliances. These electrically operated, paddle-fan devices are installed in vent connectors.

*Draft gauge:* Device for testing chimney draft.

*Draft hood:* See draft diverter.

*Draft inducer:* A fan that depressurizes the combustion chamber or venting system to move combustion products toward the outdoors.

*Draft regulator:* A self-regulating damper attached to a chimney or vent connector for the purpose of controlling draft.

*Drainage plane:* A space that allows water storage and drainage in a wall cavity, adjacent to or part of the water-resistive barrier.

*Dropped down belly:* home configuration where a hump is formed in the floor by the main duct running in the center.

*Dropped soffit:* A lowered part of the ceiling in a home.

*Drywall:* Gypsum interior wallboard used to produce a smooth and level interior wall surface and to resist fire. Also called gypsum wall board or sheetrock.

*Dry bulb temperature:* Normal ambient air temperature measured by a thermometer.

*Duct blower:* A blower-door-like device used for testing duct leakiness and air flow.

*Duct board:* Rigid board composed of insulation material with one or both sides faced with a finishing material.

*Duct boot:* Transition piece that connects the main duct to the floor and is often vulnerable to failure.

*Duct-induced pressure differences:* Pressure differences between rooms in a building caused by the ducted air delivery system, can be due to supply ducts, return ducts, or both.

*Duct zone:* A building space or cavity that contains heating or cooling ducts.

*Duplex:* Any structure which consists of two separate dwelling units in one building.

*Dwelling unit:* A house, including a stationary mobile home, an apartment, a group of rooms, or a single room occupied as separate living quarters.

*Eave:* The part of a roof that projects beyond its supporting walls (See - Soffit)

*Eave chute:* Device that maintains air space between the insulation blanket and the roof sheathing and prevents insulation from clogging eave vents.

*Eave vent:* Vent opening located in the soffit under the eaves of a house to allow the passage of air through the attic and out the roof vents.

*Efficiency:* The ratio of output divided by input

*Efficacy:* The number of lumens produced by a watt used for lighting a lamp. Used to describe lighting efficiency.

*Egress window:* A window with a defined opening size for the purpose of fire escape.

*Elastomeric:* A characteristic of a material that is flexible and permits movement.

*Elastomeric coating:* Polymeric material, such as acrylic, that is used to repair roof leaks and to reduce solar heat gain.

*Electric service:* The electric meter and main switch, usually located outside the building.

*Electro-mechanical:* Describes controls where switching is performed by an automatic mechanical device like a bimetal or bulb-and-bellows.

*Emergency heat:* A heating device that doesn't require electricity used during an emergency. Or electric-resistance heating elements used for heating in case a heat pump's compressor fails.

*Emittance:* The rate that a material emits radiant energy from its surface. Also called emissivity.

*Encapsulation:* Any covering or coating that acts as a barrier between the hazard, such as lead-based paint, and the indoor environment.

*Enclosure:* The building shell. The exterior walls, floor, and roof assembly of a building. Also referred to as building envelope.

*Energy:* A quantity of heat or work

*Energy audit:* The process of identifying energy conservation opportunities in buildings.

*Energy auditor:* One who inspects and surveys the energy use of buildings in order to promote energy conservation.

*Energy conservation measures (ECM):* Building components or products installed to reduce the building's energy consumption.

*Energy consumption:* The conversion or transformation of potential energy into kinetic energy for heat, light, electricity, etc.

*Energy education:* The process used by WAP staff to inform customers of the ways they can further reduce energy consumption through altering their behavioral patterns. The most effective protocol includes multiple interaction and reinforcement with the household residents and use of a negotiated and written action plan.

*Energy efficiency:* Term used to describe how efficiently a building component uses energy.

*Energy efficiency ratio (EER):* A measurement of energy efficiency for room air conditioners. The EER is computed by dividing cooling capacity, measured in British Thermal Units per hour (Btuh), by the watts of power. (See - Seasonal Energy Efficiency Rating or SEER)

*Energy factor:* The fraction of water heater input remaining in 64 gallons of hot water extracted from a water heater.

*Energy Information Administration (EIA):* Section of the U.S. Department of Energy providing statistics, data, and analysis on resources, supply, production, and consumption for all energy sources.

*Energy rater:* Evaluates the energy efficiency of a home and assigns a relative performance score, a certification received from HERS (Home Energy Rating System).

*Energy-recovery ventilator (ERV):* A ventilator that recovers latent and sensible energy from the exhaust airstream and imparts it to the incoming airstream.

*Enthalpy:* The internal heat of a material measured in Btus per pound.

*Entropy:* Heat unavailable to a closed thermodynamic system during a heat transfer process.

*Envelope:* The building shell. The exterior walls, floor, and roof assembly of a building. Also referred to as building enclosure.

*Environmentally Sensitive:* Highly susceptible to adverse effects of pollutants.

*EPA, U.S. Environmental Protection Agency :* EPA protects human health and safeguards the natural environment - air, water, and land upon which life depends.

*Equivalent Leakage Area (ELA):* Calculation, in square inches, of the total area of all holes and cracks in a structure. The leakage area is then accumulated to represent one total leakage point.

*Equivalent length:* The length of straight pipe or duct that has equivalent resistance to a pipe or duct fitting. Used for piping and duct design.

*Equivalent duct length (EDL) :* A measure of how much static pressure an exhaust fan has to overcome.

*Equivalent leakage area (ELA):* Calculation, in square inches, of the total area of all holes and cracks in a structure. The leakage area is then combined to represent one total leakage point.

*Evaporation:* The change that occurs when a liquid becomes a gas. Evaporation is the key process in the operation of air conditioners and evaporative coolers. Evaporation is a cooling process.

*Evaporative cooler:* A device for cooling homes in dry climates by humidifying and cooling incoming air by the evaporation of water.

*Evaporator:* The heat transfer coil of an air conditioner or heat pump that cools the surrounding air as the refrigerant inside the coil evaporates and absorbs heat.

*Excess air:* Air in excess of what is needed for combustion.

*Exfiltration:* This term describes the movement of air out of a building. Often refers to warm air leaving a building due to pressurization, infiltration, wind, stack effect, and/or convective flow.

*Expanded polystyrene:* White polystyrene insulation.

*Expanding foam:* An insulation product designed to expand and harden upon contact with the air. Available in canisters with spray nozzles that make it easy to apply foam in a wide variety of situations.

*Expansion valve:* A valve that meters refrigerant into the evaporator.

*Fahrenheit:* A temperature scale used in the United States and a few other countries. On the Fahrenheit scale, water boils at 212 degrees and freezes at 32 degrees.

*Fan-assisted combustion :* A combustion appliance with an integral fan to draw combustion supply air through the combustion chamber.

*Fan control:* A bimetal thermostat that turns the furnace blower on and off as it senses the presence of heat.

*Fan-off temperature :* In a furnace, the supply air temperature at which the fan control shuts down the distribution blower.

*Fan-on temperature :* In a furnace, the supply air temperature at which the fan control activates the distribution blower.

*Federal Energy Management Program (FEMP):* A program of DOE that implements energy legislation and presidential directives. FEMP provides project financing, technical guidance and assistance, coordination and reporting, and new initiatives for the federal government.

*Feeder wires* : The wires connecting the electric meter and main switch with the main panel box indoors.

*Fenestration*: Window and door openings in a building's wall.

*Fiberglass*: A fibrous material made by spinning molten glass used as an insulator and heat loss retardant.

*Field testing*: Assessment of a trainee's abilities conducted on-site, rather than in a classroom.

*Fill Tube*: A plastic or metal tube used for its stiffness to blow insulation inside a building cavity.

*Fin comb*: A comb-like tool used to straighten bent fins in air conditioning coils.

*Final inspection*: An evaluation of a weatherization job after its completion.

*Finished attic*: An attic that was converted to living space by the construction of dormers and knee walls.

*Finned tube*: A length or coil of pipe with heat transfer fins attached for water-to-air heat transfer.

*Fire barrier*: A tested building assembly, designed to contain a fire for a particular time period: typically 1-to-4 hours.

*Fireblocking*: Building materials installed to resist the free passage of flame to other areas of the building through concealed spaces.

*Fire resistance*: The property of materials or their assemblies that prevents or retards the passage of excessive heat, hot gases or flames under conditions of use.

*Fire resistance rating*: The period of time a building element, component or assembly maintains the ability to confine a fire, continues to perform a given structural function, or both.

*Fire stop*: Framing member designed to stop the spread of fire within a wall cavity.

*Firewall:* A structural wall between buildings designed to prevent the spread of a fire.

*Firing chamber:* The compartment inside an oil-burning furnace or boiler where the electrodes ignite the air/atomized oil mixture.

*Flame impingement:* The striking of flame against an object.

*Flame rectification:* A modern method of flame sensing, which uses the flame itself as a conductor in the flame-safety circuit.

*Flame-retention head burner:* A higher efficiency burner in an oil furnace that produces a hotter flame and operates with a lower air flow, thus reducing loss up the chimney.

*Flame roll-out:* Fuel gas combustion process occurring outside the normal combustion area of a combustion appliance.

*Flame safety control:* A control device used to stop the flow of fuel to the burner assembly in the event of no ignition.

*Flame spread:* The broadening or spreading of a flame.

*Flammability:* The rating for building materials that will burn readily when exposed to a flame.

*Flammable:* Combustible; readily set on fire.

*Flashing:* Waterproof material used to prevent leakage at intersections between the roof surface at walls or penetrations.

*Floor Joists:* The framing members that support the floor area.

*Flue:* The channel of pipe used to control air flow of combustion gases.

*Flue gas:* Gases arising from the combustion of fuels, mainly consisting of carbon dioxide. Fuel gas normally contains pollutants, such as carbon dioxide, nitrogen oxide, sulfur dioxide, and dust.

*Flush flange:* A window designed to provide a finished exterior appearance over a flat exterior surface like stucco.

*Foam board:* Plastic foam insulation manufactured most commonly in 4'x8' sheets in thickness of 1/4" to 3".

*Foam compatible adhesive:* Adhesive that is manufactured for the purpose of safely adhering to foam.

*Foot candle:* A measure of light striking a surface.

*Footing:* The part of a foundation system that actually transfers the weight of the building to the ground.

*Forced draft:* A vent system for which a fan installed at the combustion appliance moves combustion gases to the outdoors with positive static pressure in the vent pipe. Because of this positive pressure, the vent connector must be air-tight.

*Friable :* Easily broken into small fragments or reduced to powder, as with asbestos

*Frost line:* The maximum depth of the soil where water will freeze during the coldest weather.

*Fuel escalation rate:* Annual escalation rate of fuel prices based on the annual energy price forecasts of DOE's Energy Information Administration.

*Furnace:* An appliance for heating a medium to distribute heat throughout the dwelling unit.

*Furnace blower:* A part of the furnace that produces a current of air. Often referred to as the "blower" or "squirrel cage."

*Furnace plenum:* An air chamber that gets filled directly by a large blower that is above, below, or adjacent to it.

*Furring:* Thin wood strips fastened to a wall or ceiling surface as a nailing base for finish materials.

*Fuse:* A current carrying element that melts if too much current flows in an electric circuit.

*Gable:* The triangular section of an end wall formed by the pitch of the roof.

*Gable Roof*: A roof shape that has a ridge at the center and slopes in two directions.

*Gable vent*: A screened vent installed at or near the peak of a roof gable that allows warm attic air to escape.

*Gallons per minute (GPM)*: The unit for measuring water flow, frequently for showers.

*Gasket*: Elastic strip that seals a joint between two materials.

*General heat waste*: Weatherization materials that DOE has determined to be generally cost-effective. DOE must specifically approve these measures.

*Glare*: Any brightness or brightness relationship that annoys, distracts, or reduces visibility.

*Glass load factor*: A number combining glass's solar heat transmission and its heat conduction. Used for cooling load calculations.

*Glazing*: Glass installation. Pertaining to glass assemblies or windows

*Glazing Compound*: A flexible, putty-like material used to seal glass in its sash or frame.

*Grade*: The pitch of a slope such as a roof or a hill.

*Grantee*: The individual or organization that receives a grant.

*Gravity furnace*: A central heating system that uses natural gravity to distribute heat throughout the dwelling unit as opposed to forced circulation, pumps, or circulation blowers.

*Ground fault circuit interrupter (GFI or GFCI)*: An electrical connection device that breaks a circuit if a short occurs. These are required for all exterior use of electrical equipment, or when an electrical outlet is located near a water source.

*Ground-moisture barrier*: Most crawl spaces require ground-moisture barriers to prevent the ground from being a major cause of moisture problems. The ground under a building is the

most potent source of moisture in many buildings, especially those built on crawl spaces.

*Gusset:* A metal or wood plate added to the surface of a joint to strengthen the connection.

*Gypsum board:* A common interior sheeting material for walls and ceilings made of gypsum rock powder packaged between two sheets of heavy building paper. Also called drywall, sheet-rock, gyprock, or gypboard.

*Habitable space:* A building space intended for continual human occupancy. Examples include areas used for sleeping, dining, and cooking, but not bathrooms, toilets, hallways, storage areas, closets, or utility rooms. See occupiable space and conditioned space.

*Hallway return or hallway return system:* A type of mobile home air distribution system. The mobile home heating or cooling system receives return air through a central trunk line beneath the hallway.

*Hatch:* A rectangular hole in a horizontal building assembly like a floor or ceiling that allows access

*Hazardous Material:* A particular substance that is considered a danger to the client or crew.

*Head:* Foot pounds of mechanical energy per pound of fluid created by a pump to overcome gravity or friction.

*Head jamb:* Groove at the top of the window that allows the window sashes to slide into place and sit inside the window frame.

*Health and safety (H&S):* Provision included in a 1976 law change for the Weatherization Assistance Program. WAP now considers the health and safety of low-income families, as well as reducing their energy costs.

*Heat:* Molecular movement

*Heat anticipator:* A device in a thermostat that causes the thermostat to turn off before room temperature reaches the thermostat setting, so that the house doesn't overheat from heat remaining in the heater and distribution system after the burner shuts off.

*Heat capacity:* The quantity of heat required to raise the temperature of 1 cubic foot of a material 1 degree F.

*Heat exchanger :* The device in a heating unit that separates the combustion chamber from the distribution medium and transfers heat from the combustion process to the distribution medium.

*Heat gains:* Term used to mean unwanted heat that accumulates in homes, making mechanical cooling desirable or necessary.

*Heat loss:* The amount of heat escaping through the building shell as measured for a specific period of time (month, year, etc.)

*Heat pump :* A type of heating/cooling unit, usually electric, that uses a refrigerant fluid to heat and cool a space.

*Heat-recovery ventilator:* A central ventilator that transfers heat from exhaust to intake air.

*Heat rise:* The number of degrees of temperature increase that air is heated as it is blown over the heat exchanger. Heat Rise equals supply temperature minus return temperature.

*Heat transmission:* Heat flow through the walls, floor, and ceiling of a building, not including air leakage.

*Heat transfer coefficient:* See U-factor.

*Heating degree day(s) (HDD):* See: Degree days

*Heating Load:* The maximum rate of heat conversion needed by a building during the very coldest weather.

*Heating seasonal performance factor (HSPF):* Rating for heat pumps describing how many Btus they transfer per kilowatt-hour of electricity consumed.

*High-efficiency particulate air (HEPA) vacuum:* HEPA vacuum means a vacuum cleaner which has been designed with a high-efficiency particulate air (HEPA) filter as the last filtration stage.

*High limit:* A bimetal thermostat that turns the heating element of a furnace off if it senses a dangerously high temperature.

*Hinges:* The metal objects that attach your door to the jamb, normally with screws. They can be made from brass, steel, iron, or other metals.

*Hip roof:* A roof with two or more contiguous slopes, joined along a sloping “hip.”

*Home energy index:* The number of BTUs or kWh of energy used by a home, divided by its area of conditioned square feet.

*Home energy rating systems (HERS):* A nationally recognized energy rating program that give builders, mortgage lenders, secondary lending markets, homeowners, sellers, and buyers a precise evaluation of energy losing deficiencies in homes.

*Home heating index:* The number of Btus of energy used by a home divided by its area in square feet, then divided by the number of heating degree days during the time period.

*HOME Program:* A program created under Title II (the Home Investment Partnership Act) of the National Affordable Housing Act of 1990. Provides funds for states to expand the supply of decent and affordable housing for low-income people. This program can be easily coordinated with a state's WAP efforts.

*Home Ventilating Institute (HVI):* A non-profit association of manufacturers of residential ventilating products offering a variety of services including test procedures, certification and verification programs for products, and market support.

*Hot roof:* An unventilated roof with insufficient insulation to prevent snow melting on the roof and the creation of ice dams.

*House as a system:* The concept that many components of a house interact, affecting the home's comfort and performance.

*House depressurization limit:* A selected indoor negative pressure; expressed in Pascals, immediately around vented combustion appliances that use indoor air for combustion supply air.

*House pressure:* The difference in pressure between the indoors and outdoors measured by a manometer.

*House wrap:* A generic term for the modern version of the building's water-resistive barrier.

*HUD:* U.S. Department of Urban Housing and Development

*Humidistat:* An automatic control that switches a fan, humidifier, or dehumidifier on and off to control relative humidity.

*Humidity ratio:* Same as "absolute humidity." The absolute amount of air's humidity measured in pounds or grains of water vapor per pound of dry air.

*HVAC:* Heating, Ventilation, and Air-Conditioning System. All components of the appliances used to condition interior air of a building.

*Hydronic system:* A heating system that uses hot water or steam as the heat-transfer fluid. Commonly called a hot-water heating system.

*Hygrometer:* A tool for measuring relative humidity. A psychrometer, which uses two thermometers, one with a dry bulb and one with a wet bulb, is a simple hygrometer.

*IAQ:* Indoor Air Quality. The quality of indoor air relative to its acceptability for healthful human habitation.

*I-beam:* A rolled or extruded metal beam having a cross section resembling an I.

*IC rated:* Insulation Contact rating for light fixtures. IC housings may be in direct contact with fibrous insulation.

*Ice dam:* Ice that forms at the roof eaves during differential freezing and thawing.

*IECC:* International Energy Conservation Code

*Ignition barrier:* A material installed to prevent another material, often plastic foam, from catching fire.

*Illumination:* The light level measured on a horizontal plane in Foot Candles

*Inaccessible cavity:* An area that is too confined to enter and/or maneuver in by an average installer/technician.

*Incandescent light:* The common light bulb found in residential lamps and light fixtures and known for its inefficiency.

*Inches of Water Column (IWC) :* A non-metric unit of pressure difference. One IWC is equal to about 0.004 Pascals.

*Incidental repairs:* Incidental Repairs are those repairs necessary for the effective performance or preservation of weatherization materials. When a repair activity is a component of an energy efficiency measure that is being installed then the installation and materials are part of the efficiency measure and are classified as incidental repair. Such repairs include, but are not limited to, repairing (or replacement if repair costs exceeds 75% of new installation) windows and doors which could not otherwise be caulked or weather-stripped and providing protective materials, such as paint, used to seal materials installed under this program. Roof repair, knob and tube removal (including the installation of replacement wiring) for protection of and safety of insulation measures, minor electrical repairs (installing miscellaneous wiring, junction boxes and covers to ensure connections meet code), electrical upgrades to handle extra load for HVAC replacement, all of these meet the definition of incidental repair and are allowed as such. The cost of incidental repairs must be included in the cost of the package of measures.

*Indirect leakage:* When air leaks into the home at one point, and out at a different opening. Indirect leakage is more difficult to find, and is associated with interior bypasses or chaseways of a home's interstitial cavities.

*Indoor air quality (IAQ):* The quality of indoor air relative to its acceptability for healthful human habitation.

*Induced draft* : A vent system or combustion appliance for which a fan, installed at or very near the termination point of the appliance or the vent pipe, moves the combustion gases.

*Infiltration*: Infiltration refers to the movement of air into a building through cracks and penetrations in the building envelope.

*Infrared* : Pertaining to heat rays emitted by the sun or warm objects on earth.

*Infrared camera* : A special camera that “sees” temperature differences on surfaces, allowing the user to determine if a building assembly is insulated properly. This instrument is also useful for detecting air leakage if used with a blower door.

*Infrared thermography*: The science of using infrared imaging to detect radiant energy or heat loss characteristics of a building.

*Input rating*: The measured or assumed rate at which an energy-using device consumes electricity or fossil fuel.

*Insolation*: The amount of solar radiation striking a surface.

*Inspector*: A weatherization worker responsible for quality control or quality assurance by making final inspections and in-progress inspections.

*Inspection gap*: A gap in foundation insulation left for the purpose of inspecting for insect infestation.

*Insulated flex duct*: A round duct composed of two flexible plastic tubes with tubular insulation between the two.

*Insulated glass*: Two or more glass panes spaced apart and sealed in a factory.

*Insulation*: A material used to resist heat transmission.

*Insulation dam*: A material that prevents fibrous insulation from flowing into an area where it isn't necessary or wanted.

*Insulation restrainer*: A flexible material, such as netting or fabric, use to hold blown fibrous insulation in place.

*Insulation shield:* A fire-barrier erected around a heat producing device to prevent insulation from covering or contacting the heat-producing device.

*Insulated glass unit (IGU):* Two or more glass panes spaced apart and sealed in a factory.

*Intentionally conditioned:* Conditioned by design and fitted with radiators, registers, or other devices to maintain a comfortable temperature.

*Intermediate zone:* A zone located between the building's conditioned space and the outdoors, like a crawl space or attic.

*Intermittent ignition device (IID) :* A device that lights the pilot light on a gas appliance when the control system calls for heat, thus saving the energy wasted by a standing pilot.

*Internal gains:* The heat generated by bathing, cooking, and operating appliances, that must be removed during the summer to promote comfort.

*International Association of Plumbing and Mechanical Officials (IAPMO):* The industry trade group that develops the Uniform Mechanical Code and the Uniform Plumbing Code.

*International Codes Council (ICC):* An international non-governmental organization for developing building safety, fire prevention, and energy efficiency codes (I-codes).

*International Fuel Gas Code (IFGC):* Code that addresses the design and installation of fuel gas systems and gas-fired appliances through requirements that emphasize performance.

*International Residential Code (IRC)*

*Interstitial Space :* Space between framing and other building components.

*Intrusion :* Air moving into and out of insulation without going through the wall or ceiling assembly.

*Jalousie windows:* A type of window usually associated with homes with two or more panes of glass that pivot on a horizontal axis.

*Jamb:* The side or top piece of a window or door frame.

*Jamb clips or plates:* Structural devices used to fasten a block-frame window to its opening.

*Joist:* A horizontal wood framing member that supports a floor or ceiling.

*Joule:* A unit of energy. One thousand joules equals 1 BTU.

*Kerf:* A slit made by cutting, often with a saw.

*Kilowatt:* A unit of electric power equal to 1000 joules per second or 3412 Btus per hour.

*Kilowatt-hour:* The most commonly used unit for measuring the amount of electricity consumed over time; one kilowatt of electricity supplied for one hour. A unit of electric energy equal to 3600 kilojoules.

*Knee wall:* A short wall, often under three feet in height. The term is derived from the association with the vertical location of the human knee. Knee walls are common in old houses that are typically not a full two stories in height, in which the ceiling on the second floor slopes down on one or more sides. These houses are sometimes referred to as one and a half stories.

*Knee-wall attic:* An triangular attic with short walls, usually under three feet in height.

*Knob-and-tube wiring:* Early standardized method for electrical wiring in homes consisting of insulated copper conductors supported by porcelain knobs and tubes (when passing through framing members).

*Lamp:* A light bulb.

*Latent heat:* The amount of heat energy required to change the state of a substance from a solid to a liquid, or from a liquid to a gas.

*Lath* : A support for plaster, consisting of thin strips of wood, metal mesh, or gypsum board.

*Lawrence Berkeley National Laboratory (LBNL)*: Member of the national laboratory system supported by DOE through its Office of Science. It conducts unclassified research across a wide range of scientific disciplines.

*Lead-Safe Work Practices (LSW)*: Work practices required by DOE for pre-1978 homes when the weatherization work will disturb more than 2 square feet of painted surface in an interior room, 10 percent of a small component such as a baseboard or door casing, and/or when the work will disturb more than twenty square feet of painted exterior surface.

*Leadership in Energy and Environmental Design (LEED)*: A building certification system developed by the U.S. Green Building Council.

*Leakage ratio*: Measurement of total square inches of air leakage area per 100 feet of building envelope surface area.

*Light quality* : The relative presence or absence of glare and brightness contrast. Good light quality has no glare and low brightness contrast.

*Local agency*: Also referred to as the subgrantee, contractor, service delivery network member, or local service provider, a local agency is a nonprofit organization or unit of local government responsible for providing WAP services in a specified political subdivision.

*Loose fill insulation*: Fibrous insulation in small fibers that are blown into a building assembly using a blowing machine.

*Low-flow rings*: Part of a blower door that forces air past the sensors fast enough so that a reliable reading can be obtained.

*Low-E*: Short for “low emissivity”, which means the characteristic of a metallic glass coating to resist the flow of radiant heat.

*Low expanding foam*: Liquid-applied form that expands 20-30 times its liquid size.

*Low water cutoff:* A float-operated control for turning the burner off if a steam boiler is low on water.

*Lumen:* A unit of light output from a lamp.

*Luminaire:* A light fixture.

*Main panel box:* The electric service box containing a main switch, and the fuses or circuit breakers located inside the home.

*Make-up air:* Air supplied to a space to replace exhausted air.

*Manifold :* A tube with one inlet and multiple outlets, or multiple inlets and one outlet.

*Manometer:* A differential gauge used for measuring pressure.

*Manual J:* Load calculation that allows the user to properly size HVAC systems for single-family-detached homes, small multi-unit structures, condominiums, town houses, and manufactured homes.

*Manufactured home:* A home or a “double-wide” structure. Transportable homes that are quick and cheap to build. Another name for home.

*Manufactured Home Energy Audit (MHEA):* A tool to predict manufactured home energy consumption and recommend weatherization retrofit measures, accounting for local weather conditions, retrofit measure costs, and fuel costs.

*Mastic:* A thick creamy substance used to seal seams and cracks in building materials.

*Masonry:* Stone, brick, or concrete block construction.

*Materials safety data sheet (MSDS):* A sheet containing data regarding the properties of a particular substance, intended to provide workers with procedures for handling or working with that substance in a safe manner, including information such as physical data, toxicity, health effects, first aid, storage, disposal, and protective equipment.

*Mean radiant temperature (MRT):* The area-weighted mean temperature of all the objects in an environment.

*Mechanical draft:* A combustion appliance with induced draft of forced draft.

*Meeting rails:* The rail of each sash that meets a rail of the other when the window is closed.

*Membrane:* A barrier that separates two environments. Membranes may be permeable to the flow of air, water, and other fluids or particles.

*Microclimate:* A very localized climatic area, usually of a small site or habitat.

*Mildew:* Fungi that colonize organic building materials.

*Mitigate:* To make less severe or to mollify.

*Mobile home belly:* Part of a home that contains the insulation, duct system, and plumbing. It is enclosed by the sub- and finished floor, with a rodent barrier underneath.

*Mobile Home Energy Audit (MHEA):* A software tool that predicts manufactured home energy consumption and recommends weatherization retrofit measures.

*Moisture meter:* An instrument for measuring the percentage of water in a substance.

*Mold:* A growth of minute fungi forming on vegetable or animal matter and associated with decay or dampness.

*Monitor:* The process through which a person, frequently a representative of a State or Federal agency, visits completed units to ensure that weatherization funding is spent appropriately.

*Monitoring:* The process through which a person, frequently a representative of a State or Federal agency, visits completed units to ensure that weatherization funding is spent appropriately.

*Mortar*: A mixture of sand, water, and cement used to bond bricks, stones, or blocks together.

*Mortise*: A recessed area cut into the wood framing member where a hinge or wood tongue fits.

*MSDS*: Materials Safety Data Sheet.

*Mud sill*: A wood component attached to the foundation of a building that creates a means of attaching various components of the framing to the foundation.

*Mullion*: Vertical framing members that don't run the full length of the door.

*Multifamily (MF) housing*: A building with five or more residential units.

*Mushroom vent*: A vent that has at the top of a vertical shaft a broad rounded cap that can be screwed down to close it.

*N-factor*: A factor used to convert blower-door measurements taken at CFM50 to CFM<sub>natural</sub>, the amount of air leakage that occurs naturally. N ranges from 9 to 35.

*Nail fin*: Semi-flexible strips of metal or plastic used to attach a window frame to a rough opening.

*Nailing Flange*: An extrusion attached to the window and used to attach the unit to the opening.

*National Association for State Community Services Programs (NASCSPP)* : Assists States in responding to poverty issues. NASCSPP members are state administrators of the Community Services Block Grant (CSBG) and U.S. Department of Energy's Weatherization Assistance Program (DOE/WAP).

*National Bureau of Standards (NBS)*: Renamed by the Department of Commerce as the National Institute of Standards and Technology (NIST).

*National Electric Code (NEC)*: A safety code regulating the electricity use. The NEC is a product of the National Fire Protection Association.

*National Energy Audit Tool (NEAT)*: Created by Oak Ridge National Laboratories as a DOE approved audit qualifying for the 40% materials waiver. It is a computerized auditing tool for prioritizing energy conservation measures for houses.

*National Fenestration Rating Council (NFRC)*: NFRC is a non-profit organization that administers the only uniform, independent rating and labeling system for the energy performance of windows, doors, skylights, and attachment products.

*National Fire Protection Association (NFPA)*: Creates and maintains minimum standards and requirements for fire prevention, training, and equipment, developing and publishing codes and standards such as the NFPA 70, the National Electric Code, and NFPA 54, the National Fuel Gas Code.

*National Institute for Occupational Safety and Health (NIOSH)*: A federal agency responsible for conducting research and making recommendations for the prevention of work-related injury and illness to help ensure safe and healthful working conditions.

*Natural draft* : Draft that relies on buoyancy heated gases to move combustion gases up a chimney.

*Natural gas*: A hydrocarbon gas that is usually obtained from underground sources, often in association with petroleum and coal deposits.

*Natural Ventilation*: Ventilation using only natural air movement without fans or other mechanical devices.

*Net Free Vent Area (NFVA)*: The area of a vent after that area has been adjusted for insect screen, louvers, and weather covering. The free area is always less than the actual area.

*Netting*: An open weave fabric or plastic mesh that supports fibrous insulation.

*NFPA*: National Fire Protection Association.

*NFPA 211*: National Fire Protection Association's Standard for Chimneys, Fireplaces, Vents, and Solid-Fuel-Burning Appli-

ances includes installation procedures for vents and chimneys that serve wood-burning stoves and fireplaces.

*NFPA 31*: National Fire Protection Association's Standard for the Implementation of Oil-Burning Equipment, dictating that chimneys must be at least 2 feet higher than any portion of the building within 10 feet.

*NFPA 54*: National Fire Protection Association's National Fuel Gas Code.

*Noncombustible material*: Materials that pass the test procedure for defining noncombustibility of elementary materials set forth in ASTM E 136.

*Nonconditioned space*: A space that isn't heated or cooled.

*Non-expanding foam*: Spray foam that does not expand. Used in window and door jambs, and other constricted spaces where expanding foam may distort building materials and negatively impact operation.

*Non-flame retention head burner*: An older type of burner than the "flame retention head burner," requiring more excess air, which burns less efficiently.

*Nozzle*: An orifice for spraying a liquid like fuel oil.

*O<sub>2</sub>*: Oxygen

*Oak Ridge National Laboratory (ORNL)*: Laboratory where the Mobile Home Energy Audit (MHEA) software was developed.

*Occupants*: People of any age living in a dwelling. Animals are not defined as occupants.

*Occupational Safety and Health Administration (OSHA)* : An agency of the United States Department of Labor, with a mission to prevent work-related injuries, illnesses, and occupational fatality by issuing and enforcing standards for workplace safety and health.

*Off-gas*: Off-gassing is the evaporation of volatile chemicals in non-metallic materials at normal atmospheric pressure. This

means that building materials can release chemicals into the air through evaporation.

*Ohm:* A unit of measure of electrical resistance. One volt can produce a current of one ampere through a resistance of one ohm.

*One-part foam:* One-part foam comes in spray cans (e.g., Great Stuff) and spray guns with screw-on cans. One-part foam is best suited for filling gaps and holes less than  $\frac{3}{4}$ ".

*Open-combustion appliance:* An appliance that does not have a sealed combustion chamber and may take its combustion air from the surrounding room.

*Open-Combustion Heater:* A heating device that takes its combustion air from the surrounding room air.

*Orifice:* A hole in a gas pipe or nozzle fitting where gas or fuel oil exits to be mixed with air before combustion occurs in the heating chamber. The size of the orifice will help determine the flow rate.

*Oscillating Fan:* A fan, usually portable, that moves back and forth as it operates, changing the direction of the air movement.

*OSHA :* Occupational Safety and Health Administration

*Output capacity:* The useful heat in BTUH that a heating unit produces after accounting for waste.

*Over-fired:* In reference to furnaces; when too much fuel is being burned, as a response to over-sized fuel nozzles, over-pressurization from the pump, etc.

*Oxidation:* The combination of a substance with oxygen.

*Oxygen content:* A measure of the amount of oxygen in the air.

*Oxygen-depletion sensor:* A safety device on a heating unit that shuts off the fuel supply to the combustion chamber when oxygen is depleted.

*Packaged air conditioner:* An air conditioner that contains the compressor, evaporator, and condenser in a single cabinet.

*Packaged terminal air conditioner (PTAC):* A self-contained space heating and/or cooling system, usually powered with electricity, commonly found in hotels and apartment buildings.

*Packaged terminal heat pump (PTHP):* A self-contained space heating and/or cooling system, frequently installed in a sleeve through the exterior wall of a building, using heat pump technology.

*Panel:* Parts of a door between rails and stiles or mullions.

*Parapet walls:* A low wall at the edge of a platform, roof or bridge,

*Parts per million (ppm):* The unit commonly used to represent the degree of pollutant concentration, where the concentrations are small.

*Pascal (Pa):* A unit of measurement of air pressure. One column inch of water equals 247 pascals. Atmospheric pressure (29.92 inches of mercury) is equivalent to 102,000 PA.  $2.5\text{Pa} = 0.01$  inches of water column.

*Passive attic venting:* Takes advantage of the natural buoyancy of air by providing inlets and outlets low and high on the roof. Warm air rises through higher vents and cooler air is drawn through eave vents as the warm air escapes.

*Payback period:* The number of years that an investment in energy conservation will take to repay its cost through energy savings.

*Performance standard:* Specification of the conditions that will exist when a satisfactory job is performed.

*Perimeter basement drain:* An indoor drain cut into the floor and around the perimeter of a basement or crawl space to intercept and remove water from the building interior.

*Perlite:* A heat-expanded mineral used for insulation.

*Perm:* A measurement of how much water vapor a material transmits per hour. Specifically: diffusion of 1 grain of water vapor per hour, per square foot, per inch of mercury pressure.

*Permeance rating:* Number that quantifies the rate of vapor diffusion through a material.

*Personal fall arrest system:* A system used to arrest an employee in a fall from a working level. It consists of an anchor point, connectors, a body belt or body harness and may include a lanyard, deceleration device, lifeline, or combinations of these.

*Personal protective equipment (PPE):* Accessories such as safety glasses, ear plugs, and respirators worn to protect individuals from workplace hazards.

*Phase change:* The act of changing from one state of matter to another, for example: solid to liquid or liquid to gas.

*Photoresistor:* Electronic sensing device used to sense flame, daylight, artificial light.

*Photovoltaic (PV):* A solid-state electrical device that converts light directly into direct current electricity.

*PIC:* Polyisocyanurate foam insulation.

*Picture window:* Picture windows have no operable sashes and are used primarily for aesthetics.

*Pier and beam foundation:* Housing base that uses a concrete footing and pier to support wood beams and floor joists.

*Plaster:* A plastic mixture of sand, lime, and Portland cement spread over wood or metal lath to form the interior surfaces of walls and ceilings.

*Plastic tie band:* A ratcheting plastic band used to clamp flexible ducts to metal ducts or to attach insulation to round metal ducts.

*Plate:* A framing member installed horizontally to which the vertical studs in a wall frame are attached.

*Platform framing:* A system of framing a building in which floor joists of each story rest on the top plates of the story below or on the foundation sill for the first story, and the bearing walls and partitions rest on the subfloor of each story.

*Plenum:* The piece of ductwork that connects the air handler to the main ducts.

*Plumb:* Absolutely vertical at a right angle to the earth's surface.

*Plywood:* Laminated wood sheeting with layers cross-grained to each other.

*Pocket doors:* Doors that slide into a wall cavity and are typically very leaky.

*Polyethylene:* A plastic made by the polymerization of ethylene, used in making translucent, lightweight, and tough plastics, films, insulations, vapor retarders, air barriers, etc.

*Polyisocyanurate (PIC):* A plastic foam insulation sold in sheets, similar in composition to polyurethane.

*Polystyrene insulation:* A rigid plastic foam insulation, usually white, pink, green, or blue in color.

*Polyurethane:* A versatile plastic foam insulation, usually yellow in color.

*Porosity:* Measure of the void spaces in a material, expressed as either a fraction or a percentage of the total volume of material.

*Positive-pressure, supplied-air respirator :* Has its own air compressor to supply fresh air to the worker, and can use a mask or hood.

*Potential Energy:* Energy in a stored form, like fuel oil, coal, wood, or water stored at a high elevation

*Potentiometer:* A variable resistor used as a controller or sensor.

*Pounds per square inch (psi):* Units of measure for the pressure a gas or liquid exerts on the walls of its container.

*Power burner:* A burner that moves combustion air at a pressure greater than atmospheric pressure. Most oil-fired burners are power burners. Gas burners used to replace oil burners are usually power burners.

*Power vent:* A combustion appliance that uses fan-powered draft for venting combustion byproducts.

*Prescriptive standard:* Specifies in detail the requirements and procedures to be followed rather than specifying a performance outcome.

*Present value (PV):* The amount that a future sum of money is worth today given a specified rate of return.

*Pressure:* A force encouraging movement of a fluid by virtue of a difference in some condition between two areas.

*Pressure balancing:* To equalize house or duct pressure by adjusting air flow in supply and return ducts. Used on dwellings with forced air heating systems.

*Pressure boundary:* The surface that separates inside from outside, in relation to conditioned space within the home. Also called air boundary or air barrier.

*Pressure diagnostics:* The practice of measuring pressures and flows in buildings to control air leakage, and also to ensure adequate heating and cooling air flows and ventilation.

*Pressure-equalized rain screen:* A space between the water-resistive barrier and the cladding in an exterior wall that is connected to the outdoors so that there is no pressure difference between the space and the outdoors. This assembly gives superior resistance to wind-driven rain where such weather is common.

*Pressure pan:* A device used to block a duct register while measuring the static pressure behind it.

*Pressure-pan testing:* One method for determining duct leakage. Uses a pressure pan, manometer, and a blower door to quantify pressure differences and verify improvements after duct sealing.

*Pressuretrol:* A control that turns a steam boiler's burner on and off as steam pressure changes.

*Pressure-reducing valve:* An adjustable valve that reduces the building's water pressure to provide water to hydronic and steam heating systems.

*Pressure-and-temperature relief valve:* A safety component required on a boiler and water heater, designed to relieve excess pressure or temperature in the tank.

*Primary air:* Air mixed with fuel before combustion.

*Prime window:* The main window installed on the outside wall consisting of fixed or moveable lights that slide on permanently fixed tracks (not to be confused with a storm window).

*Priority list:* The list or ranking of installation measures developed by a program to produce the most cost effective energy savings results based on a savings to investment ratio calculation.

*Propane (liquefied petroleum gas, or LPG):* A colorless, flammable gas occurring in petroleum and natural gas.

*Psychrometer:* An instrument for determining atmospheric humidity by the reading of two thermometers, the bulb of one being kept moist and ventilated.

*Psychrometric chart:* A chart presenting the physical and thermal properties of moist air in graphical form. Used in conjunction with a psychrometer to determine relative humidity, dew point, and other characteristics.

*Psychrometrics:* The study of the relationship between air, water vapor, and heat.

*Pull-down stairs:* Staircase that folds up into the attic until pulled down for use.

*Pulley seals:* A component of a window sash counterweight system that helps control the movement of the lower sash.

*Purlins*: Framing members that sit on top of rafters, perpendicular to them, designed to spread support to roofing materials.

*Quality assurance*: The systematic evaluation of a product or service to ensure quality standards are being met.

*Quality control (QC)*: Review of the final work product to ensure that it was correctly done.

*R-Value*: A measurement of thermal resistance for materials and related surfaces.

*Radiant barrier*: A foil sheet or coating designed to reflect heat flows. Radiant barriers are not mass insulating materials.

*Radiant temperature*: The surface temperature of objects in a home, like walls, ceiling, floor, and furniture.

*Radiation*: Heat energy that is transferred by electromagnetic energy or infrared light, from one object to another. Radiant heat can travel through a vacuum and other transparent materials.

*Radon*: A radioactive gas that decomposes into radioactive particles.

*Rafter*: A roof beam that follows the roof's slope.

*Rain screen*: The combination of a water-resistive barrier and a space, used to keep wall assemblies dry in climates with high rainfall.

*Rater*: A person who performs energy ratings. Same as energy rater.

*Recovery efficiency*: A water heater's efficiency at actually heating water to capacity level without regard to standby or distribution losses.

*Reflectance*: The ratio of lamination or radiant heat reflected from a given surface to the total light falling on it. Also called reflectivity.

*Reflective glass:* Glass that has a mirror-like coating on its exterior surface to reflect solar heat. The solar heat gain coefficient of reflective glass ranges from 0.10 to 0.40.

*Refrigerant:* Any of various liquids that vaporize at a low temperature, used in mechanical refrigeration.

*Refrigerant:* A special fluid used in air conditioners and heat pumps that heats air when it condenses from a gas to a liquid and cools air when it evaporates from a liquid to a gas.

*Register:* The grille cover over a duct outlet for warm air distribution or cold air return and sometimes control the flow.

*Relamping:* The replacement of an existing, standard light bulbs with lower wattage energy efficient bulbs like compact fluorescent lamps.

*Relative humidity:* The percent of moisture absorbed in the air compared to the maximum amount possible. For instance, air that is completely saturated has 100% relative humidity.

*Relay:* An automatic, electrically-operated switch.

*Reset controller:* Adjusts fluid temperature or pressure in a central heating system according to outdoor air temperature.

*Resistance:* The property of a material resisting the flow of electrical energy or heat energy.

*Retrofit:* An energy conservation measure applied to an existing building or the action of improving the thermal performance or maintenance of a building.

*Return air:* Air circulating back to the furnace or central air conditioning unit from the house, to be heated or cooled and supplied back to the living area.

*Return plenum:* Used in reference to mobile home furnaces: Part of the belly return system where air is drawn back to the furnace through a louver in the floor of the furnace closet.

*Revolutions per minute:* Number of times the crankshaft of an engine, or the shaft of a motor, rotates in one minute. RPM is a function of the design of the equipment and the power supply.

*Reweatherized unit:* Any unit that received weatherization services prior to September 30, 1994 and has received additional services under subsequent grants or allowed by current DOE regulations.

*Ridge venting:* Ridge venting is a continuous vent (or two strips of vents) along the roof ridge. Usually combined with continuous soffit or eave vents as part of an overall attic ventilation system.

*Rim joist:* The outermost joist around the perimeter of the floor framing. Also known as band joist.

*Riser:* Transition piece that connects the main duct to the floor and is often vulnerable to failure. See also duct boot.

*Rodent barrier:* Guard used to keep rodents from entering a mobile home through the belly.

*Roof jack:* Chimney assembly that penetrates the roof and includes the flashing and chimney cap assemblies.

*Roof vent:* A louver or small dome mounted on a roof (often near the ridge) to allow the passage of air through the attic.

*Room air conditioner:* An air conditioning unit installed through a wall or window, which cools the room by removing heat and releasing it outdoors.

*Room heater:* A heater located within a room and used to heat that room.

*Rough opening:* The framed opening in a wall into which a door or window is installed.

*Safety glass:* Glass that is toughened or laminated so that it is less likely to splinter when broken.

*Sash :* A movable or stationary part of a window that frames a piece of glass.

*Saturation:* Describing vapor and liquid at the phase-change point. The condition in which the air cannot hold any more moisture, as a function of temperature and vapor pressure.

*Savings-to-investment ratio (SIR):* SIR is computed over the lifetimes of the retrofit measures installed and expressed in terms of the net present value of the retail cost of the dwelling's fuel. SIRs of greater than one are counted as cost effective under this DOE WAP method of determining cost-effectiveness.

*Scale:* Dissolved minerals that precipitate inside boilers and storage tanks.

*Sealed combustion:* A heater that draws air for combustion from outdoors and has a sealed exhaust system.

*Sealed combustion heater:* A heater that draws air for combustion from outdoors and has a sealed exhaust system. Also called a direct-vent appliance.

*Seasonal efficiency:* Refers to the overall efficiency of the central heating system including on and off cycle fuel utilization and heat loss. The calculation of these factors is represented in the Annual Fuel Utilization Efficiency (AFUE) rating for the appliance. Distribution system loss is not factored into the AFUE.

*Seasonal energy efficiency ratio (SEER):* A measurement of energy efficiency for central air conditioners. The SEER is computed by dividing cooling capacity, measured in BTUh, by the Watts (see also Energy Efficiency Rating).

*Seasonal heating performance factor (SHPF):* Ratio of useful heat output of a heat pump to the electricity input, averaged over a heating season.

*Secondary air:* Combustion air surrounding a flame.

*Sensible heat:* The heat required to change the temperature of a material.

*Sequencer:* A bimetal switch that turns on the elements of an electric furnace in sequence.

*Service equipment:* The electric meter and main switch, usually located outside the building.

*Service wires:* The wires coming from the utility transformer to the service equipment of the building.

*Set-point:* The heat absorbed or evolved by a substance during a change of temperature that is not accompanied by a change of state.

*Shading coefficient (SC):* A decimal describing how much solar energy is transmitted through a window opening compared to clear single glass having an SC of 1.0. For example, reflective glass has an SC of 0.20 to 0.45.

*Sheathing:* Structural sheathing, attached on top of the framing, underneath the siding and roofing of a building. Any building material used for covering a building surface.

*Sheet Metal and Air Conditioning Contractors' National Association (SMACNA):* An international association of contractors who specialize in heating, ventilation and air conditioning.

*Sheeting:* Common term for any building material used for covering a building surface.

*Sheetrock:* See drywall.

*Shell:* The building's exterior envelope including walls, floor, and roof.

*Shingle:* A modular roofing material, usually asphalt, that is installed in overlapping rows to cover the entire roof.

*Short circuit:* A dangerous malfunction in an electrical circuit where electricity is flowing through conductors and into the ground without going through an electric load, like a light or motor.

*Side jamb:* Grooves in window that allow the window sashes to slide up and down or side to side.

*Sill:* The bottom of a window or door frame.

*Sill Box:* The outer area of the floor bound by the rim joist, floor joist, sill plate, and floor.

*Sill Pan:* A flashing device that sits on a rough-framed window sill to prevent water infiltration should water infiltrate the cladding and sealant around the finished window.

*Single-family (SF) home:* A free-standing residential building

*SIR:* See savings-to-investment ratio.

*Skirting:* A non-structural screening built around the exterior of an open crawl space to exclude animals, wind and sunlight. Also has aesthetic value.

*Slab-on-grade foundation:* Housing base that uses concrete slabs formed from molds set in the ground. Concrete is poured into the mold all at one time, with no space left between the ground and the home.

*Slider window:* A slider window is essentially a double-hung window turned on its side so the sashes move horizontally.

*Sling psychrometer:* A device holding two thermometers that is slung through the air to measure relative humidity.

*Slope :* The roof section of an attic with the roof and ceiling surfaces attached to the rafters.

*Smoke-developed index:* The level of smoke that a material produces when burning in a fire test compared to red oak, which has a rating of 100.

*Smoke tester:* Device to test the amount of smoke being produced by an oil burning furnace. High smoke means the fuel-to-air ratio is off, and combustion is less efficient than it should be.

*Soffit:* The underside of a roof overhang or a small lowered ceiling, as above cabinets or a bathtub.

*Solar absorption:* Solar absorption is that portion of total solar energy neither transmitted nor reflected.

*Solar exposure:* The amount of solar energy falling on a horizontal surface.

*Solar control film:* Plastic films, coated with a metallic reflective surface, that are adhered to window glass to reflect solar heat gain. See also window film.

*Solar gain:* Heat from the sun that is absorbed by a building's materials and contributes to the heating and cooling requirements of the dwelling.

*Solar heat:* Radiant energy from the sun with wavelengths between 0.7 and 1 micrometers.

*Solar Heat Gain Coefficient (SHGC):* The ratio of solar heat gain through a window to incident solar heat, including both transmitted heat and absorbed/radiated heat.

*Solar Heat Gain Factor (SHGF):* Solar heat gain amount on a surface with a particular angle and orientation expressed in Btus per square foot per hour.

*Solar reflectance:* The ratio of reflected to incident light. See also albedo.

*Solar Screen:* A framed screen designed to absorb solar heat before it transmits through window glass that is installed on the window's exterior.

*Solar transmittance:* The percent of total solar energy transmitted by a material.

*Solar water heater:* System in which water is heated by solar radiation.

*Solenoid:* A magnetic device that moves a switch or valve stem.

*Sone level:* An international unit used to measure sound levels. One Sone is equivalent to the sound of a quiet refrigerator in a quiet kitchen.

*Space conditioning:* Heating, cooling, or ventilation of an indoor space.

*Space heating:* Heating the living spaces of the home with a room heater or central heating system.

*Spauling:* White, chalk-like coating on concrete caused by water picking up salts as it migrates through concrete, then leaving the salts on the surface when it evaporates. Also spelled, “spalling.”

*Span:* Horizontal distance between supports.

*Specific heat:* The ratio of the heat storage capacity of a particular material to the heat storage capacity of water.

*Spillage:* Temporary flow of combustion gases from a dilution device.

*Spline:* A strip of vinyl, rubber, or plastic that, when inserted into a groove, holds a screen or plastic film in place on a frame.

*Split-system air conditioner:* An air conditioner having the condenser and compressor outdoors and the evaporator indoors.

*Spray foam:* Liquid-applied foam that expands forming a rigid foam material with millions of insulating cells.

*Spot source ventilation:* Spot source ventilation includes things like kitchen exhaust fans and bathroom exhaust fans.

*Stack Effect:* The term describes the effect of higher pressure at the top of a structure, lower pressure at the bottom of a structure, and neutral pressure somewhere in between, relative to the ambient (surrounding) air pressure. It is usually the result of different densities of warmer and cooler air (convective airflow).

*Standard Work Specifications:* Voluntary guidelines for quality work for residential energy upgrades. These specifications define the minimum requirements for high-quality installation of energy efficiency measures.

*Standing Loss:* Heat loss from a hot water storage tank through its shell.

*State point:* Air at a particular temperature and humidity occupies a single point on the psychrometric chart called a state point.

*Static pressure:* Measurement of pressure in a fluid filled chamber at a specific location. Use of a static pressure probe allows measuring pressures in forced air duct systems without regard to pressure changes due to movement of air in the system.

*Steady state efficiency (SSE):* The measurement of heating efficiency measured by a combustion analyzer.

*Steel chassis:* Supporting frame for the mobile home structure exclusive of the body or housing.

*Steam trap:* An automatic valve that closes to trap steam in a radiator until it condenses.

*Steam vent:* A bimetal-operated air vent that allows air to leave steam piping and radiators, but closes when steam strikes the surface.

*Stiles:* Full-length vertical framing members of a door.

*Stop:* A thin, trim board for windows and doors to close against or slide against.

*Strapping:* Similar to furring. A nailer applied to a building surface.

*Strike plate:* The metal plate attached to the door jamb that the latch inserts into upon closing.

*Strip heat:* Heat provided by an electric-resistance heating cable or element as in a heat pump for auxiliary heat or emergency heat.

*Stucco:* Plaster applied to the building's exterior walls.

*Stud:* A vertical wood or metal framing member used to build a wall.

*Subfloor:* The sheathing over the floor joists and under the floor covering.

*Subcooling:* The number of degrees Fahrenheit that a condenser and nearby piping cools the liquid refrigerant below its saturation temperature.

*Subgrantee:* A person or agency that is awarded a sub-grant and is accountable to the grantee for the utilization of resources.

*Substrate:* A layer of material to which another layer is applied.

*Sulfur dioxide (SO<sub>2</sub>):* A colorless, nonflammable, water-soluble gas.

*Sump pump:* A pump that removes water from underneath a house or building.

*Superheat:* The number of degrees Fahrenheit that an evaporator and nearby piping heats gaseous refrigerant above its saturation temperature.

*Supply air:* Air that has been heated or cooled and is moved through the ducts and to the supply registers of a home.

*Suspended ceiling:* Modular ceiling panels supported by a hanging frame.

*Tankless water heater:* Rather than storing hot water, a tankless unit heats water as it is being used.

*Task lighting:* Lighting provided at the area where a visual task is performed.

*Temperature:* A measure of the heat present.

*Temperature and pressure relief valve:* A safety component required on a boiler and water heater, designed to relieve excess pressure buildup in the tank.

*Temperature rise:* The number of degrees of temperature that the heating fluid increases as it moves through the heat exchanger.

*Therm:* A unit of energy equal to 100,000 Btus or 29.3 kilowatt-hours.

*Thermal barrier:* A material that protects materials behind it from reaching 250° F during a fire. Drywall is a 15-minute thermal barrier.

*Thermal break:* A relatively low heat/cold conductive material separating two highly conductive materials, installed to reduce heat flow through the assembly.

*Thermal bridging:* Rapid heat conduction resulting from direct contact between very thermally conductive materials like metal and glass.

*Thermal boundary:* A line or plane where insulation and air barrier(s) exist in order to resist thermal transmission and air leakage through or within a building shell.

*Thermal Bypass:* A large air leak that carries allows air to flow around insulation.

*Thermal Conductance:* A material's ability to conduct heat, which uses the letter **k**.

*Thermal emittance:* The ability of a material to release absorbed heat.

*Thermal enclosure/envelope:* The boundaries of a dwelling that surround the conditioned space.

*Thermal mass:* A solid or liquid material that will absorb and store warmth and coolness until it is needed.

*Thermal resistance :* R-value; a measurement expressing the ability to resist heat flow.

*Thermal transmittance:* Expressed as U-factor, thermal transmittance is heat flow by conduction, convection, and radiation through a non-uniform layered building component like a wall.

*Thermistor:* An electronic resistor used to sense temperature.

*Thermocouple:* A bimetal-junction electric generator used to keep the safety valve of an automatic gas valve open.

*Thermodynamics:* The science of heat.

*Thermostat:* A device used to control a heating or cooling system to maintain a set temperature.

*Threshold:* The raised part of a floor underneath a door that acts as an air and dust seal.

*Total solar energy rejected:* The percent of incident solar energy rejected by a glazing system equals solar reflectance plus the part of solar absorption that is reradiated outward.

*Tracer gas:* A harmless gas used to measure air leakage in a building.

*Training and technical assistance (T&TA):* Program structure that ensures that all work in the field meets State standards. This ensures that there is a feedback loop and accountability within the program.

*Transformer:* A double coil of wire that increases or decreases voltage from a primary circuit to a secondary circuit.

*Trim:* Decorative wood that covers cracks around window and door openings and at the corners where walls meet floors and ceilings. Sometimes called molding.

*Truss:* A braced framework usually in the shape of a triangle to form and support a roof.

*Tuck-under garage:* Architectural style in which the garage is situated underneath a room of the house.

*Turbine vent:* Vent usually mounted on the roof of a building. The vent has at its head a globular, vaned rotor that is rotated by wind, conveying air through a duct to and from a chamber below.

*Two-part foam:* A triple-expanding foam appropriate for larger and more numerous air leaks, and for insulating crawl space walls and other big jobs. Two-part foam comes in portable two-tank kits and truck-mounted rigs.

*Type IC Recessed Electrical Fixture :* An electrical fixture that is rated to be in direct contact with fibrous insulation.

*Type-S fuses:* Fuse type with a rejection base that prevents tampering as well as mismatching.

*U-factor*: The total heat transmission in BTUs per square feet per hour per degree Fahrenheit between the indoor and the outdoors.

*U.S. Department of Agriculture (USDA)*: United States government agency responsible for agricultural programs, USDA also administers some low-income housing programs.

*U.S. Department of Energy (DOE)*: United States government agency whose mission is to advance energy technology and promote related innovation in the United States.

*U.S. Department of Housing and Urban Development (HUD)*: United States government agency charged with rule-making and enforcement of the HUD Code.

*U.S. Environmental Protection Agency (EPA)*: The mission of the U.S. Environmental Protection Agency is to protect human health and the environment.

*U-value*: See U-factor. An older term for U-factor.

*Ultraviolet Radiation*: Light radiation having wavelengths beyond the violet end of the visible spectrum; high frequency light waves.

*Unconditioned Crawl Space*: A crawl space without a supply of heat from a forced-air register or other heat emitter.

*Unconditioned space*: An area within the building envelope not intentionally heated.

*Underlayment* : Sheetting installed to provide a smooth, sound base for a finish material.

*Under-fired*: A burner that isn't receiving a sufficient flow rate of fuel.

*Underwriter's Laboratory (UL)*: A private laboratory that tests materials and lists their fire-resistance characteristics.

*Uniform Mechanical Code (UMC)*: A model code developed by the International Association of Plumbing and Mechanical Offi-

cial to govern the installation and inspection of mechanical systems.

*Uniform Plumbing Code (UPC):* A model code developed by the International Association of Plumbing and Mechanical Officials to govern the installation and inspection of plumbing systems.

*Unintentionally conditioned:* A space that is heated or cooled by energy that escapes the heating or cooling system. For example: a cooled attic or heated crawl space, which have no intentional energy delivery or comfort needs.

*Unvented attic:* An attic space without intentional vents to ventilate it.

*Upduct:* An automatic vent, between the conditioned space and the attic, that operates by the pressure created by an evaporative cooler and exhausts room air into the attic. Used when open windows are a security problem.

*Upflow furnace:* A furnace in which the heated air flows upward as it leaves the furnace.

*Upstream:* Toward the source of the flow.

*Vapor barrier:* A material that controls water-vapor diffusion to less than 0.1 perms.

*Vapor diffusion:* The flow of water vapor through a solid material.

*Vapor permeable:* A material with a water vapor permeance or more than 10 perms.

*Vapor pressure:* The ratio of the water vapor in an air mass to a pound of that air. Measured in grains per pound or pounds per pound. Also known as absolute humidity.

*Vapor retarder:* A material that controls water-vapor diffusion to less than 10 perms.

*Vaporize:* To change from a liquid to a gas.

*Vaulted attic/ceiling:* An attic bounded by a sloped ceiling and sloped roof, which is created by a truss and typically has more than 16 inches of space between the ceiling and roof.

*Veiling reflection:* Light reflection from an object or task that obscures details.

*Veneer:* The outer layer of a building component that protects or beautifies the component.

*Vent connector:* The vent pipe carrying combustion gases from the appliance to a vent or chimney.

*Vent chute:* A lightweight plate that directs air from a soffit over attic insulation and along the bottom of the roof deck to ventilate the attic and cool the roof deck. A baffle.

*Vent damper:* An automatic damper powered by heat or electricity that closes the chimney while a heating device is off.

*Vent pipe:* The pipe carrying combustion gases from the appliance to the chimney.

*Vent terminations:* Where a vent leaves the building. Vent terminations must prevent intrusion of moisture, detritus, or pests into the building, and allow safe exhaust of vented gases.

*Vented crawl space:* Crawlspace with grilles or vents installed to allow for passive ventilation beneath the home.

*Venting:* The removal of combustion gases by a chimney or horizontal vent.

*Venting system:* A continuous passageway from a combustion appliance to the outdoors through which combustion gases can safely pass.

*Ventilation:* Refers to the controlled air exchange within a structure such as local ventilation, whole-house ventilation, attic ventilation, and crawl space ventilation.

*Vermiculite:* A heat-expanded mineral used for insulation.

*Visible Transmittance:* The percent of visible light transmitted by a glass assembly.

*Visqueen:* Polyethylene film vapor barrier.

*Volt:* The amount of electromotive force required to push a current of one ampere through a resistance of one ohm.

*Voltage drop:* The loss of voltage in a circuit caused by resistance.

*Volume:* The amount of space occupied by a three-dimensional object or region of space, expressed in cubic units.

*Water-resistive barrier:* Used to prevent water from contacting a building's sheathing and structural components.

*Watt (W):* A unit of measure of electric power at a point in time, as capacity or demand. One Watt of power maintained over time is equal to one joule per second.

*Watt-hour :* One Watt of power extended for one hour. One thousandth of a kilowatt-hour.

*Watt meter:* An instrument for measuring, in watts, the electric power in a circuit.

*Weatherization:* The process of reducing energy consumption and increasing comfort in buildings by improving the energy efficiency of the building while maintaining health and safety.

*Weatherization Assistance Program (WAP):* DOE's Weatherization

*Weatherization program notices (WPN):* Guidance documents issued by the U.S. Department of Energy for the weatherization program.

*Weather-resistant barrier:* See water-resistive barrier.

*Weatherstripping:* Flexible gaskets, often mounted in rigid metal strips, for limiting air leakage at openings in the shell like doors and windows.

*Webbing:* A reinforcing fabric used with mastics and coatings to prevent patches from cracking.

*Weep holes:* Holes drilled for the purpose of allowing water to drain out of an area in a building where it has accumulated.

*Wet-bulb temperature:* The temperature of a dampened thermometer of a Sling Psychrometer used to determine relative humidity, dew point, and enthalpy.

*Wet spray:* Fibrous insulation mixed with water and sometimes also a binder during installation.

*Whole-house fan:* A fan that draws fresh outside air into the living space, flushes hot air up the attic and exhausts it to the outside.

*Whole-house ventilation:* Controlled air exchange using one or more fans and duct systems.

*Wind effect:* House pressure and airflow between indoor and outdoors caused by the wind.

*Wind washing:* Air entering and leaving the attic is frequently able to blow through fibrous attic insulation, removing heat as it goes.

*Window films:* Plastic films coated with a metallic reflective surface that are adhered to window glass to reflect infrared rays from the sun.

*Window frame:* The sides, top, and sill of the window forming a box around window sashes and other components.

*Window stop:* A wood trim member nailed to the window frame to hold, position, or separate window parts. The stop is often molded into the jamb liners on sliding windows.

*With reference to (WRT):* Compared to another measurement. In weatherization, a way to assess pressure differences between ducts and the rest of the home.

*Work order:* An order authorizing specific work to be done. Sometimes called the work scope.

*Workforce Guidelines:* DOE guidance on specific energy conservation measures; also called Standardized Work Specifications.

*Work scope:* The summary of energy conservation measures, materials lists and labor estimates that is prepared by an energy auditor as part of an energy audit.

*Worst-case depressurization test:* A safety test, performed by specific procedures, designed to evaluate the probability of chimney back-drafting.

*Zone:* A room or portion of a building separated from other rooms by an air barrier.

*Zone pressure diagnostics (ZPD):* Using a blower door to determine the interconnectivity of various building components, which helps the practitioner locate the air barrier and know if the insulation and air barrier are aligned. Also called zonal pressure diagnostics.

# INDEX

## A

---

Acoustical sealant	112	masonry surfaces	183
Adhesives		materials for	108-110
caulking as	111-113	mobile homes	444-445
construction	113	return ducts	335-336
for polystyrene foam	113, 220	supply ducts	337-339
Air barriers		with foam	209-219
air permeance of	480	Air separator	345
definition	480	Air shutters, oil	286
primary vs. secondary	481	Airflow	
testing for leaks	478-487	improving low	324
Air conditioners		testing for unbalanced	319-320
inspections	362-363	troubleshooting	315-320
refrigerant charge	365	Air-free CO measurement	22
Air filters		Air-to-air heat exchangers	390-391
oil burner	290	Alarms	
Air handlers		carbon monoxide	23
See also Blowers		American Gas Association	
see also Furnaces		venting categories	307
sealing holes in	267	Appliances	
Air leakage		energy measures	409-429
of materials, rates	480	Asbestos	38, 50-51
when to test	472	Attics	
Air leaks		air sealing	142
ceilings	141-142	finished	140, 161-166
chimneys	306	hatches	138
floor cavities	141	insulation	146-168
plumbing	203	ventilation	148-395
porches	139	<b>B</b>	
size, type	106	Backdrafting	255
soffits	141	Backer rod	110
stairways	139, 206	Balloon framing	191
Air permeance		Band joists	
of building materials	480	air sealing	183
Air quality	19	insulation	209-210
See also Indoor air quality		Baseload	
Air sealing		analysis example	102
door/window frames	182-183	measures	409-425
duct boots	335-339		

Basements		standard for oil	288
air sealing	207	testing	22, 254
insulation	217-221	Caulking	444
testing for air leakage	487	fire-rated	112
thermal boundary	201-203	types of	111-113
Bathhtub		uses of	141-151
air sealing	204	CAZ	313
Batts		Ceilings	
floor cavities	212-214	air leakage	141-142
for basements	218-219	insulation	146-168
open wall cavities	192-194	Cellulose insulation	
Blower doors		characteristics	119-120
components/description	472-474	stuffing material	110
preparing for tests	474	CFL	417
pressure diagnostics	478-487	See also Compact fluorescent	
simple zone testing	481-482	lamps	
test procedures	475	CFM50	
testing	472-477	defined	472
Blowers		Charge	
controls	322	refrigerant	365
Boilers		Chimney effect. See Stack effect	
corrosion	343	Chimney liners	
efficiency	345-346	sizing	303
low-limit control	346	Chimneys	
maintenance/efficiency	343-344	air leakage	306
sizing	272	air sealing around	134
Burners		all-fuel	304
nozzle for oil	286	and insulation safety	150
oil	285-291	clearances	304
<b>C</b>		masonry specifications	301
<hr/>			
Cad cell	289	measures to improve draft	260
Cans. See Lights, recessed		retrofit liners	302, 309
Cantilevered floor		termination	305
testing	486	types	300
Cantilevered floors		when to reline	308
air sealing	207	Clothes dryers	410, 420-422
Carbon monoxide	21-25, 265	CO	19
air-free measurement	22	See also Carbon monoxide	
alarms	23	Coils	
causes of	22	cleaning	362
causes/solutions	266	Combustion	
exposure limits	22	oil standards	288
		problems/solutions	260

testing/analysis	262-266	unbalanced airflow	319-320
the chemical process	263	Doors	244
Combustion air		mobile home	462
cfm requirements	255, 310	replacement	244
confined spaces	311-313	sealing frames	182-183
methods of providing	310	weatherstrip	247, 248
unconfined spaces	311	Draft	
Combustion losses		and duct improvements	259
excess air	345	measuring, illus.	284
Combustion zone		over-fire	286
definition	255, 310	strength & types of	255
depressurization	107	Draft proofing	
Compact fluorescent lamps	136,	see also Air sealing	
416-418		Drainage	129, 225
Computers, energy consumption	410	Drywall	109, 136, 183, 219, 221
Condenser coils		Duct blower	
cleaning	362	leak-testing	331-333
Construction adhesives	113	Duct mastic	112
Consumption		Ductboard	
of energy	99	deteriorating facing	339
Convectors		Duct-induced house pressure	
fin-tube	346	334-335	
Cooling		Ducts	
evaporative coolers	401-405	air sealing boots	335-339
Corrosion	343	duct-airtightness testing	331-333
Costs		evaluating leakage	327-330
seasonal/baseload	101	finding leaks	327-330
Crawl space		improvements to solve draft problems	259
thermal boundary	488	in crawl spaces	211
Crawl spaces		Insulation	340-341
air sealing	183	mastic	112
thermal boundary	201-203	mobile home leakage	447-448
ventilation	225	pressure-pan testing	328-330
		sealing leaks	335-339
<b>D</b>		sealing return	335-336
		sealing supply	337-339
Dampers		static pressure	316-318
balancing	316	thermal boundary and	489
Dense-packed insulation	189-191	troubleshooting leakage	327-340
Diagnostics		Dust	
airflow	315-320	and respirators	41
building shell	478-487	protecting clients from	51
house pressure	334-335		
pressure-pan testing	328-330		

worker hazard	50-51	R-value	184
<b>E-F</b>		wall batts	192-194
<hr/>			
Efficiency		Fill tubes	
storage water heaters and	437-438	use for wall insulation	456
Efflorescence	31	Filters	363
Egress windows	243	air, installation	267
Electric furnaces. See Furnaces, elec-		Fire partitions	20
tric		Fire safety	
Electric heat	352-359	closed-cell foam	124
baseboard	353	insulation	148-151
furnaces	354	light fixtures	136, 148-149
Electrical safety	42-43	Fireplaces	
Energy		air leakage	134
baseload measures	409-425	Fire-rated assemblies	112
consumption	99	Firewalls	20
Energy auditor		Flame characteristics	283, 292
responsibilities	87-95	Flashings	129
Energy audits		Flexduct	
ethics, bias	88	joints	338
Energy consumption	410	Floors	
Energy factor	437	cantilevered	207, 486
water heating	431	insulation	210-212
Energy recovery ventilators	390-391	mobile homes	457-460
Energy use		sealing cavities	141
analysis	99-102	thermal boundary	488
analysis, example	102	Flue dampers. See vent dampers	
EPA lead rules	39-40	Flue-gas analysis	286
Ethics	88	Fluorescent lamps	
Evaporative coolers	401-405	compact	136
maintenance	404-405	Foam	
operation	402-403	basements, spray	219
sizing, selection	404	characteristics of materials	
Excess air		124-126	
oil burners	288	closed-cell polyurethane	122-124
Expansion tanks	344, 345	injectable	123-124
Fiberglass insulation		liquid applied	209-219
basements	218-219	liquid sealant	113-114
characteristics	117-119	one-part	113-114
floor batts	212-214	open-cell polyurethane	123
floor blowing	211-212	spray	122-124
for stuffing	110	two-part	114
mobile homes	450-460	Foam board	109
		basement insulation	219-221

EPS	125	forced-air	315-342
polyisocyanurate	126	heat pumps	354-358
wall sheathing	196	hot-water	342
XPS	125-126	hydronic	272-273, 344-347
Foundation insulation	216-217	oil-fired	285-291
Furnace fans, energy consumption	410	replacement	273
Furnaces		room heat pumps	358-359
installation	266-271	steam	347-352
operating parameters	323	High limit	
replacement	266-271	hot-water heating	345
sealing holes in	267	steam	349
temperature rise	322	Hot tubs, energy consumption	410

## G

Galvanized steel	109
Garages	
thermal boundary	489
Gas burners	
operation of	263
Gores	338
Ground moisture barrier	35, 128, 202

## H

Hazardous materials	51-52
protective equipment	41, 51
Hazards	
avoiding	19-55
Health and safety	19-55
communication	45-46, 52
customer	21-43
MSDS	52
worker	44-55
Heat pumps	
efficiency	354-358
room	358-359
testing	355-356
Heat recovery ventilators	390-391
Heating systems	
electric	352-359
electric baseboard	353
electric furnaces	354

limits	319
measuring	473
reducing	259
unbalanced airflow	319-320
HRVs.	
See Heat recovery ventilators	
Hydronic heating systems	344-347

## I

IAQ	19
See also indoor air quality	
IC-rated fixtures	136, 149
Ignition barriers	21, 124, 127, 217
Indoor air pollution	
controlling	21-38
Indoor air quality	21-38
see also Ventilation	
worker	50-51
Infiltration	106
See also	
Air sealing, Air leakage	
Injuries	
preventing	44-55
Inspections	
air conditioners	362-363
final	97
in-progress	96

Insulation		Lead-safe weatherization	40-41
attic	146-168	Leakage area	478
basements	217-221	Light fixtures	
cellulose	119-120	fire safety	136, 148-149
cellulose stuffing	110	Lighting	416-418
characteristics	116-126	Line-voltage thermostats	353
dense-packed cellulose	189-191	Low-flow shower head	424
durability	127-129	Low-limit	273
fiberglass batts	192-194, 212-214	Lungs	
fiberglass, blown	211-212	protecting	50-51
fire safety	148-151	Manometers	
foam	209-219	digital	255, 474
foam sheathing	196	Masonry	
foundation	216-217	sealing	183
hydronic pipe	273	Mastic	
hydronic piping	346, 352	duct	112
injectable foam	123-124	Material Safety Data Sheets	47, 51
mobile home	450-460	Mesh tape	338
non-combustible	120, 126	Metering	
polystyrene beads	126	refrigerators	412-414
pourable	126-127	Mildew	106
rock wool	120	See also Mold	
safety	127	Mobile homes	443-465
spray foam	122-123	air sealing	444-445
steam piping	346, 352	air-leakage locations	445
to reduce condensation	33	construction/components	443
wall	184-199	doors	462
wall, mobile home	455	duct leaks	447-448
water heaters	425-429	duct pressure testing	450
Intermediate zones		floor insulation	457-460
defined	473	insulation	450-460
Intumescent paint	21, 127	roof insulation	450-454
<b>J-M</b>		skirting	465
<hr/>		wall insulation	455
Kneewalls	141, 164-166	windows	461-462
Ladders		Moisture	
safety	53-54	and health	30
Lawrence Berkeley Laboratory (LBL)		barriers, ground	31, 35, 202, 225
410		problems	28-33
Lead safety	39-41	source reduction	32-33
EPA RRP rule	39-40	sources	28-30
		water leaks	31-32

Mold 30  
MSDS. See Material Safety Data Sheet

## **N-O**

---

National Fire Protection Association standards 297  
National Safety Council 52  
NFPA. See National Fire Protection Association  
Occupational Safety and Health Administration 45  
Oil burners 285-291  
    air filter 290  
    excess air 288  
    maintenance/adjustment 285-291  
    nozzles 286  
    performance indicators 265, 288  
Oil filters 290  
Oil pressure 265, 288  
Orifices  
    steam 350  
Outdoor thermostat 358  
Over-fire draft 286

## **P-Q**

---

Paint  
    failure 30  
Perlite 126  
Pipe insulation 346, 352  
Plaster 141  
Plumbing penetrations  
    sealing around 203  
Plywood  
    air barrier 109  
Pollution  
    controlling sources 21-38  
Polyethylene  
    cross-linked 110  
Polyisocyanurate foam board 126  
Polystyrene (EPS) beads 126  
Polystyrene foam  
    adhesive for 113

    expanded 125  
    extruded 125-126  
Polyurethane  
    caulking 111-112  
    closed-cell foam 122-124  
    foam sealant 113-114  
    open cell foam 123  
Porch roof  
    testing air leakage through 486  
Porches  
    air leakage 139  
Pressure  
    See also House pressures  
    measuring differences in 473  
    pan testing 328-330  
    WRT notation 473  
    zone leak-testing 481-482  
Pressure boundary. See Air barrier  
Pressure diagnostics. See House pressures, See Diagnostics  
Pressure pan testing 328-330  
Pressure tank 273  
    and pump 273  
Pressure-relief valve 272, 344  
Programmable thermostats 353  
Propane 307  
    finding leaks 253  
Pumps  
    hydronic, installation 273  
Quality assurance 98  
Quality control 97, 98

## **R-S**

---

Radiator valves  
    thermostatic 350  
Radiators 346  
Radon 37  
Recessed lights  
    air sealing 137, 178  
Refrigerant  
    charge 365  
Refrigerators  
    evaluation and replacement

410-412		Silicone	
metering	412-414	caulking	111
Registers		Siliconized latex caulk	111
sealing around	335-339	Sizing	
unoccupied spaces	339	air conditioners	364
Renovation, repair and painting rule		Skirting	
39-40		mobile home	465
Reset controllers	346	Smoke number	288
Respirators	41, 47, 50-51	Soffits	
Rim joists		kitchen	141
air sealing	183	Split-level homes	142
insulation	209-210	Stairways	
Rock wool	120	air leakage	139, 206
Roofs		Static pressure	316-318
mobile homes	450-454	Steady-state efficiency	265, 288
R-values		testing for	286
see also Thermal resistance		Steam	
of blown insulation	184	orifices	350
Safety		Steam heating	347-352
commitment to	45-46	Steam orifices	
communication	20, 45-46	replacing steam traps	350
electrical	42-43	Steam traps	347, 351
fire	148-151	switching to orifices	350
insulation	127	Steel	
ladders	53-54	galvanized	109
new employees	46	Stick pins	341
of residents	38	Storage water heaters	429-438
preventing falls	52-54	efficiency	437-438
storage water heaters	435-436	safety	435-436
tools	54-55	Storm windows	
vehicles	47-48	exterior	225-227
windows	240-243	mobile home	461
worker	44-55	Stove cement	112
Safety and health	19-55	Stuffing materials	110
Scaffolding		Subcooling	365
safety	54	Superheat	365
Sealants		Superheat test	361
caulking	111-113	Supply ventilation	388-389
foam	113-114		
one-part foam	113-114	<b>T-V</b>	
two-part foam	114		
Siding		Tape	
removal	187	holding power	340

Televisions	410	exhaust	387-388
Temperature rise		supply	388-389
furnace	322	systems	386-391
Termites	122, 125, 129	through windows and doors	391
Termiticides	122, 125, 129	whole house	386-391
Thermal barriers	20, 127	see also Indoor air quality	
Thermal boundary		Venting	
see also Insulation		AGA categories	307
basements and crawl spaces		atmospheric	297-303
201-203		fan-assisted	308
flaws in	106	Vermiculite	126
ideal location	489		
Thermal resistance		<b>W-Z</b>	
see also R-values			
improving	177-191, 201-227, 450-462	Walls	
of insulation materials	491	dense-packing	189-191
Thermostatic radiator valves	350	inspection	187
Thermostats		insulated sheathing	196
line voltage	353	insulation	184-199
outdoor	358	Water	
programmable	353	leakage	31-32
two-stage	358	Water heaters	
Tools		energy efficiency	423-427
safety	54-55	insulation	425-429
Torchiere	416-418	setting temperature	427
Tri-level homes	142	storage	429-438
Utility bills		Water temperature	
analysis, example	102	setting	427
Valves		Water-resistive barriers	128, 233
thermostatic radiator	350	Weatherstrip	
Vapor barriers	128	attic hatches	138, 204
Vehicle safety	47-48	doors	247, 248
Vent connectors	297-300	windows	228-229
clearances	298, 299	Well pumps	
materials	297	energy consumption of	410
specifications	298	Windows	
Vent dampers	347	double-hung,	
Ventilation		weatherizing	229-231
attic	148-395	egress	243
balanced	390	exterior storm	225-227
crawl spaces	225	mobile home	461-462
determining need for	373	repair and weatherstrip	228-229
		replacement	231-238
		safety	240-243

sealing frames	182-183
Wood decay	30
Wood heating	292-295
clearances	293
inspection checklist	294
Wood stoves	
UL-listed	293
Work orders	95
Worst-case draft test	107, 255
Zones	
combustion-appliance	255
input vs. reference	473
intermediate	327, 473
pressure testing	481-482
simple pressure test	481